

RESPONSIBILITY MATRIX			
ITEM:	FURNISHED BY:	INSTALLED BY:	COMMENTS:
EAS SYSTEM	AAP	AAP	SENSORMATIC SOLUTIONS. CONTACT: SHAWN PIFER. CONTROLTEK SHAWN.PIFER@CONTROLTEKUSA.COM - (908) 882-2786
SITE CAMERA	G.C.	G.C.	OXBLUE CONSTRUCTION CAMERA SERVICE CONTACT: JONATHAN GARNER 404-400-7610 JGARNER@OXBLUE.COM
STEEL	G.C.	G.C.	NATIONAL ACCOUNT PREFERRED PRICING AVAILABLE THROUGH LIBERTY STEEL FABRICATION, INC. 256-623-3027 AAP@LIBERTYSTEELINC.COM
H.V.A.C. ROOF TOP UNITS & CURBS	G.C.	G.C.	LENNOX NATIONAL ACCOUNT/NO SUBSTITUTIONS. 1-800-367-6285 OR EMAIL: ADVANCEAUTO@LENNOXIND.COM
H.V.A.C. ROOF TOP UNITS & CURBS (ALTERNATE)	G.C.	G.C.	CARRIER NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT: KEN REVILLA STRATEGIC ACCOUNT MANAGER CARRIER RETAIL STRATEGIC ACCOUNTS CELL 954-218-0070 KEN.REVILLA@CARRIER.COM
TESTING H.V.A.C. AND BALANCING	G.C.	N/A	FROM AN INDEPENDENT TEST AND BALANCE COMPANY THAT IS EITHER A MEMBER OF THE 'ASSOCIATED AIR BALANCE COUNCIL' OR THE 'NATIONAL ENVIRONMENTAL BALANCING BUREAU' CERTIFYING TO AAP THAT THE HVAC IS IN CONFORMITY WITH THE MANUFACTURER'S PERFORMANCE STANDARDS
SALES FIXTURES, SHELVING SYSTEM AND GONDOLAS	AAP	AAP	ALL REQUIRED ANCHORING AND SHORING IS THE RESP. OF THE AAP FIXTURE INSTALLATION TEAM.
FIRE EXTINGUISHERS	G.C.	G.C.	G.C. TO OBTAIN FIRE DEPARTMENT APPROVAL FOR FINAL LOCATIONS AND QUANTITIES. (MIN 4)
MISC. SIGNAGE (ADA REQD., CODE RQMTS, ROOM IDENTIFICATION)	G.C.	G.C.	GRAPHICS AND BRANDING TEMPLATES PROVIDED BY AAP.
EMERGENCY & EXIT LIGHTS	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT LOCKE SUPPLY COMPANY (DONALD BROWN) 804-353-2511 EMAIL: AAP@RESCOUSA.COM
EXTERIOR LIGHT FIXTURES	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT LOCKE SUPPLY COMPANY (DONALD BROWN) 804-353-2511 EMAIL: AAP@LOCKESUPPLY.COM
INTERIOR LIGHTING	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT US LED 866-972-9191 EMAIL: ADVANCEAUTOPARTS@USLED.COM
PLUMBING FIXTURES INCLUDES EYEWASH STATION	G.C.	G.C.	NATIONAL ACCOUNTS PREFERRED PRICING AVAILABLE THROUGH HAINES, JONES & CADBURY 800-459-7099 EMAIL: AAP@HJCINC.COM
PYLON SIGN	EX	EX	
ALUMINUM STOREFRONT AT NEW STOREFRONT ONLY	G.C.	G.C.	KAWNEER NATIONAL ACCOUNT/NO SUBSTITUTIONS. WWW.KAWNEER.COM SALES REP VARIES DEPENDING ON LOCATION.
BUILDING SIGNAGE	AAP	AAP	E.C. TO PROVIDE ELECTRICAL CIRCUITS AS NOTED ON PLAN.
TOILET TISSUE DISPENSER PAPER TOWEL DISPENSER SOAP DISPENSER "OPEN" SIGN AT STOREFRONT	AAP	G.C.	WILL BE SHIPPED WITH THE STORE FIXTURE PACKAGE
"COMING SOON" SIGN	AAP	AAP	AAP VENDOR (GC TO REMOVE SIGN)
PAINT	G.C.	G.C.	PPG NATIONAL ACCOUNT/NO SUBSTITUTIONS. COMMERCIAL SALES MANAGER RICK GARLIN EMAIL: GARLIN@PITTSBURGHPAINTS.COM MOBILE, (317) 318-5800
LOW VOLTAGE CABLES (VOICE, DATA, SPEAKERS)	AAP	AAP	AAP VENDOR TO FURNISH & INSTALL ALL CABLES AND SECURE ALL PERMITS
ROOFING (MATERIAL)	EX	EX	EXISTING TO REMAIN. G.C. TO COORDINATE ANY WORK REQUIRED WITH AAP CM AND LANDLORD.
FLOOR FINISH FOR EXPOSED SLAB	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT: CURECRETE DISTRIBUTION, INC. 800-998-5664 OR WWW.ASHFORDFORMULA.COM
			CONTACT: W.R. MEADOWS, INC. 800-342-5976 OR WWW.WRMEADOWS.COM
STOREFRONT SHADES	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. ROLL-A-SHADE ANTONE SESSIONS antonesessions@rollashade.com PROJECT MANAGER P: 951.245.5077 X 131 F: 951.245.5075 WWW.ROLLASHADE.COM
			SHEERWEAVE 2705 OYSTER/PEWTER 5% OPENNESS. FIXED SHADES. OYSTER FACES OUTSIDE AND PEWTER FACES INSIDE.
WINDOW TINT	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. INSTALL WINDOW TINT AS PER MERCHANDISE PLAN. LLUMAR SINGLE PANE: DL 05 GE SR CDF - GRAY LLUMAR DOUBLE PANE: DR 15 SR CDF - GRAY GC TO VERIFY TYPE OF GLAZING IN FIELD.
AIR CURTAIN	G.C.	G.C.	NATIONAL ACCOUNT/NO SUBSTITUTIONS. JAMIE JAZWINSKI - REGIONAL SALES MANAGER POWERED AIRE, INC OFFICE 724-588-3305 CELL 724-866-8628 JAMIE.J@POWEREDAIRE.COM WWW.POWEREDAIRE.COM
SECURITY ALARM (MONITORED BY ADT)	AAP	AAP	EVERON SOLUTIONS - MIKE MAYO NATIONAL ACCOUNT MANAGER 5321 VALLEY PARK, VA 24019 PHONE:540-589-2798 MICHAEL.MAYO@EVERONSOLUTIONS.COM ANDREW CARSON - ACASON@EVERONSOLUTIONS.COM
ENERGY MANAGEMENT SYSTEM (EMS)	AAP	AAP	NATIONAL ACCOUNT/NO SUBSTITUTIONS. CONTACT BRAINBOX AI (FORMERLY TELETROL) retail.support@brainboxai.com NATIONAL ACCOUNTS HOTLINE (888) 211-6789 Fax: (855) 224-0879 DAVID WHEAT - D.WHEAT@BRAINBOXAI.COM
			NOTE: THE EMS SYSTEM IS TO BE INSTALLED BY THE AAP VENDOR AFTER THE PROJECT IS TURNED OVER FROM THE GC TO AAP.

Advance
Auto Parts 
221 GROVE CITY RD
SLIPPERY ROCK, PA 16057

GENERAL NOTES

1.

CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL CODES, LAWS AND REGULATIONS. CONSTRUCTION SHALL ALSO COMPLY WITH ADVANCE AUTO PARTS' CRITERIA (UNLESS PRECLUDED PER CODE.)

2.

THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ADVANCE AUTO PARTS OF ANY DISCREPANCIES PRIOR TO BIDDING.

3.

ALL MATERIALS INDICATED AS NEW SHALL BE PROVIDED BY CONTRACTOR UNLESS OTHERWISE NOTED. NO SUBSTITUTIONS ALLOWED.

4.

DURING THE COURSE OF CONSTRUCTION; IF THE CONTRACTOR UNCOVERS ANY CODE VIOLATIONS KNOWN TO THE CONTRACTOR OR ANY DISCREPANCY WITH THE DESIGN, SAID CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ADVANCE AUTO PARTS' CONSTRUCTION PROJECT MANAGER IMMEDIATELY.

5.

CONTRACTOR SHALL ASSEMBLE AND INSTALL MATERIALS/PRODUCTS IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND INDUSTRIAL/ASSOCIATION STANDARDS.

6.

OPEN CEILING SALES AREA DESIGN: ALL MECHANICAL, ELECTRICAL AND LOW VOLTAGE SHOULD BE STRAIGHT, TRUE, PLUMB AND SQUARE TO THE BUILDING. TIED OFF CONTINUOUSLY TO STRUCTURE AS TIGHT AS POSSIBLE, AND AS CONCEALED AS POSSIBLE. NO FREE AIR OR DIAGONAL ROUTING METHODS.

7.

GENERAL CONTRACTOR TO PROVIDE THE FOLLOWING CLOSE OUT DOCUMENTS:

7.1.

LIST OF SUBCONTRACTORS

7.2.

COPIES OF ALL PERMITS

7.3.

HVAC TEST AND BALANCE REPORT

7.4.

ROOF MANUFACTURERS WARRANTY

7.5.

PAVEMENT CERTIFICATION (ASPHALT & CONCRETE)

7.6.

COPY OF CERTIFICATE OF OCCUPANCY LISTING ADVANCE STORES COMPANY, INC. AS THE "OCCUPANT" D.B.A. ADVANCE AUTO PARTS.

7.7.

FINAL LIEN WAIVERS AND AFFIDAVITS TO BE PROVIDED BY ALL VENDORS AND SUPPLIERS FOR CONTRACTOR.

7.8.

ALL CLOSE-OUT DOCUMENTS ARE TO BE POSTED ELECTRONICALLY TO LUCERNEX

7.9.

G.C. IS TO PLACE THE STAMPED SET / CONSTRUCTION / AS BUILT DRAWINGS IN A 4" PVC TUBE. PLACE CAPS AT EACH END AND DRILL 1/4" HOLE INTO EACH END AND MOUNT IN OR ABOUT ELECTRICAL / PHONE BOARD.

8.

FINAL CLEANING - COMPLETE THE FOLLOWING CLEANING OPERATIONS BEFORE REQUESTING FINAL INSPECTION.

8.1.

REMOVE LABELS THAT ARE NOT PERMANENT LABELS.

8.2.

CLEAN TRANSPARENT MATERIALS, INCLUDING MIRRORS AND GLASS IN DOORS AND WINDOWS. REMOVE GLAZING COMPOUND AND OTHER SUBSTANCES THAT ARE NOTICEABLE VISION-OBSCURING MATERIALS.

8.3.

CLEAN EXPOSED EXTERIOR AND INTERIOR HARD-SURFACED FINISHES TO A DUST-FREE CONDITION, FREE OF STAINS, FILMS AND SIMILAR FOREIGN SUBSTANCES. LEAVE CONCRETE FLOORS BROOM CLEAN.

8.4.

CLEAN PLUMBING FIXTURES TO A SANITARY CONDITION. CLEAN LIGHT FIXTURES AND LAMPS.

8.5.

CLEAN THE SITE, INCLUDING LANDSCAPE DEVELOPMENT AREAS, OF RUBBISH, LITTER AND OTHER FOREIGN SUBSTANCES. SWEEP PAVED AREAS BROOM CLEAN; REMOVE STAINS, SPILLS AND OTHER FOREIGN DEPOSITS.

8.6.

COMPLY WITH REGULATIONS OF AUTHORITIES HAVING JURISDICTION AND SAFETY STANDARDS FOR CLEANING.

8.7.

PRESSURE WASH ENTIRE PARKING LOT AND WALKWAYS ADJACENT TO BUILDING.

9.

GENERAL CONTRACTOR RESPONSIBLE TO PRODUCE WEEKLY STATUS REPORT.

10.

G.C. TO PROVIDE SNOW REMOVAL SERVICES AS REQUIRED FOR STAND ALONE AND GROUND UP LOCATIONS.

11.

LOCKBOX CODE FOR SPACE SHOULD BE LAST 4 DIGITS OF THE STORE NUMBER. COORDINATE WITH AAP CM.

12.

G.C. SHALL BE RESPONSIBLE TO ENSURE PROPER WORKING ORDER AND FREE OF DAMAGE FOR ALL AMENITIES TO REMAIN

TITLE SHEET

F1

TITLE SHEET

F1.1

LIFE SAFETY PLAN - EGRESS AND FIRE EXTINGUISHERS

STRUCTURAL

F1

FIXTURE LAYOUT PLANS

F2

SHELVING DETAILS

ARCHITECTURAL

D1

DEMOLITION / EXISTING CONDITIONS PLAN

D2

DEMOLITION / EXISTING CONDITIONS CEILING PLAN

A1

FLOOR PLAN

A1.1

FLOOR PLAN DETAILS

A2

ENLARGED PLAN, ELEVATIONS AND TYPICAL DETAILS

A2.1

DOOR SCHEDULE, DETAILS AND NOTES

A3

MERCHANTISE PLAN

A4

ROOF PLAN AND DETAILS

A5

REFLECTED CEILING PLAN

A6

EXTERIOR ELEVATIONS

MECHANICAL

M1

HVAC FLOOR PLAN

M2

HVAC SCHEDULES

MECHANICAL/PLUMBING

MP1

HVAC / PLUMBING SPECIFICATIONS

PLUMBING

P1

PLUMBING FLOOR PLANS

P2

PLUMBING SCHEDULES AND DETAILS

ELECTRICAL

E1

POWER PLAN, NOTES AND DETAILS

E2

ENLARGED COUNTER DETAILS

E3

LIGHTNING PLAN, SCHEDULE AND NOTES

E4

SPECIFICATIONS, PANEL SCHEDULES AND RISER DIAGRAM

ATTACHED

FIXTURE ANCHOR CALCULATIONS

MECHANICAL COMCHECK

ELECTRICAL COMCHECK

SPECIAL INSPECTIONS NOTE

ANY SPECIAL INSPECTIONS OR 3RD PARTY ENGINEERING IS THE RESPONSIBILITY OF THE G.C.

G.C. TO COORDINATE WITH THE BUILDING DEPARTMENT FOR TIMING.

SYMBOLS

SECTION NUMBER
SHEET WHERE DRAWN, TYP.

FACE OF WALL / COLUMN LINE IDENTIFIER

ELEVATION OF FLOOR

NOTE REFERENCE

1

A4

1

2

FIN. FLR.
EL.: +0'-0"

5

ROOM NAME

100

 ROOM NAME

WALL TYPE NUMBER

3

DOOR NUMBER
101

EXTERIOR ELEVATION NUMBER
SHEET WHERE DRAWN

1

A3

DETAIL NUMBER
SHEET WHERE DRAWN

5

A7

PROJECT DIRECTORY

OWNER:

ADVANCE AUTO PARTS, INC.

ADDRESS:

1136 PLANTATION RD., N.E.
ROANOKE VA 24012

CONTACT: PATRICK MCCUEN
patrick.mccuen@advance-auto.com

ARCHITECT:

ADDRESS:

STEVEN BRUCE GARAND
1103 SCHROCK RD, SUITE 405
COLUMBUS, OH 43229

PHONE:

614-436-0100

EMAIL :

TCRAWFORD@CSG2MSTUDIOS.COM

CONTACT: TONY CRAWFORD

MEP ENGINEER:

ADDRESS:

POINT ONE DESIGN, LLC
2800 CORPORATE EXCHANGE DR., #270
COLUMBUS, OH 43231

PHONE:

614-540-3500

FAX:

614-540-3502

EMAIL:

VELLETT@POINTONDESIGN.COM

CONTACT: VIRGIL ELLETT

PLANNING & ZONING:

ADDRESS:

SLEEPERY ROCK BOROUGH
OFFICE OF ZONING & CODE ENFORCEMENT
306 E WATER ST., SLIPPERY ROCK, PA 16057

PHONE:

724-794-6391

EMAIL:

KURT.REASNERR@SLIPPERYROCKBOROUGHPA.GOV

CONTACT: KURT REASNER
CODE ENFORCEMENT OFFICER

FIRE DEPARTMENT:

ADDRESS:

SLEEPERY ROCK BOROUGH
306 E. WATER STREET,
SLIPPERY ROCK, PA 16057

PHONE:

724-794-6434

CONTACT: STAFF

BUILDING DEPARTMENT:

ADDRESS:

SLEEPERY ROCK BOROUGH
306 E. WATER ST.
SLIPPERY ROCK, PA 16057

PHONE:

724-794-6391

EMAIL:

BORO_ADMIN@SLIPPERYROCKBOROUGHPA.GOV

CONTACT: STAFF

SITE MAP

The site map shows the project location highlighted by a red square and labeled with a black box containing the number 1. The map includes surrounding streets such as Kelly Blvd, Bolter Dr, Grove City Rd, Franklin St, E Water St, and Elvaston St. Nearby businesses like Google Supermarket, First National Bank, Fairfield Inn, Slippy's Pizza, and various other shops are also indicated.

ADVANCE
AUTO PARTS

THIS BOX IS FOR ADVANCE AUTO PARTS OFFICE ONLY

Q1-26 83x83

SCOPE OF WORK

INTERIOR FIT-UP OF AN EXISTING BUILDING, MODIFYING EXISTING BUILDING SYSTEMS RELATING TO MECHANICAL, PLUMBING, AND ELECTRICAL.

CODE ANALYSIS

A. BUILDING CRITERIA

BUILDING CODE: PENNSYLVANIA BUILDING CODE (IBC 2021)

BUILDING CODE: INTERNATIONAL EXISTING BUILDINGS CODE (IEBC 2021)

MECHANICAL CODE: PENNSYLVANIA MECHANICAL CODE (IMC 2021)

ELECTRICAL CODE: PENNSYLVANIA ELECTRICAL CODE 2020 (NFPA 70, 2020)

PLUMBING CODE: PENNSYLVANIA PLUMBING CODE (IPC 2021)

ENERGY CODE: PENNSYLVANIA ENERGY CODE (IECC 2021)

FIRE CODE: PENNSYLVANIA FIRE CODE (IFC 2021)

ACCESSIBILITY CODE: 2018 I CODES/2010 ADA STANDARDS - ADA 2010/ANSIA117.1-2009

LOCAL ORDINANCE: IF APPLICABLE

OCCUPANCY: MERCANTILE

BUILDING/CONSTRUCTION TYPE: IIB

ALTERATION LEVEL: LEVEL 3

SPRINKLERED: NO

FIRE ALARM: NO

SEISMIC ZONE (DESIGN CATEGORY): B

FIXTURE ANCHORING REQUIRED: YES

ALLOWABLE BUILDING AREA: 12,500 SQ. FT.

SEPARATE FIXTURE PERMIT REQUIRED: NO

SEPARATE LOW VOLTAGE PERMIT REQUIRED: NO

B. BUILDING AREA

SALES AREA: 10,285 SQ. FT.

NON-SALES AREA (RESTROOMS): 976 SQ. FT.

TOTAL FLOOR AREA: 11,261 SQ. FT.

C. OCCUPANT LOADING

SALES AREA @ 30/PERSON = 342

NON-SALES AREAS @ 300/PERSON = 4

TOTAL OCCUPANT LOAD= 346

D. EGRESS

EGRESS WIDTH REQUIRED: 36"

EGRESS WIDTH PROVIDED: 104"

NUMBER OF EXITS REQUIRED: 2

NUMBER OF EXITS PROVIDED: 2

E. PLUMBING FIXTURE COUNT

IPC 2021 TABLE 403.1 - MINIMUM NUMBER OF REQUIRED FIXTURES:

OCCUPANCY: MERCANTILE

WATER CLOSET REQUIREMENTS: 1 PER 500 FOR MALE AND FEMALE

LAVATORY REQUIREMENTS: 1 PER 750 FOR MALE AND FEMALE

DRINKING FOUNTAINS: 100 - 1,000: 1 REQUIRED

SERVICE SINK: 1 REQUIRED

GENDER NEUTRAL PLUMBING FIXTURES QUANTITIES PROVIDED:

TOILET ROOMS REQUIRED: 2 REQUIRED

LAVATORIES PER ROOM: 1

WATER CLOSETS PER ROOM: 1

URINALS PER ROOM: 0

DRINKING FOUNTAIN(S) NUMBER PROVIDED: 1 BI-LEVEL DRINKING FOUNTAIN


MOP SINK PROVIDED: 1

NON-SALES AREA

NON-SALES	300 / PER.
976 S.F	4

SALES AREA

MERC.	30 / PER.
10,285 S.F	342

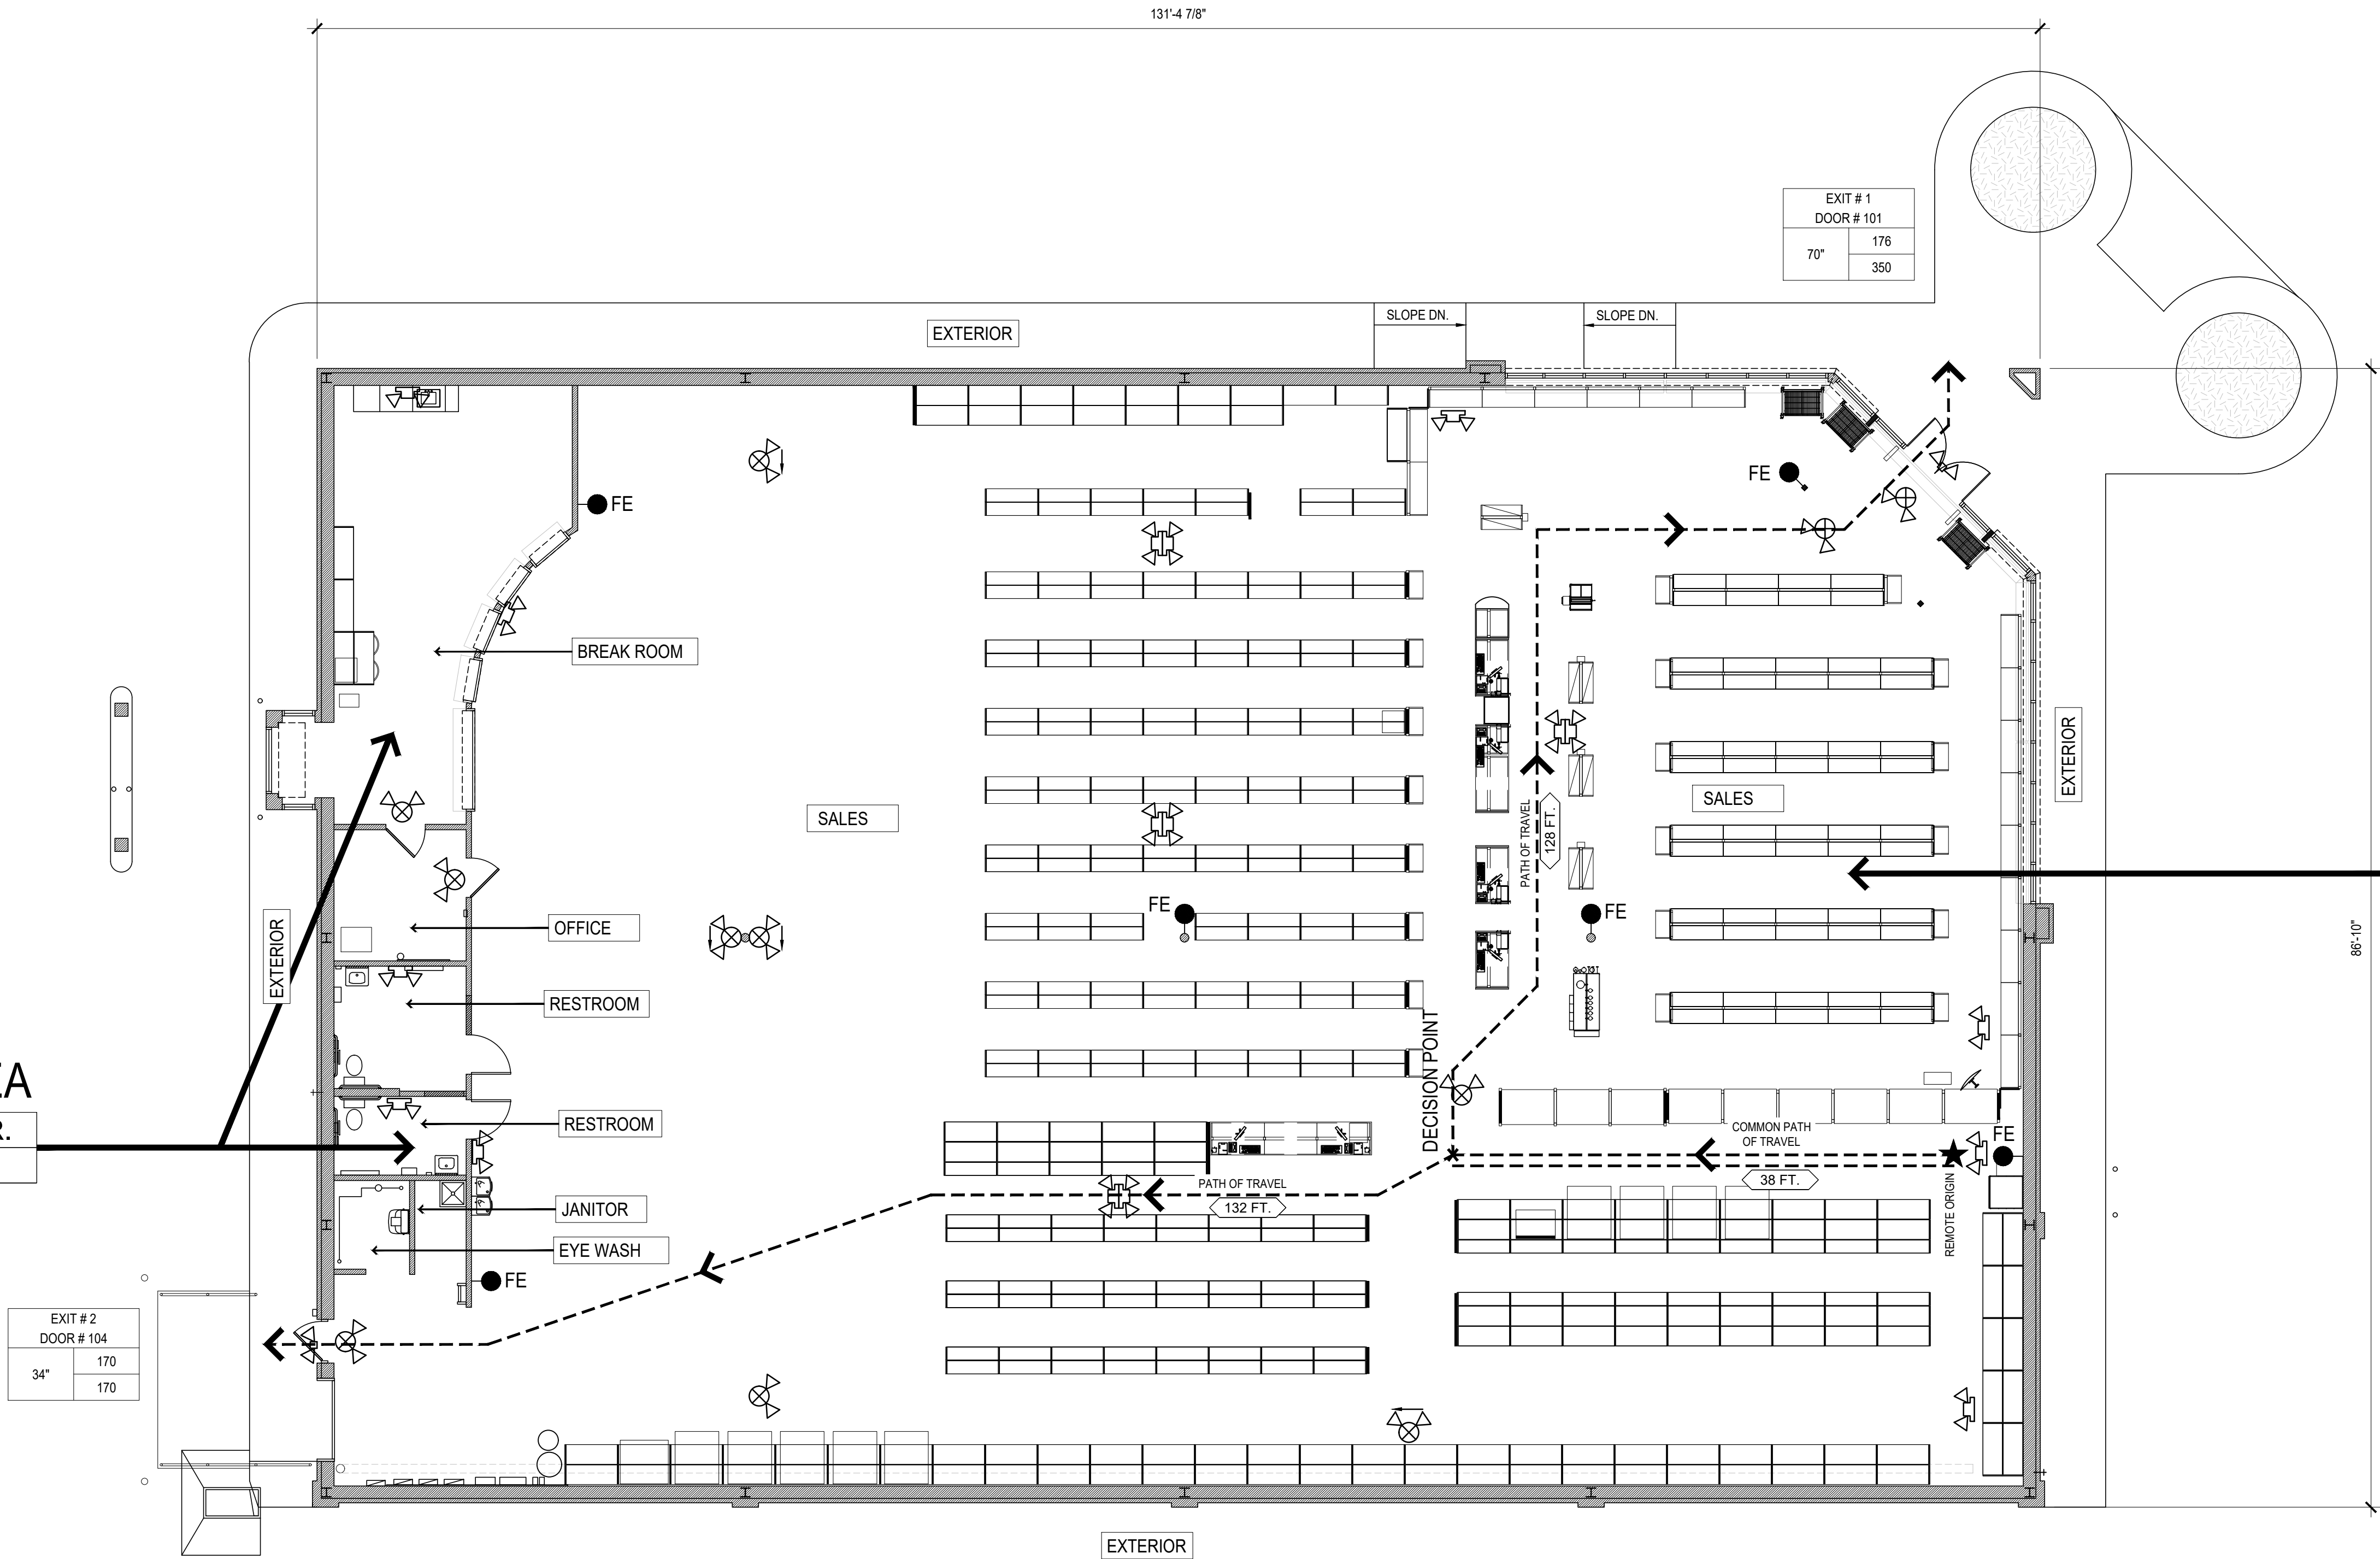

EGRESS PLAN & F.E. PLAN LEGEND

FE ●

●

⬆

⬆

×

⬆

⬆

FE - FIRE EXTINGUISHER

EMERGENCY LIGHT

EMERGENCY LT. / EXIT SIGN (COMBO SIGN WITH BLANK PLATE ON BACKSIDE)

DECISION POINT

EMERGENCY LIGHT REMOTE HEAD

REMOTE ORIGIN

EGRESS DOOR SYMBOL KEY

EXIT CAPACITY

EXIT # X

DOOR # XXX

XX


XXX

EXIT NUMBER

DOOR NUMBER

EXPECTED LOAD

MAXIMUM LOAD

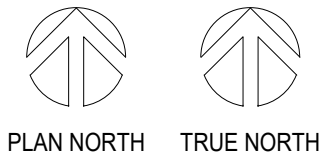

REGISTERED ARCHITECT

PA 0000000000

2018

SEAN E. CONRAD

2018

221 GROVE CITY RD.

SLIPPERY ROCK, PA 16057

Advance Auto Parts

STORE # TBD

REV	DATE	DESCRIPTION

DATE	GROSS SQ. FT.
6-18-26	11,261 S.F.

PROJECT # 330

DRAWN BY: STAFF

CHECK BY: STAFF

VERSION Q1-26 83x83

ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL, AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE ARE HEREBY SPECIFICALLY RESERVED.

LIFE SAFETY

PLAN - EGRESS &

FIRE EXTINGUISHERS

T1.1

DATE 6-17-26	CROSS SQ. FT. 11,287 S.F.
PROJECT # 300	
DEVELOPER: STAFF	
CHECKER: STAFF	

VERSION Q1-26 83x83

ALL REPORTS, PLANS, SPECIFICATIONS,
FIELD DATA, NOTES AND OTHER
DOCUMENTS, INCLUDING ALL
DOCUMENTS ON ELECTRONIC MEDIA,
PREPARED BY THE DESIGN
PROFESSIONAL AS INSTRUMENTS OF
SERVICE SHALL REMAIN THE PROPERTY
OF THE DESIGN PROFESSIONAL.
DISSEMINATION MAY NOT BE MADE
WITHOUT PRIOR CONSENT OF THE
DESIGN PROFESSIONAL. ALL COMMON
LAW RIGHTS OF COPYRIGHT AND
OTHERWISE, ARE HEREBY SPECIFICALLY


FIXTURE PLAN
 GEN. NOTES

F1

WIDESPAN & STORAGE SHELVING BASE PLATE



SHELVING BASE PLATES:



A) 4" THICK CONCRETE
F'C = 2,500 PSI MIN.
ALLOWABLE SOIL BEARING: 1,000 PSF

A) 1/4" & 3/8" Φ HILTI KUWIK HUS EZ ANCHORS
SAE J403 GRADE 10B21
ESR*-3021
1/4" Φ INSTALLATION TORQUE (T_{INST}): 18 FT. LBS.
3/8" Φ INSTALLATION TORQUE (T_{INST}): 40 FT. LBS.

B) 3/8" Φ SIMPSON TITEN HD SCREW ANCHOR
FOR CMU AND CONCRETE WALL ATTACHMENT
ESR*-1056 & ESR*-2713
INSTALLATION TORQUE (T_{INST}): 50 FT. LBS

C) 3/8" Φ SIMPSON STRONG-TIE TITEN HD ANCHORS
SAE J403 GRADE 10B21
ESR*-2713
INSTALLATION TORQUE (T_{INST}): 50 FT. LBS.

D) 3/8" ϕ DEWALT SCREW-BOLT + ANCHORS
ASTM B633 OR ASTM B695, CLASS 55
ESR*-3889
INSTALLATION TORQUE (T_{INST}): 25 FT. LBS

E) SPECIAL INSPECTION IS NOT REQUIRED.

BUILDING CODE: 2022 UNIFORM CONSTRUCTION CODE AND
2021 INTERNATIONAL BUILDING CODE WITH
STATE AMENDMENTS

<u>SEISMIC:</u>	ASCE 7-16 & RPT ANS/MIH 16.1-12	
S _a		= 0.098
S ₁		= 0.044
S _{0.2}		= 0.105
S _{D1}		= 0.070
SEISMIC IMPORTANCE FACTOR		= 1.5
RISK CATEGORY		= II
SEISMIC SITE CLASS		= D
SEISMIC DESIGN CATEGORY		= B
RESPONSE MODIFICATION FACTOR (R)		= 4
SEISMIC RESPONSE COEFFICIENT (C _s)		= 0.04

FRAME A:	DL = 3.0 PSF/SHELF LL = 20.0 PSF/SHELF
FRAME A1:	DL = 3.0 PSF/SHELF LL = 20.0 PSF/SHELF

FRAME B: DL = 5.0 PSF/SHELF
LL = 500 LBS/SHELF

FRAME C:	DL = 5.0 PSF/SHELF LL = 680 LBS/SHELF
FRAME EI:	DL = 3.0 PSF/SHELF LL = 15.0 PSF/SHELF


NOTE:
ALL STEEL STORAGE SHELVING SHALL BE INSTALLED PER 2022
UNIFORM CONSTRUCTION CODE AND 2021 INTERNATIONAL BUILDING
CODE WITH STATE AMENDMENTS AND THE MANUFACTURERS
RECOMMENDATIONS.



NOTE:
DESIGN, TESTING AND UTILIZATION OF INDUSTRIAL STEEL STORAGE
RACKS ARE IN ACCORDANCE WITH THE RMI SPECIFICATION.

ICC ESR EVALUATION SERVICES REPORT ARE INCLUDED IN THE CALCULATIONS, APPENDIX 'C'.




"NOTE ** : SECTION 105.2 WORK EXEMPT FROM PERMIT
- EXEMPTION FROM PERMIT REQUIREMENTS OF THIS CODE SHALL
NOT BE DEEMED TO GRANT AUTHORIZATION FOR ANY WORK TO BE
DONE IN ANY MANNER IN VIOLATION OF THE PROVISIONS OF THIS
CODE OF ANY OTHER LAWS OR ORDINANCES OF THIS JURISDICTION.
PERMITS SHALL NOT BE REQUIRED FOR THE FOLLOWING:
SECTION 105.213 - MOVEABLE AND MOVEABLE FIXTURES,
CLOSER, RACKS, COUNTERS AND PARTITIONS NOT OVER
5 FEET, 9 INCHES (69 1/2 INCHES) IN HEIGHT.

SCOPE OF WORK:
CONTRACTOR SHALL INSTALL NEW LOZIER FIXTURES PER THE
FIXTURE PLAN, DRAWINGS AND DETAILS AS SHOWN IN THIS SET.
FIXTURES SHALL BE ANCHORED IN ACCORDANCE WITH PLANS.
STORAGE HEIGHTS FOR COMMODITIES ARE LESS THAN 12'-0".
NO HIGH PILE STORAGE IS USED FOR THIS STORE.

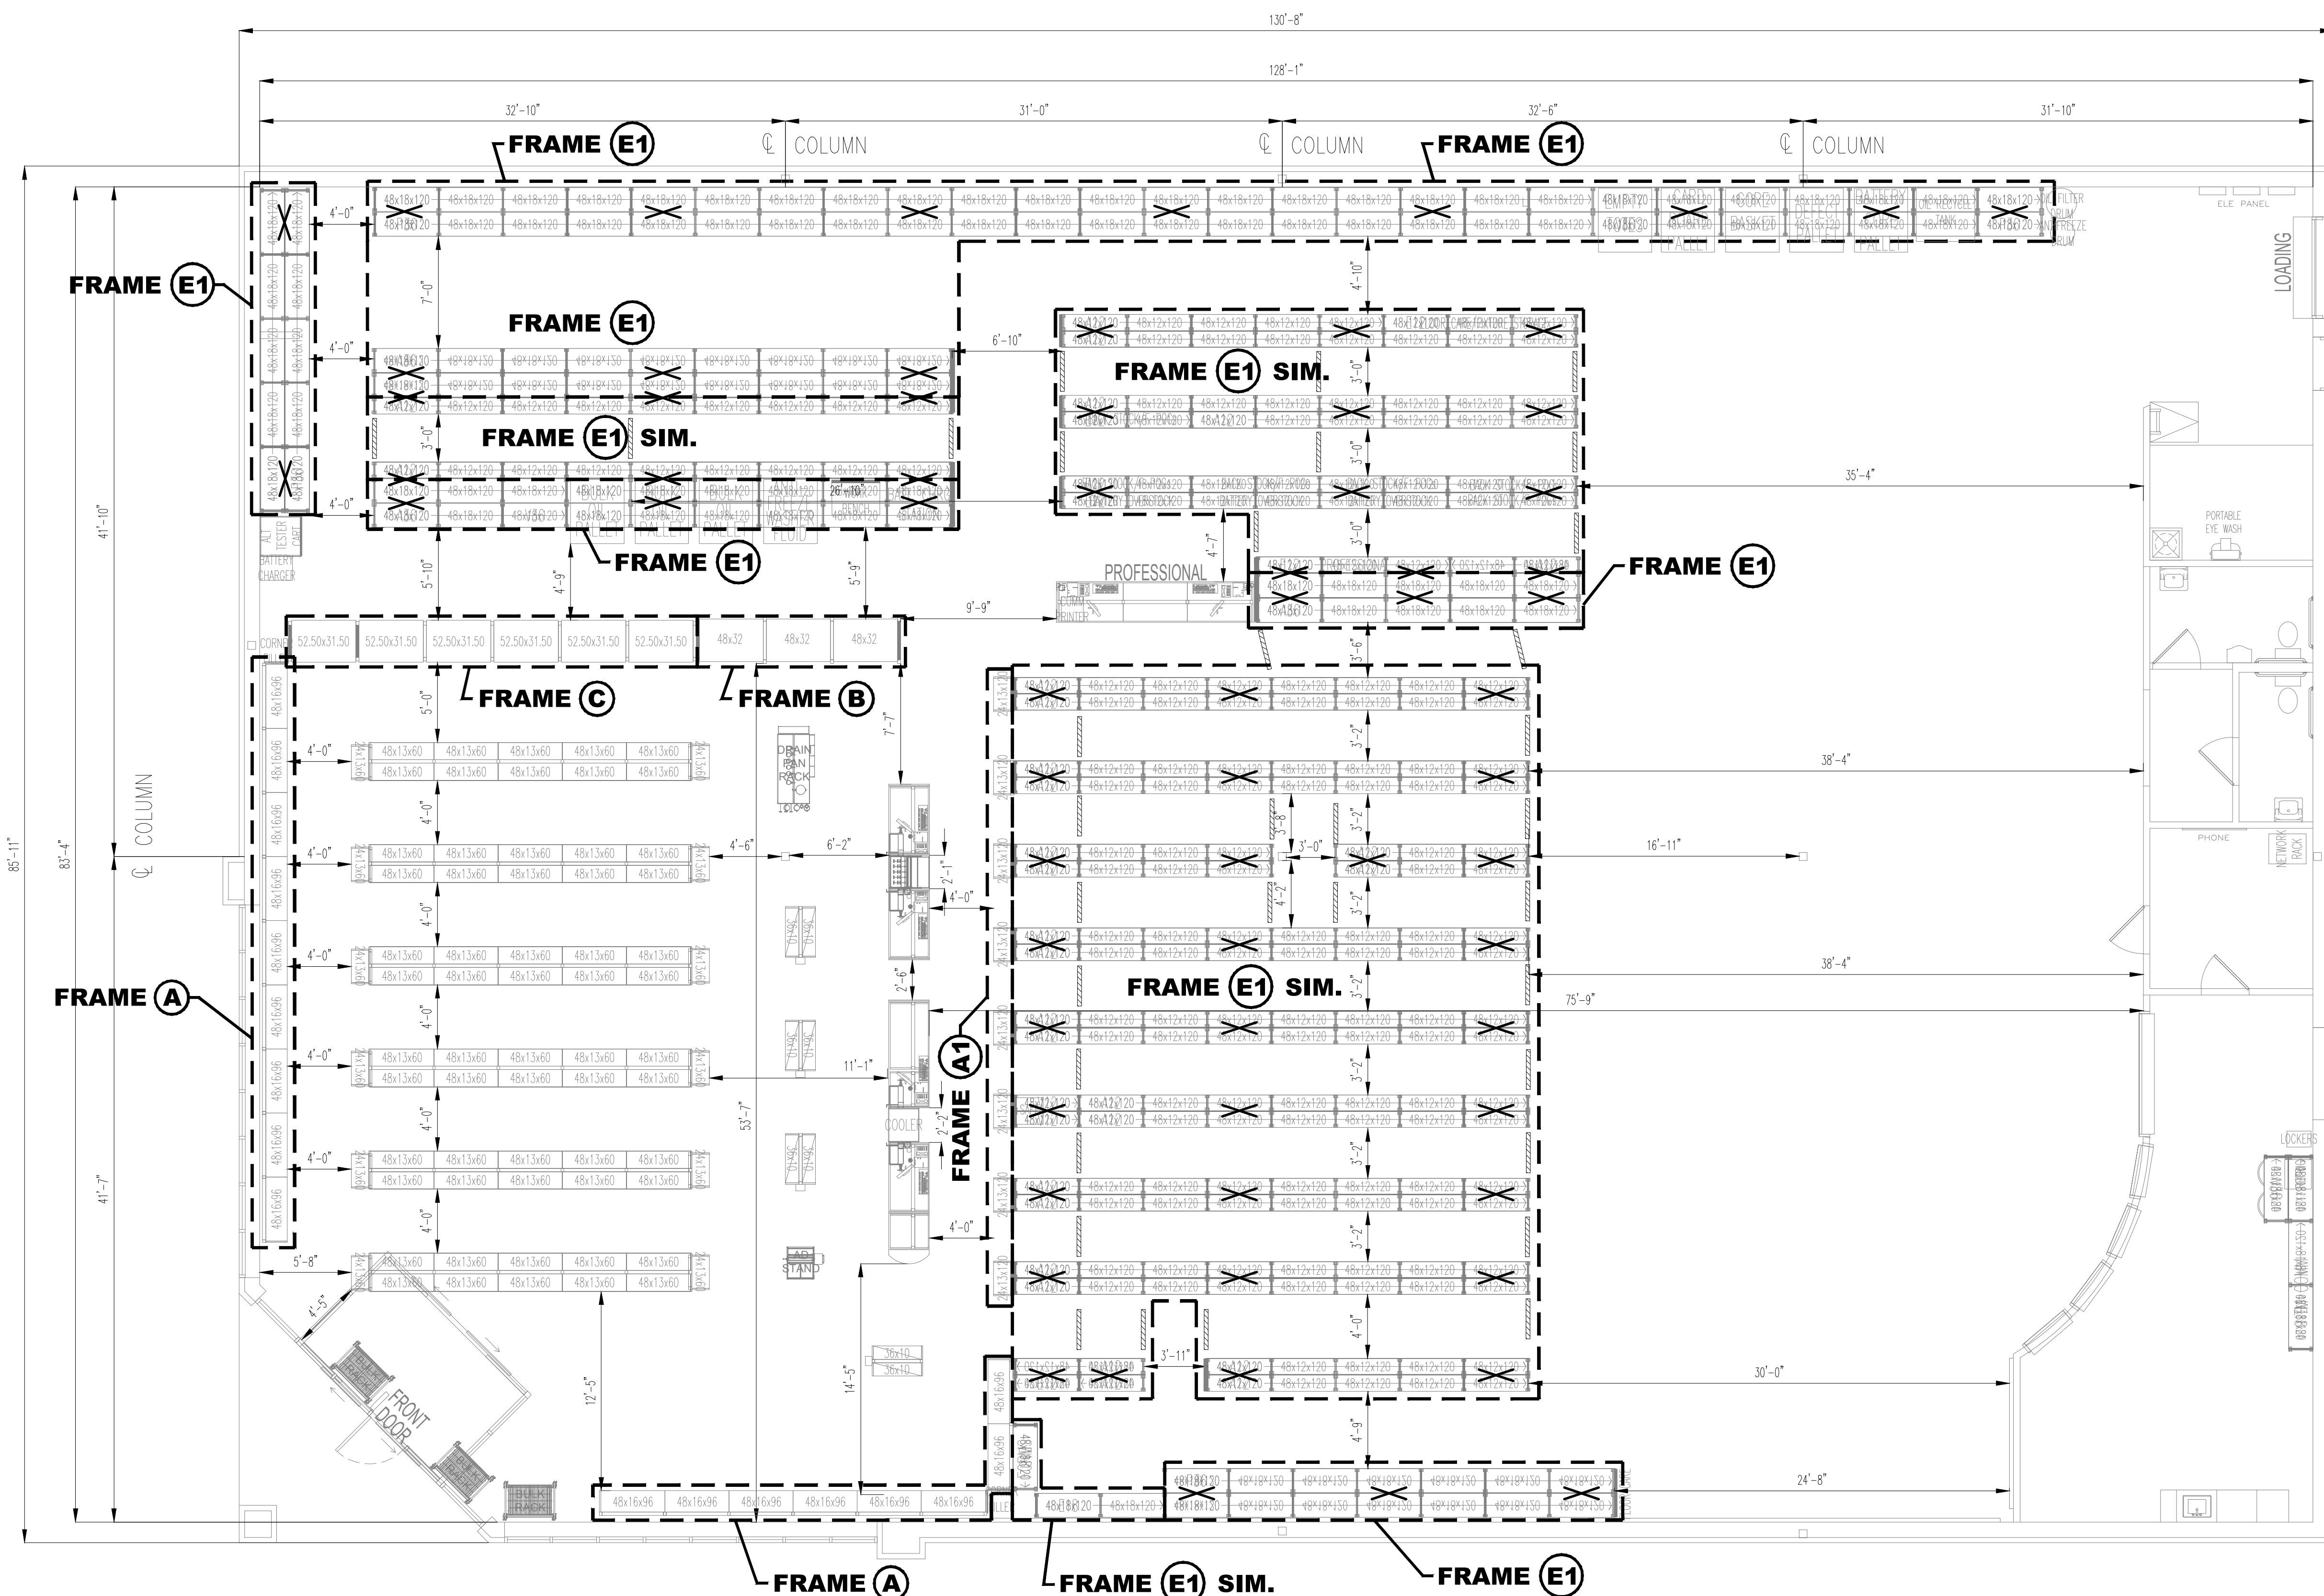

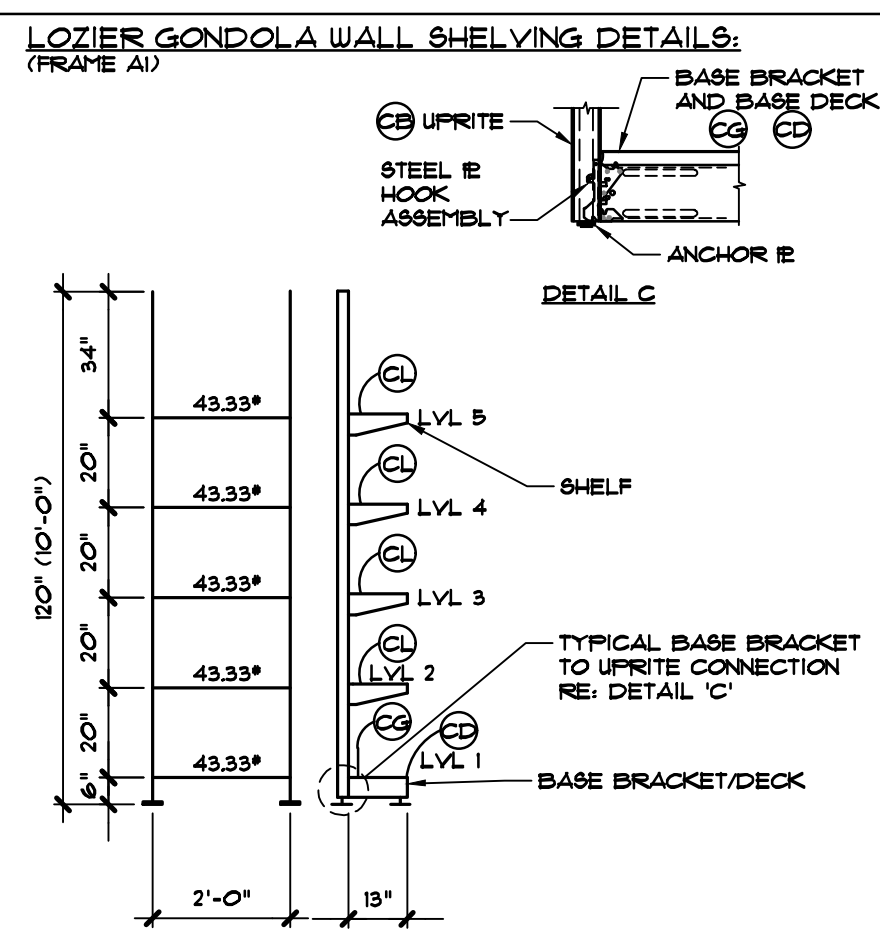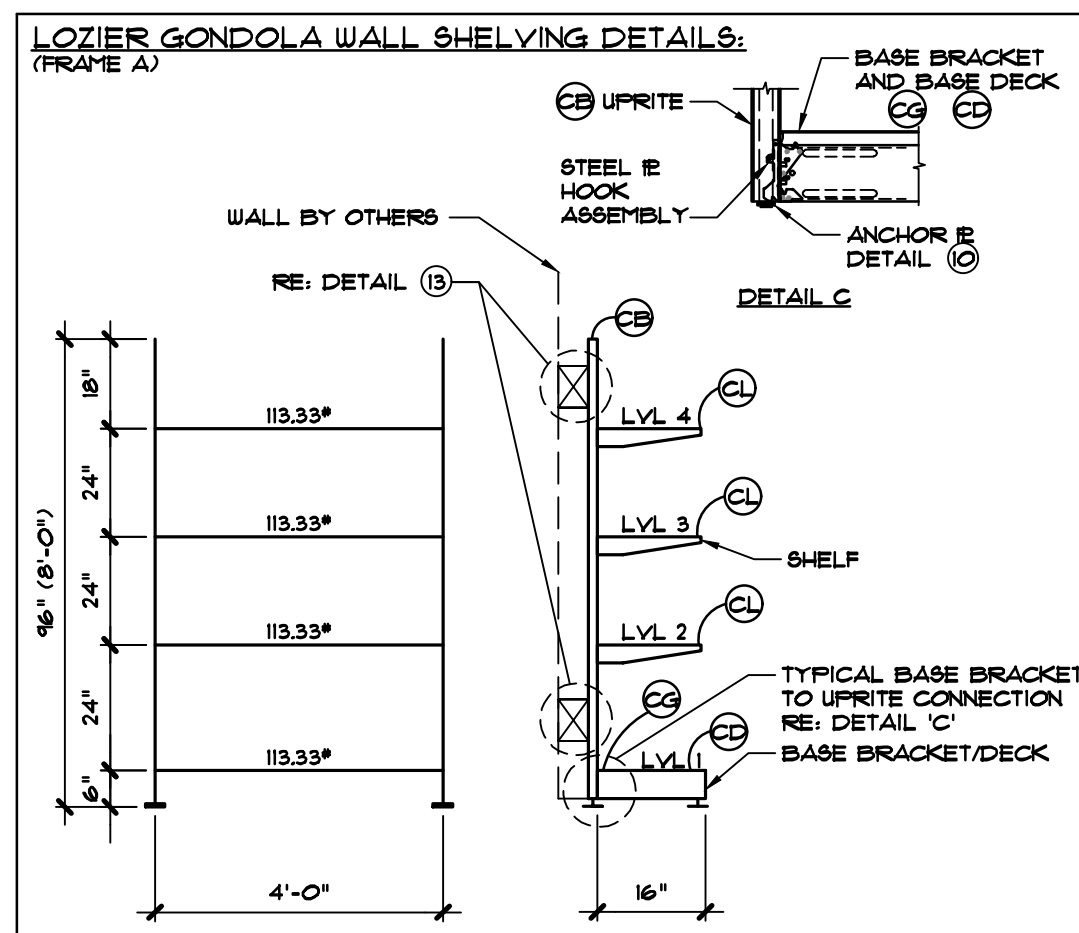


NOT USED

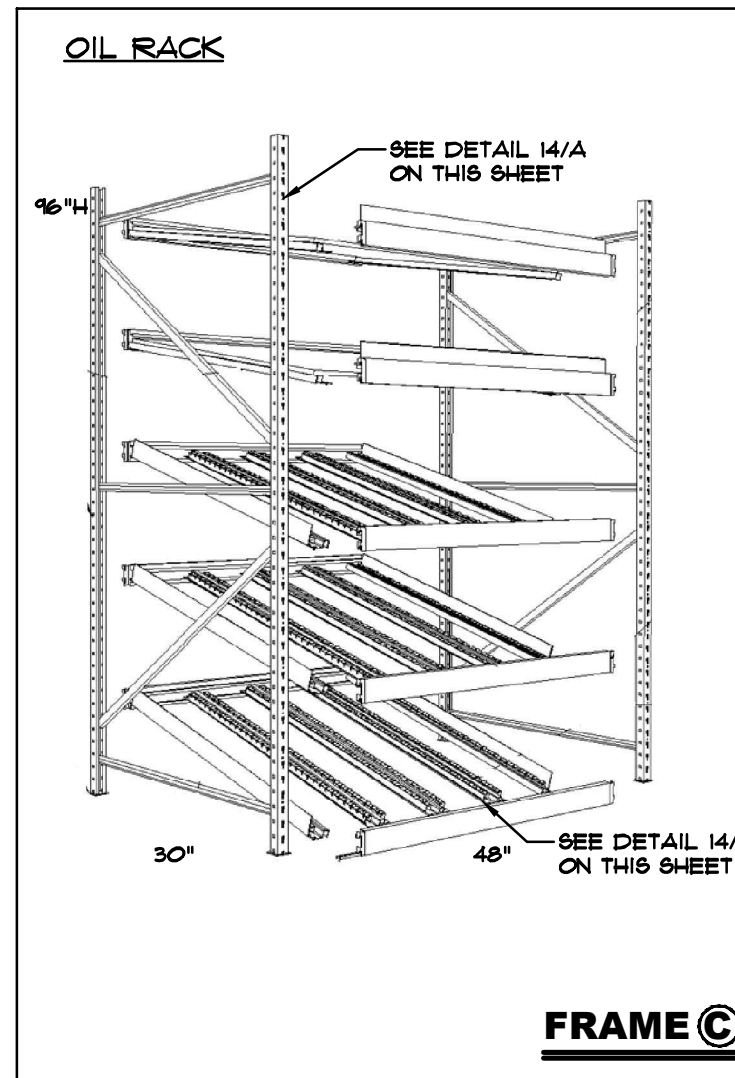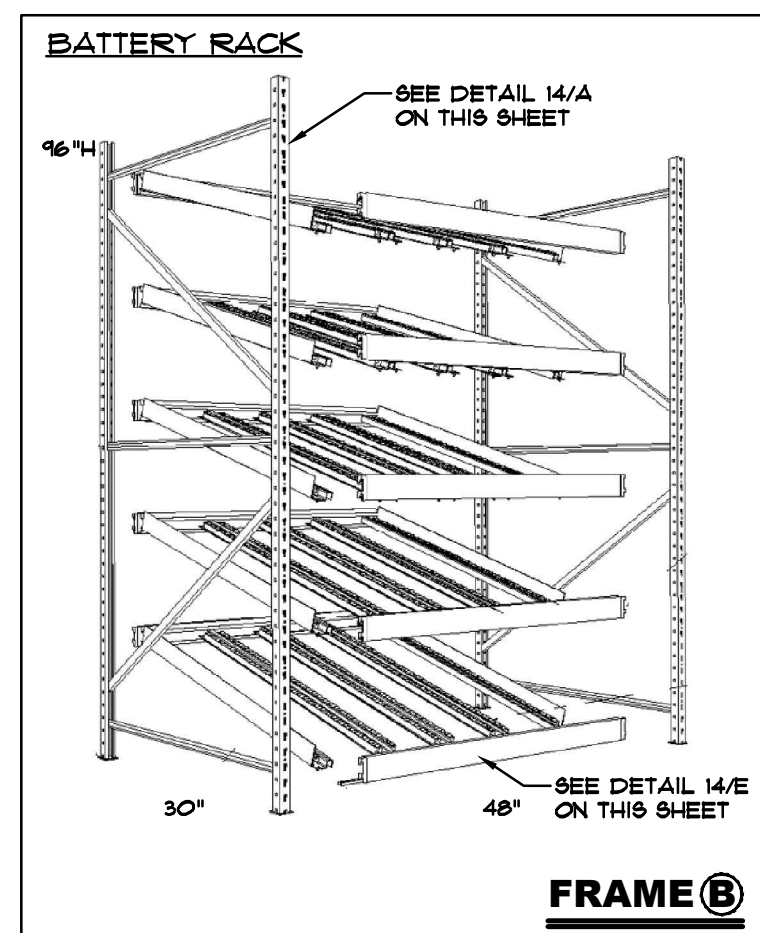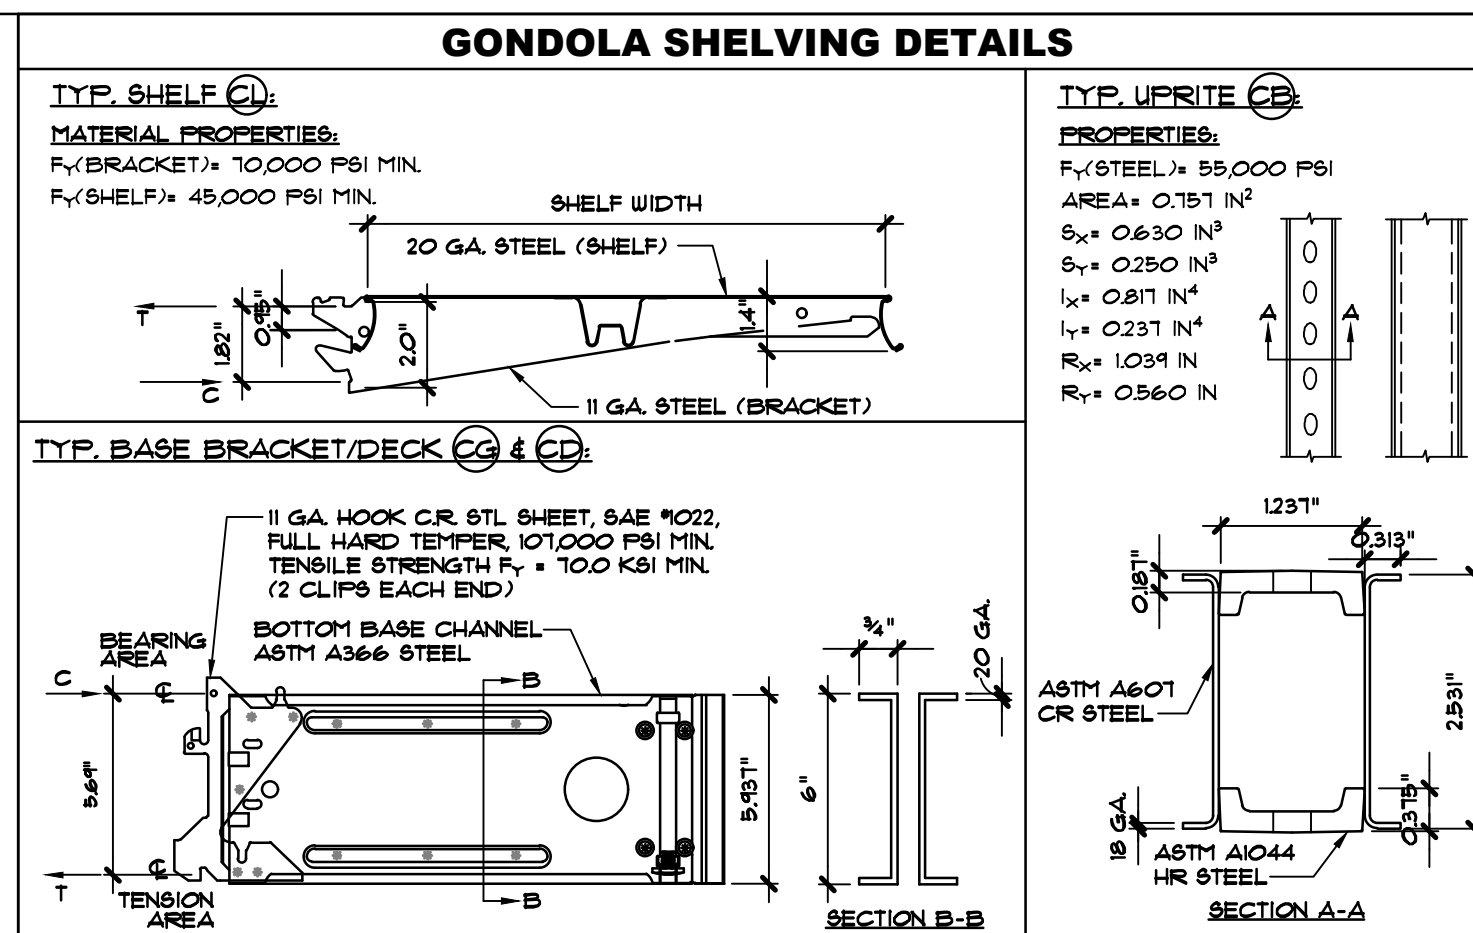











TYPICAL S-SERIES SHELVING DETAILS:

TYPICAL S-SERIES SHELVING DETAILS:

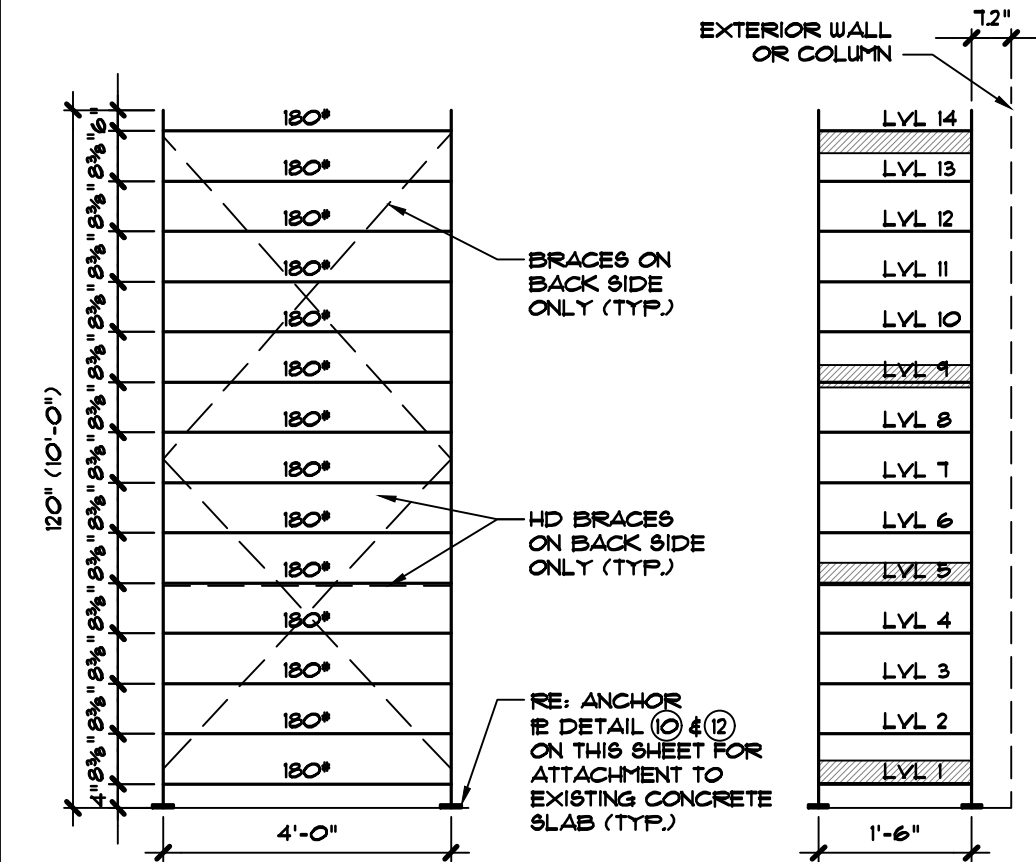

TYPICAL WIDESPAN DETAILS:

STORAGE SHELVING DETAILS

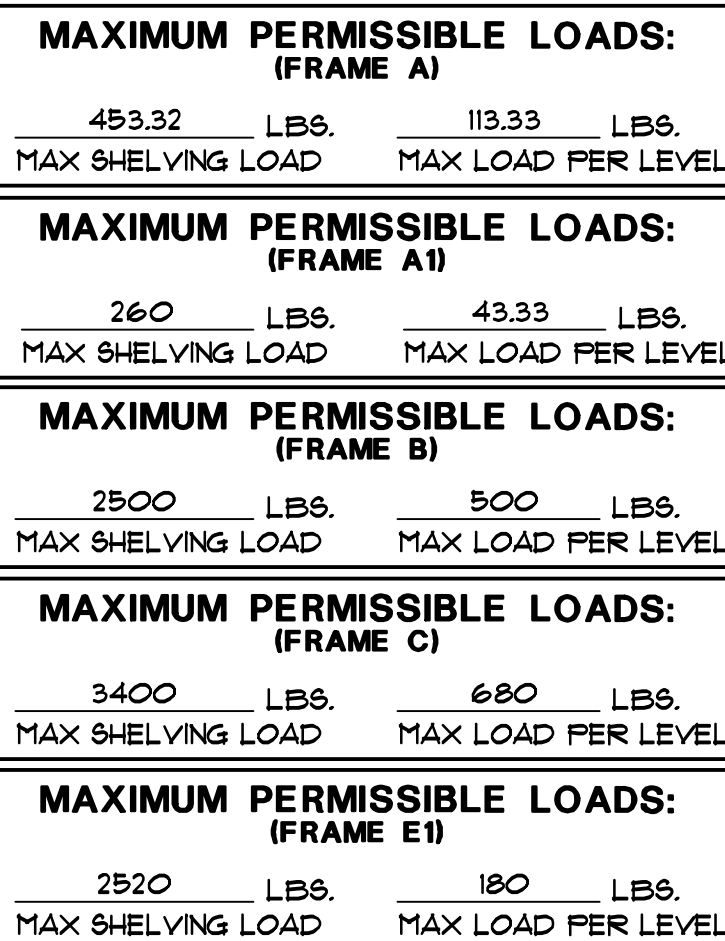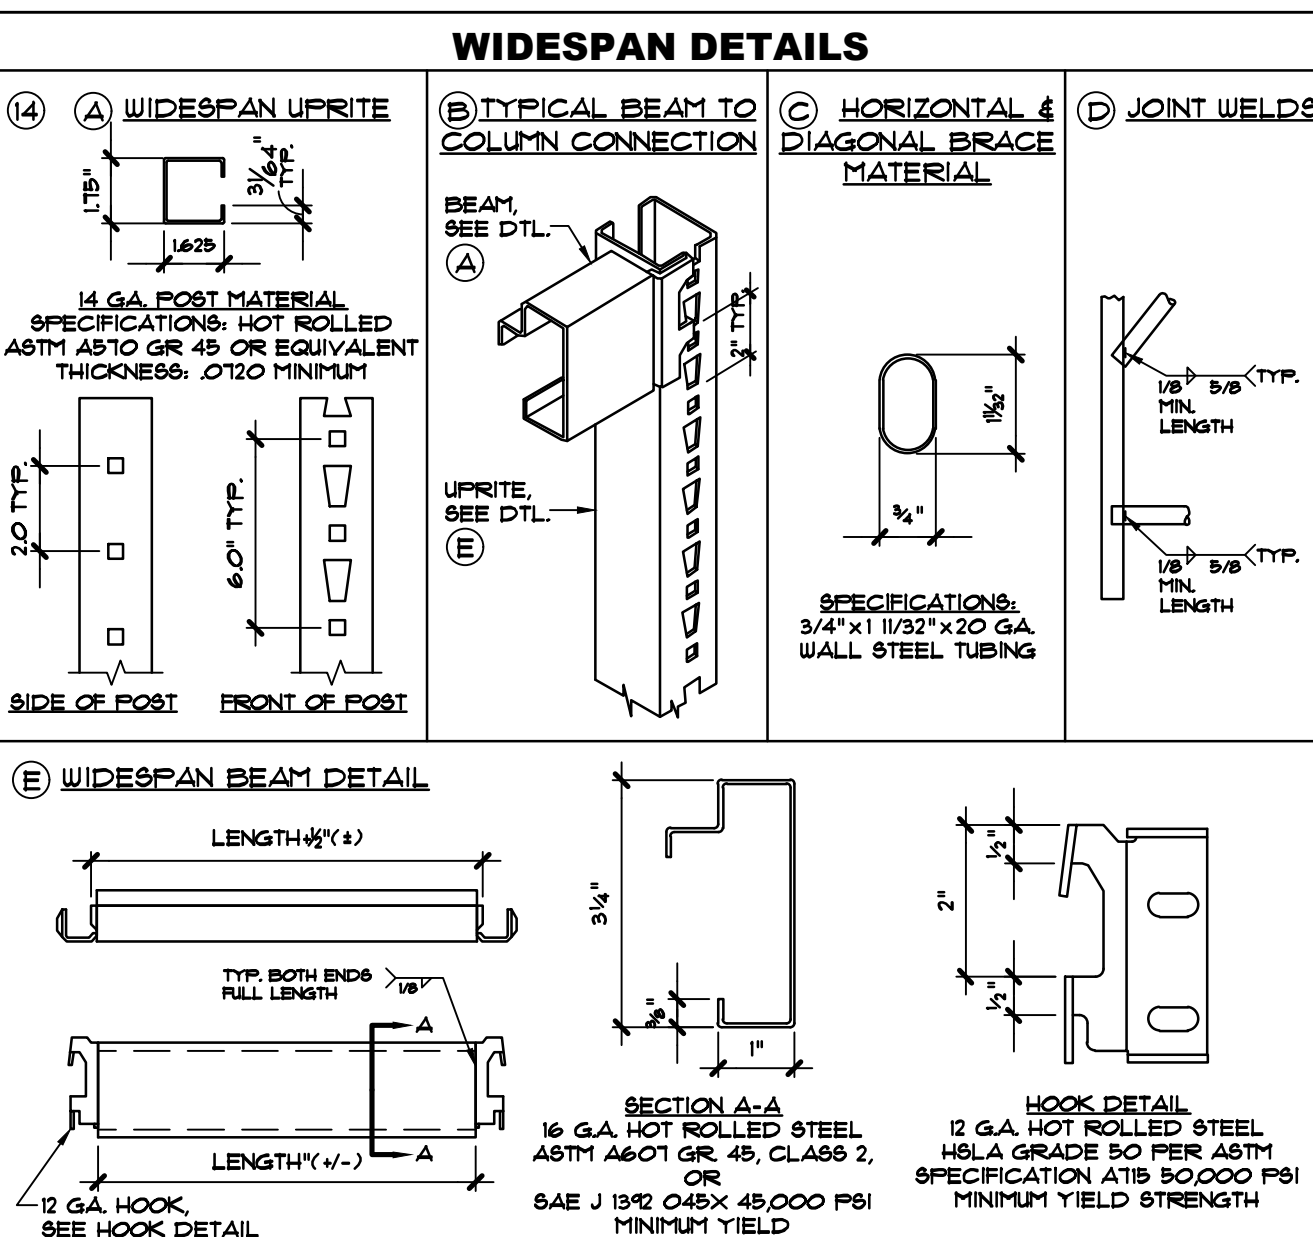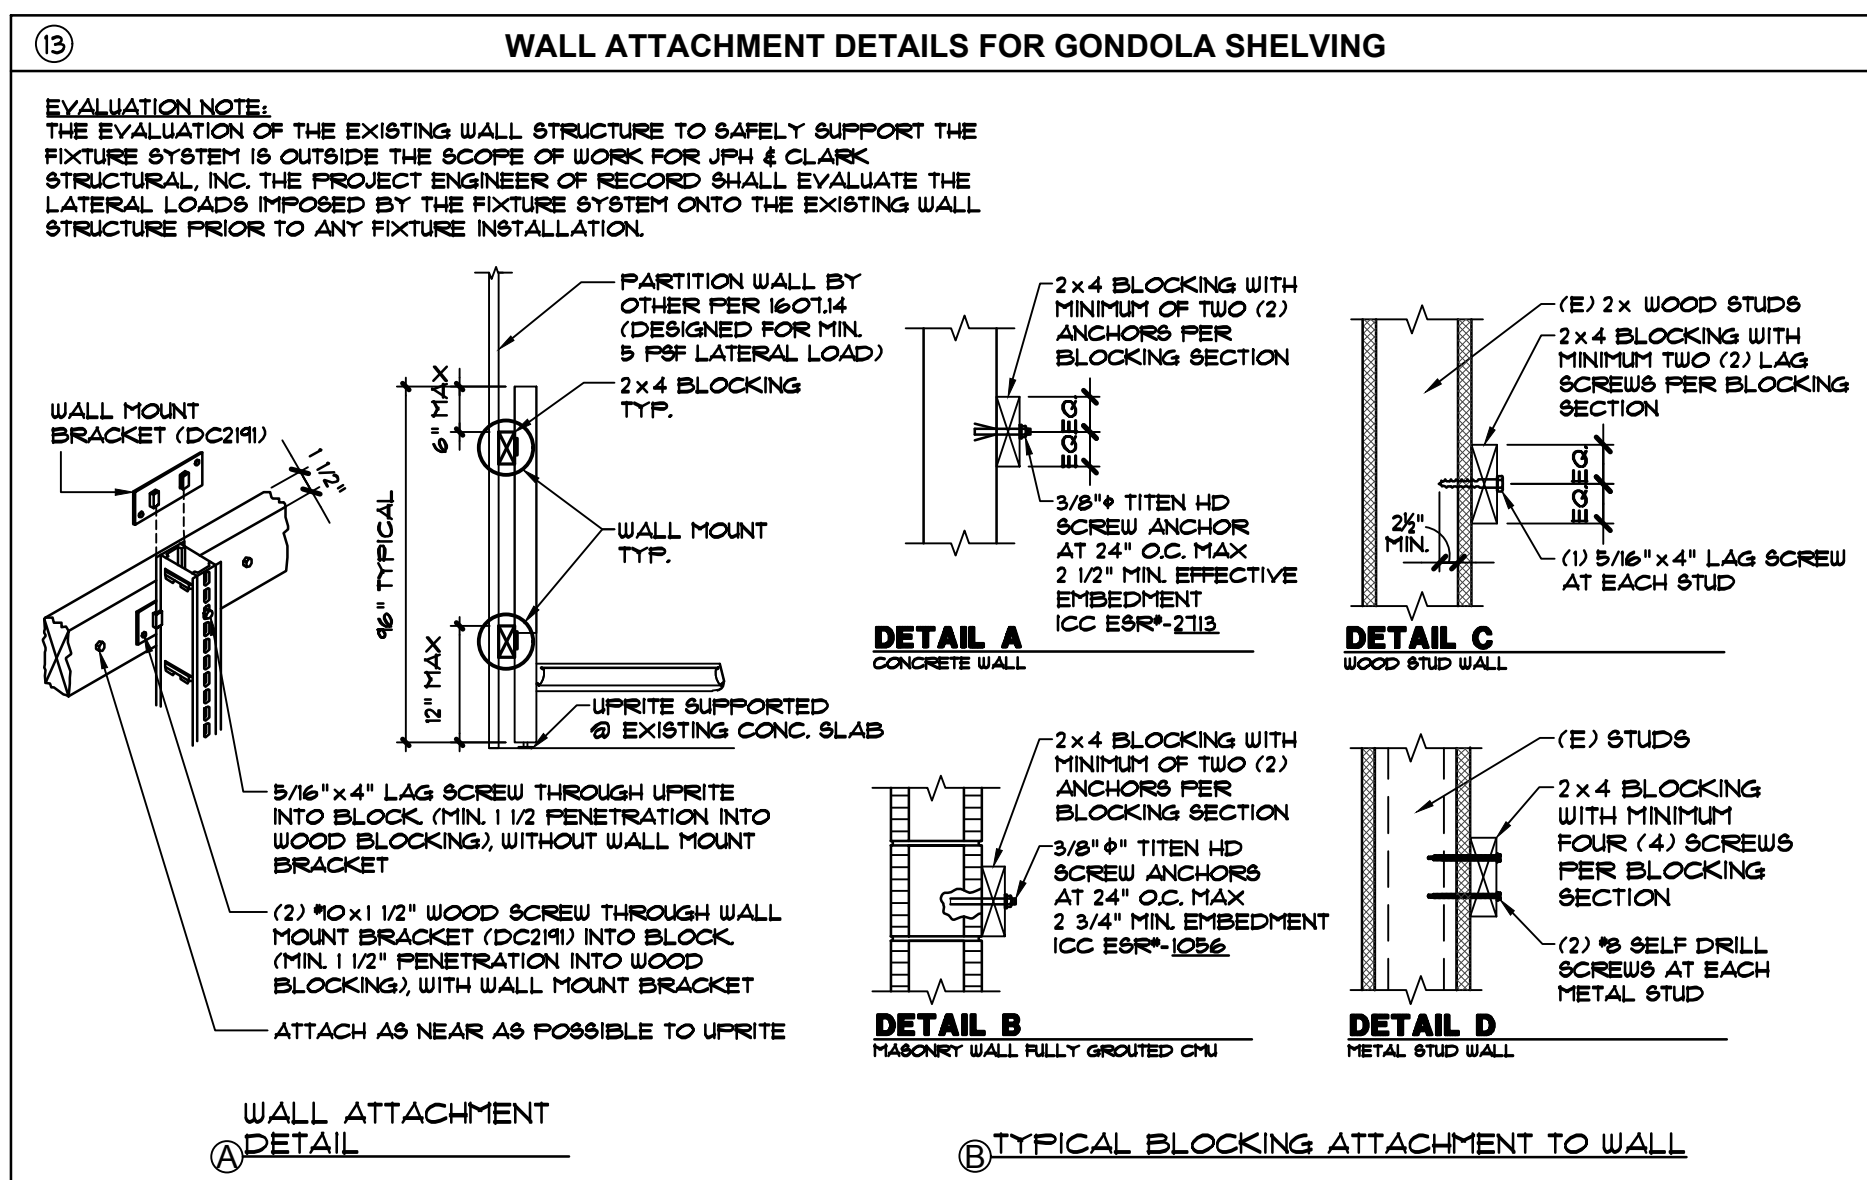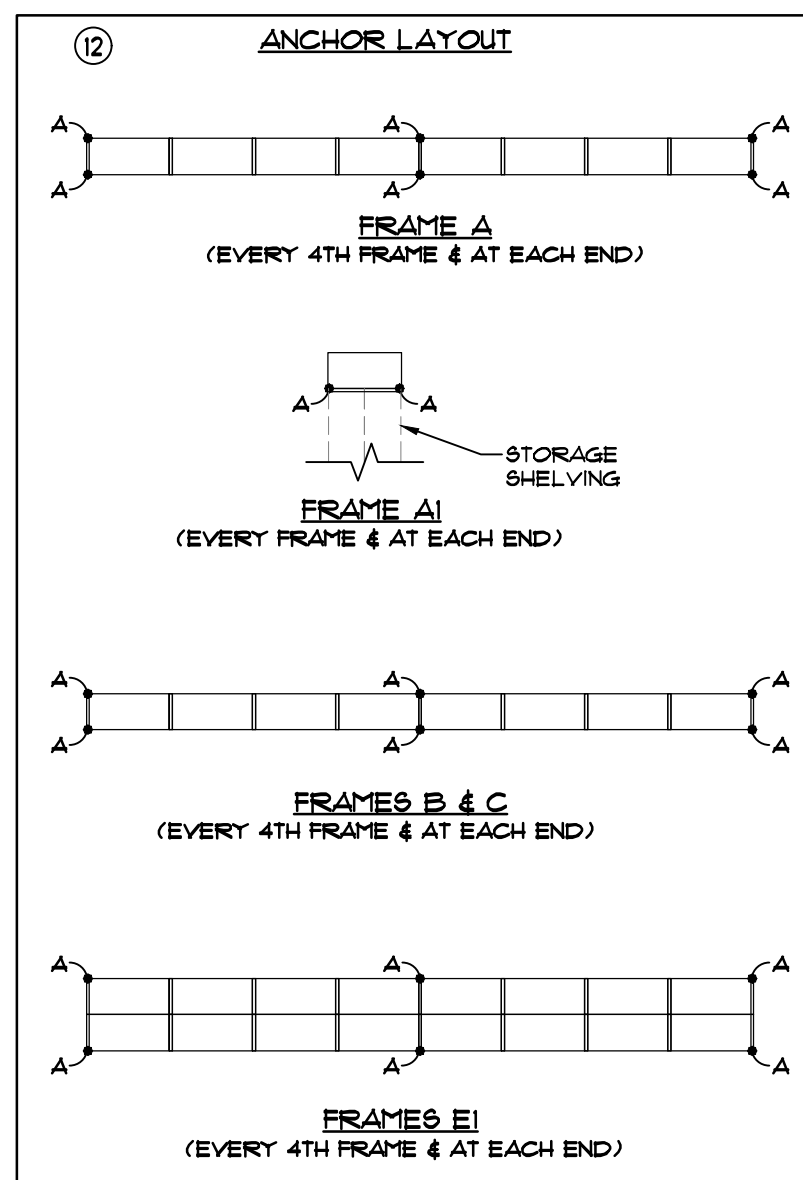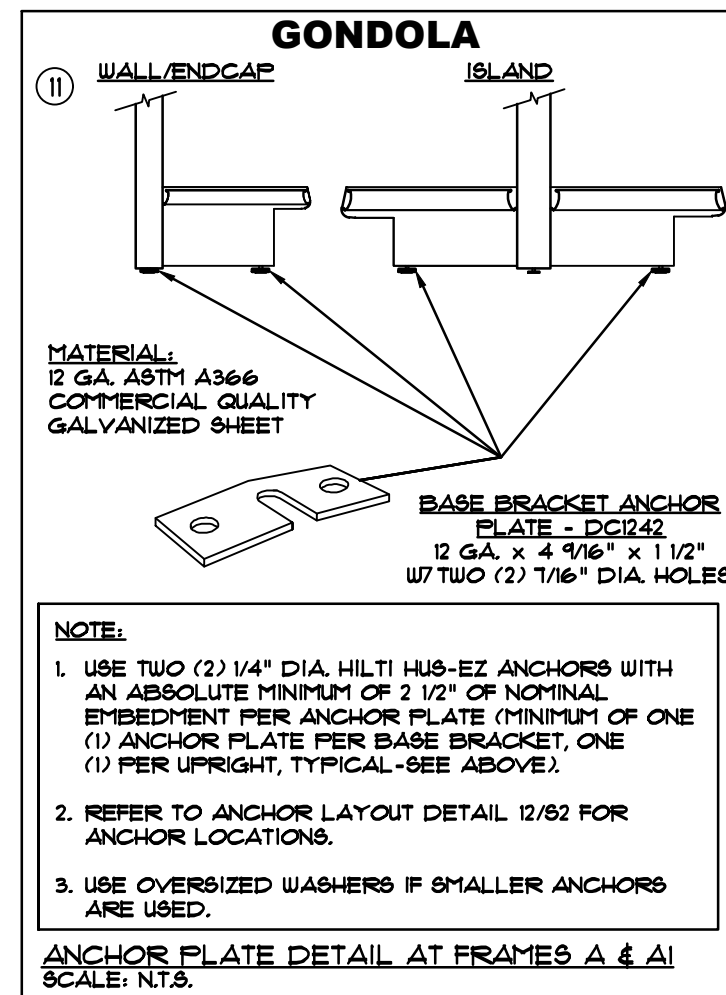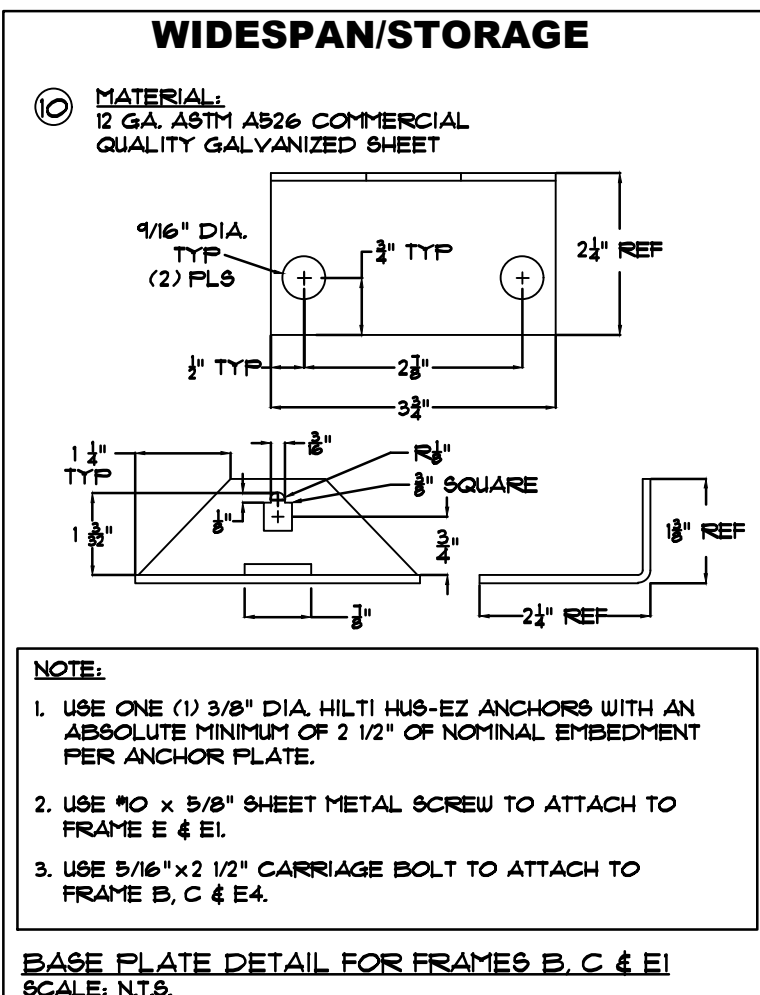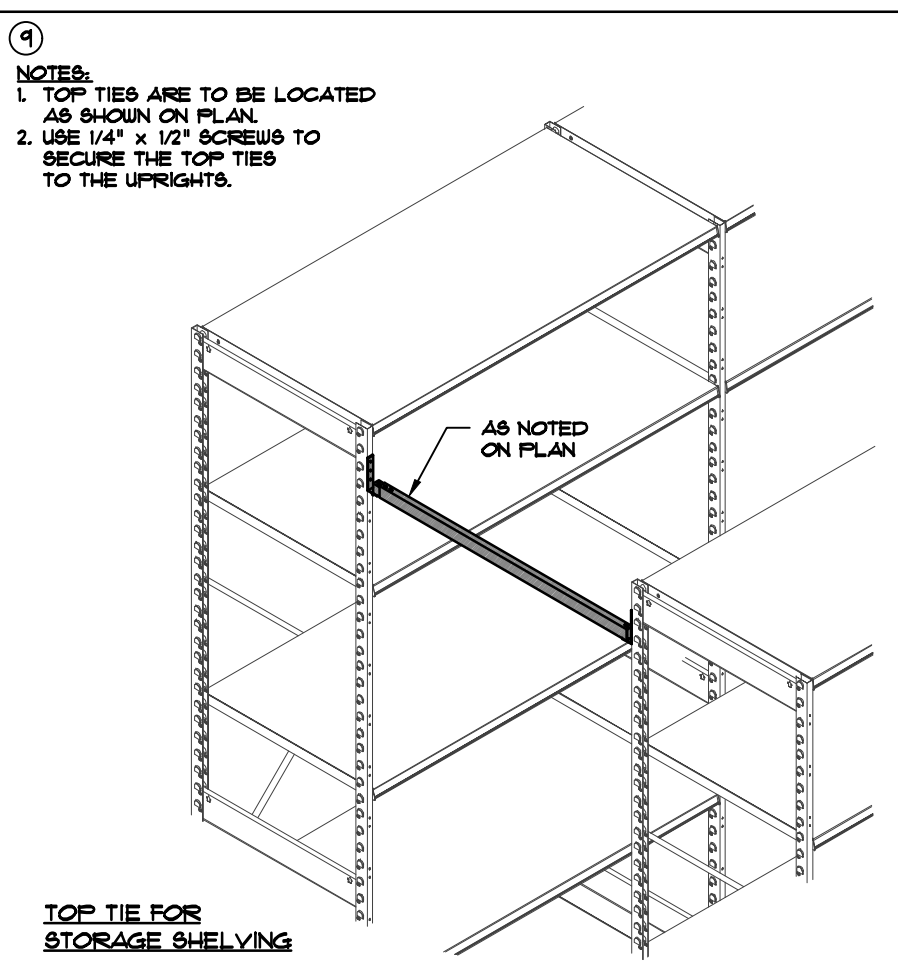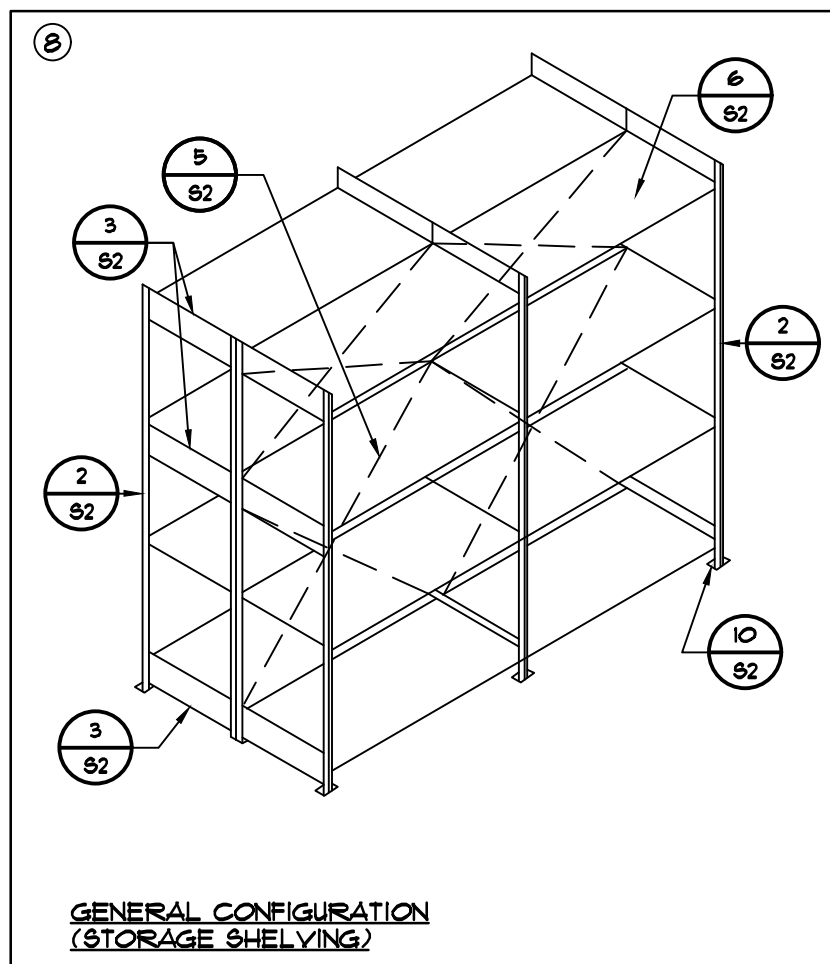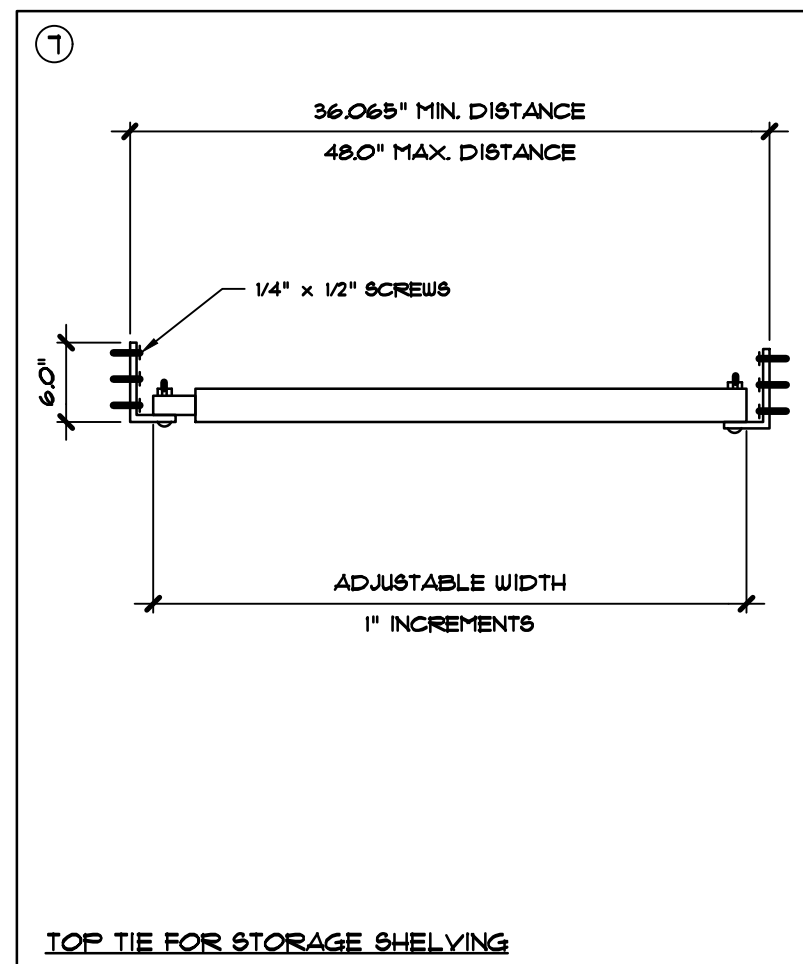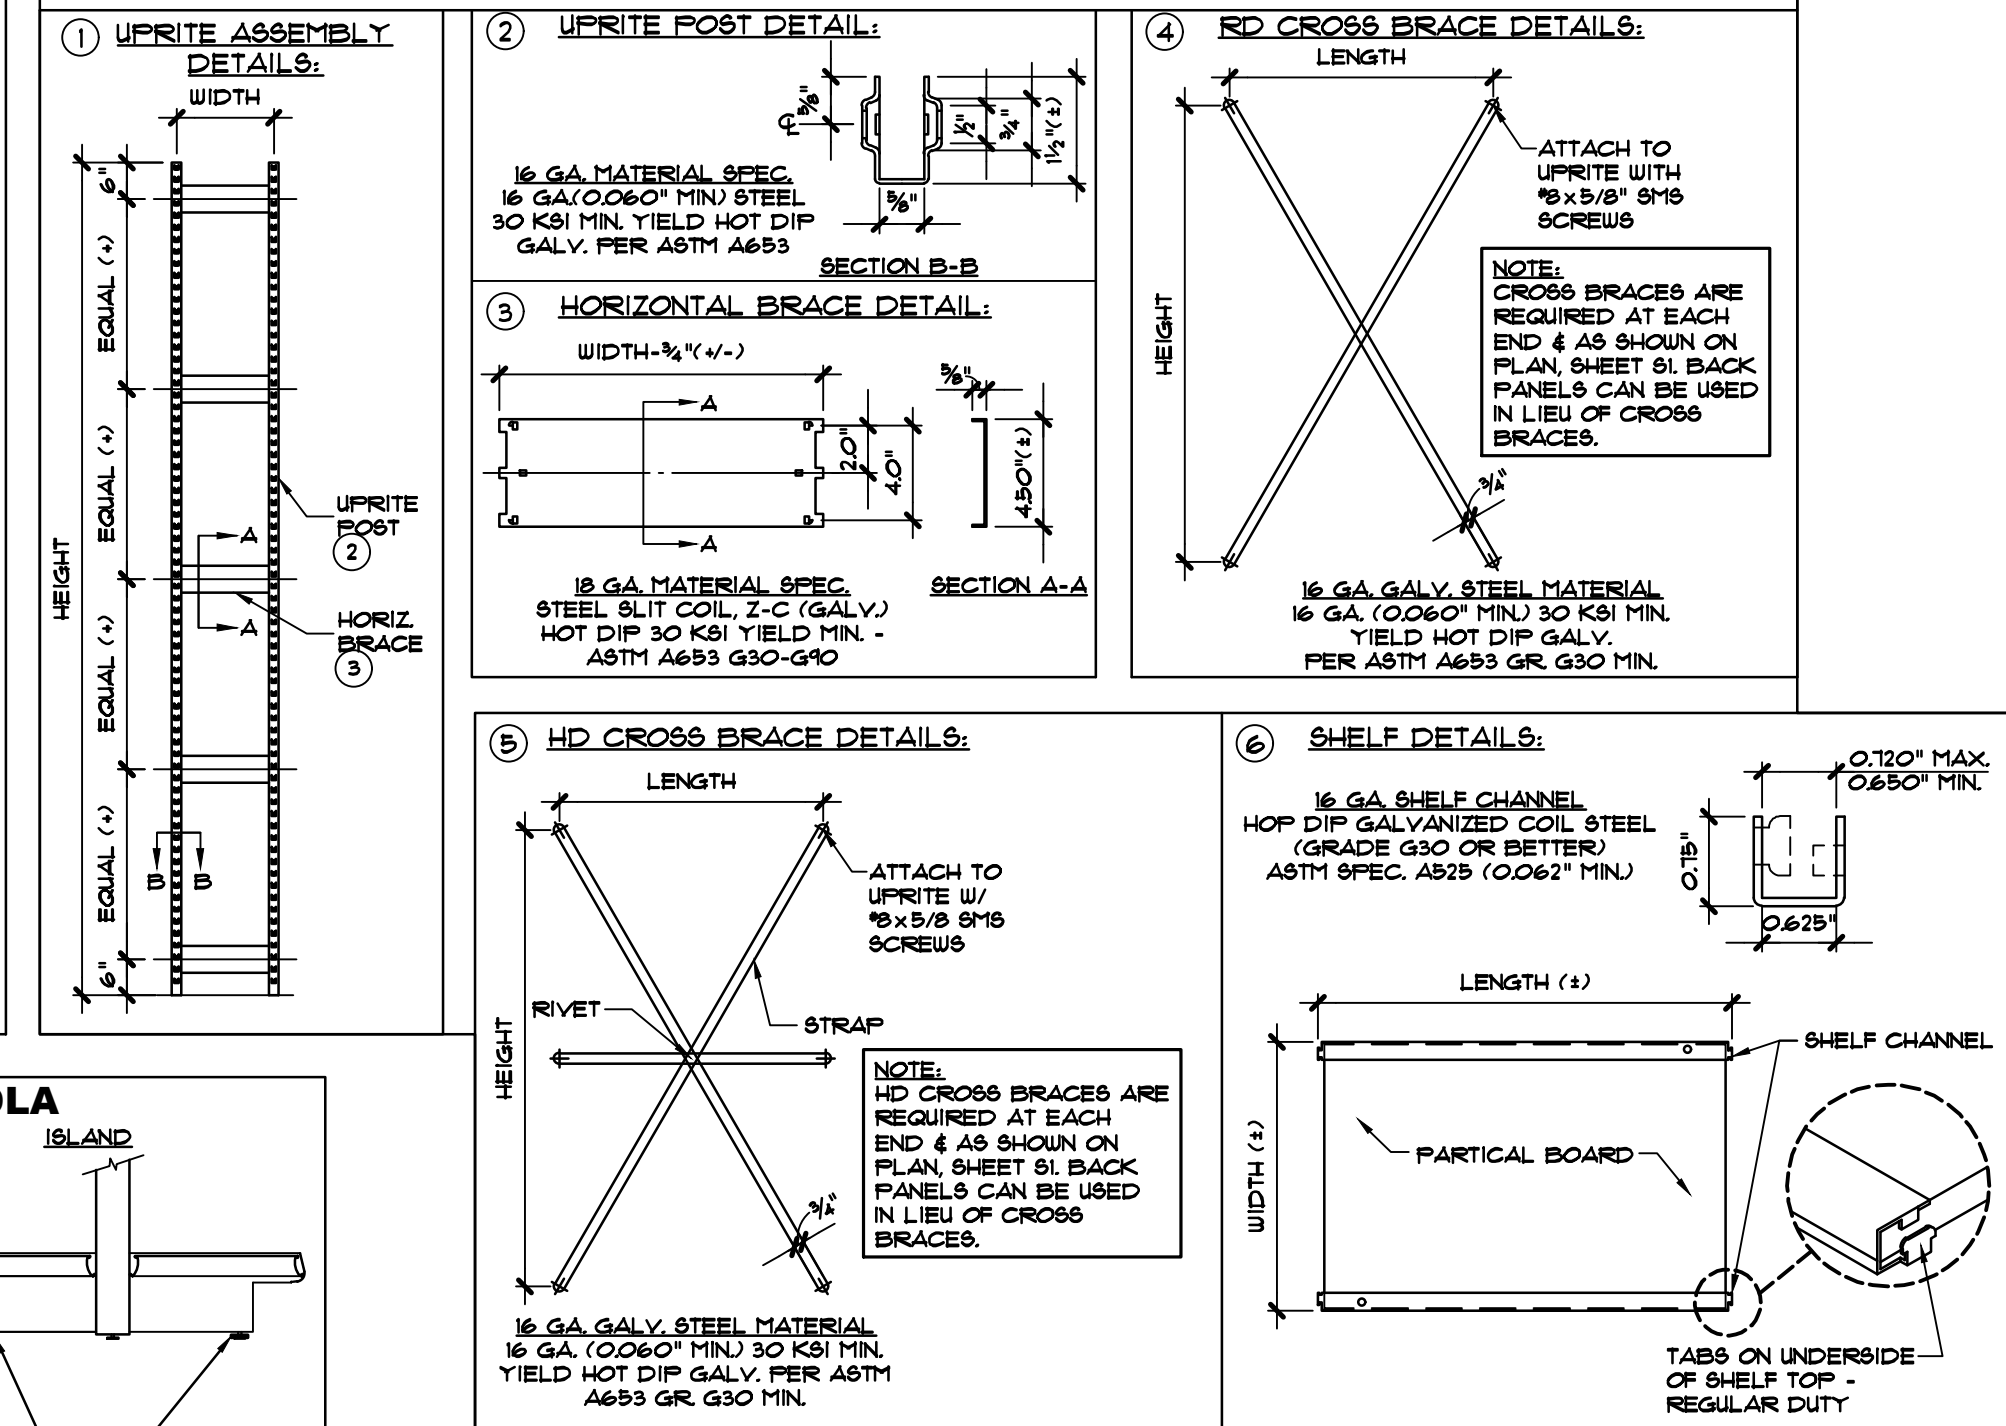

WARNING:
THE ABOVE CAPACITIES ARE BASED ON
NEW, UNDAMAGED COMPONENTS. DAMAGE
REDUCES RACK CAPACITIES. REPAIR OR
REPLACE DAMAGED COMPONENTS.

NOTE:
ALL RACK INSTALLATION SHOULD DISPLAY
IN ONE OR MORE CONSPICUOUS LOCATIONS
A PERMANENT PLAQUE AND EACH PLAQUE
SHALL HAVE AN AREA OF NOT LESS THAN
50 SQUARE INCHES. SECTION 1.4.2 OF RMI

REV	DATE	DESCRIPTION
	6-17-26	GROSS SQ. FT. 11,287 S.F.
PROJECT # 330 RAWN E.C. STAFF		
CHECK BY: STAFF		

ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.


FIXTURE DETAILS

[illegible]

DATE	GROSS SQ. FT.
6-18-26	11,261 S.
PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF
VERSION Q1-26 83x83	
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMERCIAL RIGHTS OF COPYRIGHT AND OTHERWISE ARE HEREBY SPECIFICALLY RESERVED.	

DEMOLITION
EXISTING CONDITION
PLAN


D1

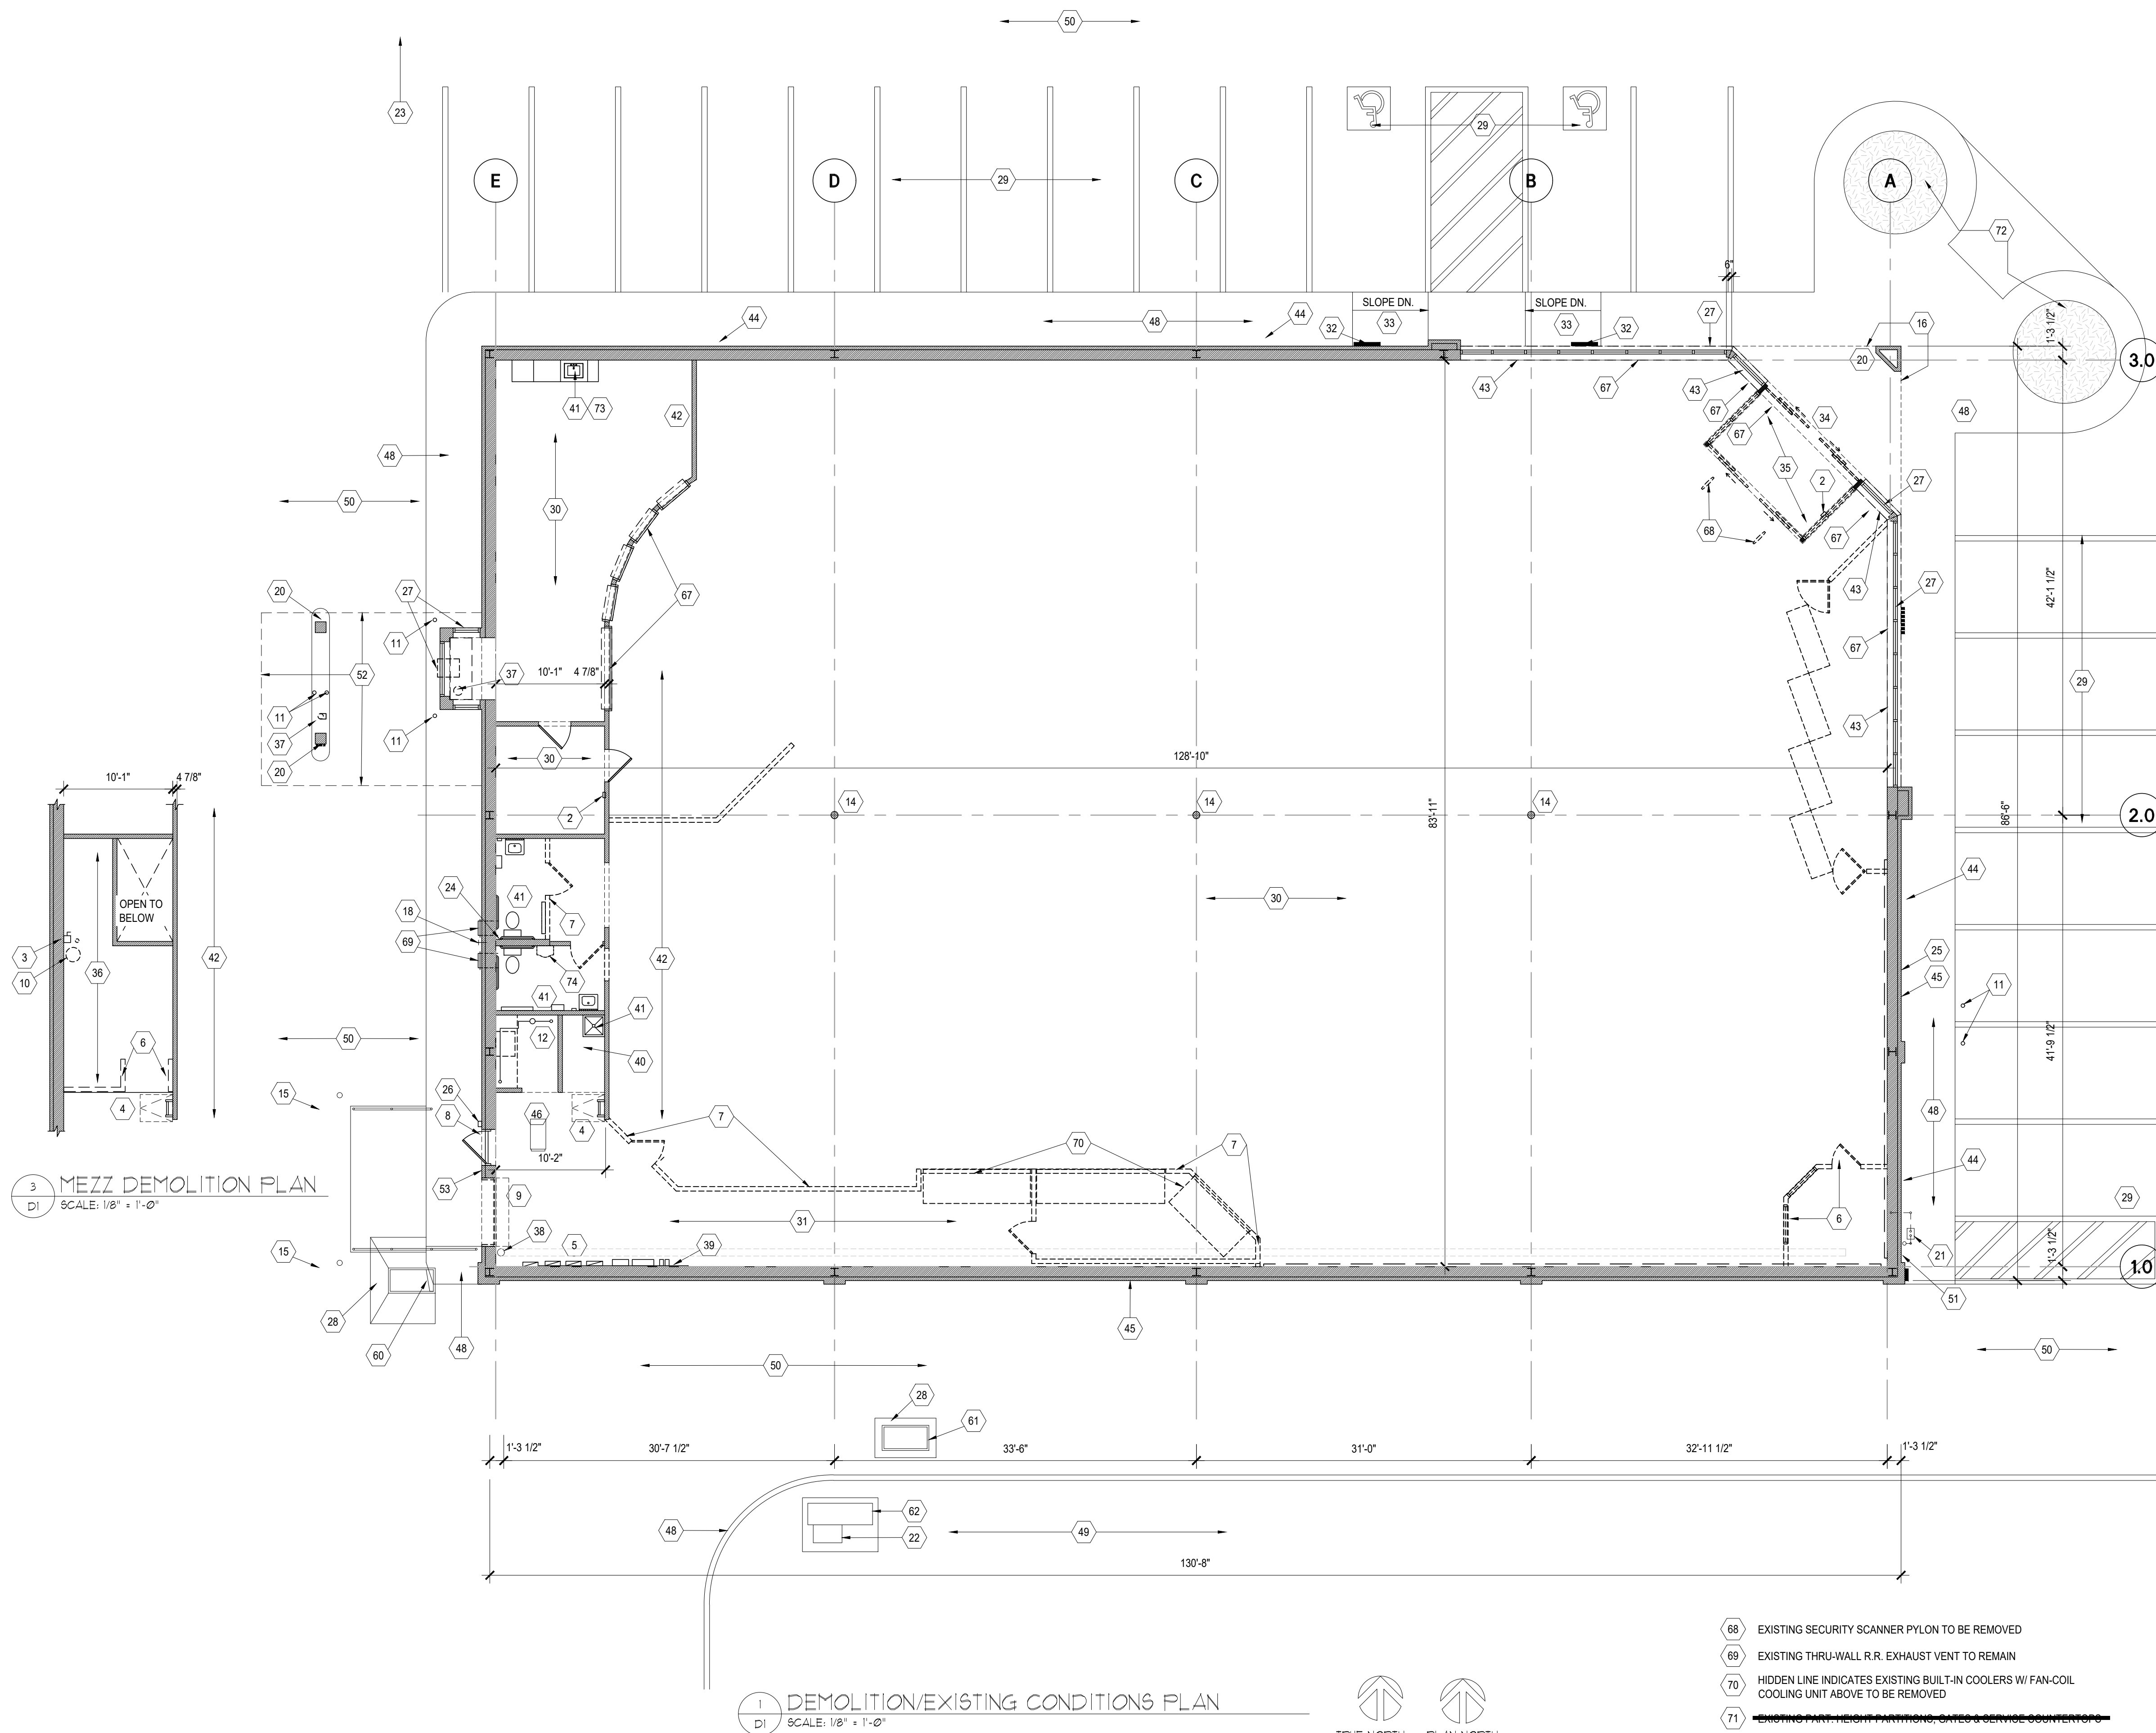


- | | |
|----|---|
| 68 | EXISTING SECURITY SCANNER PYLON TO BE REMOVED |
| 69 | EXISTING THRU-WALL R.R. EXHAUST VENT TO REMAIN |
| 70 | HIDDEN LINE INDICATES EXISTING BUILT-IN COOLERS W/ FAN-COIL COOLING UNIT ABOVE TO BE REMOVED |
| 71 | EXISTING PART HEIGHT PARTITIONS, SAVED & SERVICE COUNTER |
| 72 | EXISTING MULCH BED & PLANTINGS. GC TO REMOVE ALL PLANTINGS & REMULCH. THESE TWO LOCATIONS ONLY. |
| 73 | EXISTING WATER HEATER UNDER COUNTER TO BE REMOVED. SEE MECHANICAL PLANS. |
| 74 | EXISTING URINAL TO BE REMOVED. |

1	EXISTING FIRE ALARM PAD TO GO TO COORDINATE WITH FIRE ALARM VENDOR FOR REDUCING RATING
2	EXISTING SECURITY ALARM PAD TO BE REMOVED
3	EXISTING ELECTRICAL DISCONNECT SWITCH TO REMAIN
4	EXISTING ROOF LADDER AND HATCH ABOVE TO REMAIN
5	EXISTING ELECTRICAL PANELS AND EQUIPMENT TO REMAIN. SEE ELECTRICAL PLANS.
6	EXISTING PARTIAL HEIGHT PARTITION AND RESTROOM PARTITION TO BE REMOVED
7	EXISTING FULL HEIGHT PARTITION AND DIAGONAL FRAMING ABOVE TO BE REMOVED.
8	EXISTING EXTERIOR MAN DOOR TO REMAIN
9	EXISTING MOTORIZED EXTERIOR ROLLING DOOR TO BE REMOVED AND REPLACED. SEE A1.
10	EXISTING WATER HEATER AND DRIP PAN ON FLOOR TO BE REMOVED
11	EXISTING BOLLARDS TO REMAIN
12	EXISTING WATER SERVICE ENTRANCE LINES, METER, BACK-FLOW CONTROLS AND SHUT-OFF VALVES TO REMAIN. SEE PLUMBING PLANS.
13	EXISTING EXTERIOR BRICK WALL WITH DRAIN DUMP OUTS
14	EXISTING 6" DIAMETER PIPE STEEL COLUMN TO REMAIN
15	EXISTING CONCRETE FILLED STEEL PIPE BOLLARDS TO REMAIN
16	EXISTING EXTERIOR CANOPIES TO REMAIN
17	EXISTING EXTERIOR SECURITY LIGHT
18	EXISTING EXTERIOR HOSE BIB TO REMAIN
19	EXISTING WALL MOUNTED STORE SIGN
20	EXISTING EXTERIOR BRICK COLUMN ENCLOSURE TO REMAIN
21	EXISTING GAS METER AND GAS PIPING THRU WALL TO REMAIN
22	EXISTING ELEC. METER AND CABINET TO REMAIN
23	EXISTING FENCING AND GATES FOR DUMPSTER ENCLOSURE, TO REMAIN (NOT SHOWN)
24	EXISTING WALL CLEAN-OUT TO REMAIN
25	EXISTING EXTERIOR ELECTRICAL RECEPTACLE TO REMAIN
26	EXISTING KNOX BOX TO REMAIN
27	EXISTING GLAZING SYSTEM AND WINDOWS TO REMAIN
28	EXISTING SLOPED CONCRETE PAVING TO REMAIN
29	EXISTING PAINTED PARKING LOT STRIPING AND HANDICAP PARKING SIGNAGE TO REMAIN
30	EXISTING FLOORING IN THIS AREA TO BE REMOVED
31	EXISTING EXPOSED SLAB THIS AREA TO REMAIN
32	EXISTING ACCESSIBLE PARKING SIGN ON WALL TO REMAIN
33	EXISTING ACCESSIBLE CONCRETE CURB CUT TO REMAIN
34	EXISTING AUTOMATIC STOREFRONT SLIDING DOORS, ELEC. OPENING CONTROLS AND SIDELIGHTS TO BE REMOVED
35	EXISTING VESTIBULE PARTIAL HEIGHT WALLS W/ GLAZING SYSTEM TO BE REMOVED
36	EXISTING GWB, GFCI, SOFFIT AND CORNER SUPPORT POSTS TO REMAIN
37	EXISTING MEZZANINE
38	DRIVE-THRU WINDOW, ASSOCIATED FIXTURES AND ALL PNEUMATIC EQUIPMENT TO BE REMOVED. INSTALL AND SECURE METAL COVER OVER DRAWER OPENING TO INTERIOR & EXTERIOR AND INSULATE THE VOID.
39	EXISTING INTERNAL ROOF DRAIN PIPING TO REMAIN, G.C. TO CLEAN AND ENSURE PROPER WORKING ORDER, PRIOR TO TURNOVER.
40	EXISTING PHONE BOARD TO REMAIN.
41	EXISTING FLOOR DRAIN TO REMAIN. SEE PLUMBING PLANS.
42	EXISTING PLUMBING FIXTURES TO REMAIN
43	EXISTING INTERIOR PARTITION TO REMAIN
44	EXISTING INTERIOR SOFFIT TO REMAIN
45	EXISTING EXTERIOR WALL MOUNTED SIGN BOX TO REMAIN
46	EXISTING NO PARKING / TOW AWAY SIGN TO BE REMOVED


- | | |
|----|---|
| 46 | EXISTING SUSPENDED GAS UNIT HEATER AND VENT PIPING THRU-ROOF TO REMAIN |
| 47 | EXISTING DOOR BUZZER TO BE REMOVED |
| 48 | EXISTING SIDEWALK AND CURBS TO REMAIN |
| 49 | EXISTING PLANTING AREA W/ MULCH AND LAWN TO REMAIN |
| 50 | EXISTING ASPHALT PAVEMENT TO REMAIN |
| 51 | EXISTING TRAFFIC SIGN TO REMAIN |
| 52 | EXISTING DRIVE-THRU CANOPY TO REMAIN. SEE SHEET A6 |
| 53 | EXISTING DOOR BUZZER TO BE REMOVED |
| 54 | EXISTING THRU WALL DIEBOLD PASS THRU DRAWER |
| 55 | EXISTING METAL SOILING MAT PARAPET WALL |
| 56 | EXISTING AUTOMATIC DOOR MOTION-DETECTOR TO BE REMOVED |
| 57 | EXISTING BRICK SINGLE STAGED RAMP |
| 58 | EXISTING BRICK SOLDER SOURCE DANG |
| 59 | EXISTING WATER METER VALVE TO REMAIN |
| 60 | EXISTING STORM DRAIN, W/ METAL CATCH BASIN GRATE. GC TO COORD. WITH AAP PM TO REMOVE, REPAIR OR REPLACE METAL PLATE OVER PART OF GRATE. EXISTING CONC. SIDEWALK & CURB RESTING ON METAL PLATE AND EXISTING CONCRETE IS CRACKED/MISSING IN THIS AREA - SEE DETAIL 1 / A1.1 FOR ADDL INFO |
| 61 | EXISTING STORM DRAIN, W/ METAL CATCH BASIN GRATE TO REMAIN |
| 62 | EXISTING ELEC. TRANSFORMER ON CONC. PAD TO REMAIN |
| 63 | EXISTING DRAMPED DANG |
| 64 | EXISTING WALL MOUNTED SIGN LIGHT BOXES |
| 65 | EXISTING PARKING SIGN |
| 66 | NOTHING INDICATED EXISTING DAMAGE OR EFFLUENCE ON ORIGIN IN THIS AREA |



- A. HAND OR POWER FLOOR FLAT BEFORE STARTING TROWELING.
- B. FOR FIRST TROWELING, KEEL BLADE(S) AT FLAT AS POSSIBLE AND USE LOW SPEED, MINIMIZING "WASHBOARD" OR "CHATTER MARKS" AND "RITING".
- C. TROWEL 2" STRIPS MINIMUM WITH FIRST TWO TROWELING AT RIGHT ANGLES. CEASE TROWELING BEFORE TROWEL BLADES SCRATCH SURFACE.
- D. ALLOW TIME BETWEEN TROWELING FOR CONCRETE TO STIFFEN AND WATER SHEEN TO DISAPPEAR.
- E. DO NOT ADD WATER TO SLAB SURFACE DURING TROWELING.
- F. DO NOT TROWEL ON EXISTING HARDENED CONCRETE SLABS. TROWELS SHALL BE CARRIED OFF OF SLAB SURFACES. WHEN PUNISHING TROWELS ON FRESH CONCRETE, PLACE ON TOP OF PLYWOOD.
- G. ENSURE KNEEBOARD IMPRESSIONS, TROWEL MARKS, FOOT PRINTS AND/OR CHATTERED AREAS ARE NOT EVIDENT AFTER FLOOR FINISH.
- H. PROVIDE DENSE, SMOOTH, FLAT ROWEL SURFACE, UNIFORM M TEXTURE.
- I. FINISH SURFACE TO PRODUCE MAXIMUM SHEEN PER SPECIFICATIONS FREE OF SCRATCHES AND TROWEL MARKS.

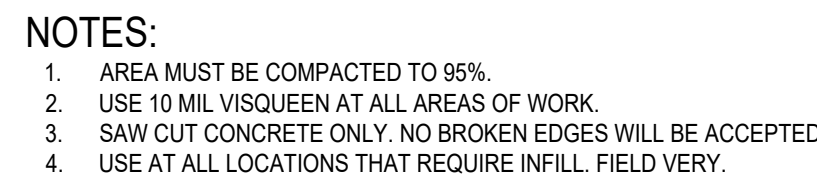

2 TRENCHING
A1 SCALE: 1 1/2" = 1'-0"

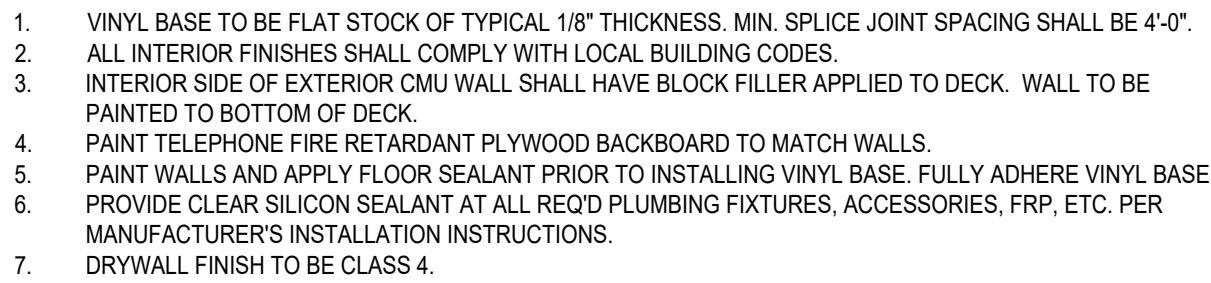

1.4 METAL BAR JOIST, DUCTWORK AND CEILING DECKING:

NEW CONSTRUCTION SPECIFICATION:

PRIME: FACTORY PRIMED GRAY. CLEAN AND SPOT PRIME ANY FLASH RUST OR BARE AREAS WERE FACTORY PRIMER WAS DAMAGED. PRIME USING PPG 4160 RUST INHIBITIVE PRIMER TO MATCH GRAY.

REMODEL / UP-FIT SPECIFICATION:

PRIME: SPOT PRIME TO COVER ANY BARE AREAS OF DECKING OR DUCTWORK. PRIME USING PPG 90-1912

PITT TECH TRB WB PRIMER SEALER. FOR WIDE-SPREAD RUST OR SURFACE ISSUES - PLEASE CONTACT YOUR LOCAL PPG SALES PERSON FOR RECOMMENDATIONS PRIOR TO PAINTING.

FINISH: PPG SPEEDHIDE 6-725XI INTERIOR DRY-FOG



COLOR TO BE: IP2 AAP-INT2 PPG SILVER BAND (PPG0695-3)

ROOM FINISH SCHEDULE											
ROOM NO.	ROOM NAME	FLR / BASE		EXIST. VCT - SEE REMARKS	WALLS			CEILING			REMARKS
		PC-1	VB-1		IP-1	IP-2	FRP-1	PAINT IP-2	GYP BD IP-1	ACT-1	
101	SALES	●	●		●	●		●		11'-11"	EXISTING CEILING GRID, REPLACE ALL PADS.
102	LAVATORY 1		●	●				●		8'-0"	DOORS, FRAMES AND TRIM TO BE IP-2. NOTE - THE WALLS ON THE EXTERIOR OF THE RESTROOMS ARE TO BE IP-1 FRP IS NOT TO BE PAINTED.
103	LAVATORY 2		●	●				●		8'-0"	PATCH FLOOR W/ NEW VCT. TO MATCH EXISTING - EXISTING VCT. TO BE STRIPPED AND WAXED PRIOR TO TURNOVER.
104	STAGING	●	●		●			●		11'-11"	DOORS, FRAMES AND TRIM TO BE IP-2. EXISTING CEILING GRID, REPLACE ALL PADS.
105	OFFICE	●	●		●			●		9'-10"	DOORS, FRAMES AND TRIM TO BE IP-2. EXISTING CEILING GRID, REPLACE ALL PADS.
106	BREAK ROOM	●	●		●			●		9'-10"	DOORS, FRAMES AND TRIM TO BE IP-2. EXISTING CEILING GRID, REPLACE ALL PADS.
MATERIAL SCHEDULE											
MATERIAL:										LOCATION:	
FLOORING											
PC-1	ASHFORD (OR) W.R. MEADOWS POLISHED CONCRETE. COORDINATE WITH AAP PROJECT MANAGER.							ENTIRE SALES FLOOR AREA - REFER TO RESPONSIBILITY MATRIX ON SHEET 11 FOR ADDITIONAL INFORMATION.			
VCT-1	EXISTING TO REMAIN - SEE NOTES IN SCHEDULE										
BASE											
VB-1	4" BLACK VINYL BASE - ARMSTRONG, JOHNSONITE OR ROPPE.							INSTALL ON WALLS THAT DO NOT RECEIVE FIXTURES. CLASS C FLAME SPREAD: 0.45 SMOKE DEVELOPED: 450 OR LESS			
CEILING											
GB-1	USG 1/2" GYPSUM BOARD							FRAMED TOILET ROOM WALLS. CMU WALLS DO NOT RECEIVE GWB.			
ACT-1	ARMSTRONG 755 WHITE FISSURED SQUARE EDGE 24"x48"							RESTROOMS CLASS A: ASTM E84 AND CANULC S102 SURFACE BURNING CHARACTERISTICS. FLAME SPREAD INDEX OF 25 OR LESS. SMOKE DEVELOPED INDEX OF 50 OR LESS (UL LABELLED)			
INTERIOR PAINT											
IP-1	AAP-INT1 DELICATE WHITE (PPG1001-1)							DRYWALL, BLOCK WALLS, SMOKE DEVELOPED: 35 - 60			
IP-2	AAP-INT2 PPG SILVER BAND (PPG0995-3)							COLUMNS, DOORS, JAMBS AND INTERIOR RESTROOM WALLS SMOKE DEVELOPED: 35 - 60			
FIBERGLASS REINFORCED PANELS											
FRP-1	MARLITE WHITE FIBERGLASS REINFORCED PANELS							WALLS ADJACENT TO THE MOP SINK AND EWC WALL CLASS C. FLAME SPREAD: 110 SMOKE DEVELOPED: 300			

- 1 4'x10' X 3/4" APA RATED PLYWOOD BACKBOARD. REFER TO SHEET E4 FOR ADDITIONAL INFORMATION.
- 2 EXISTING BRICK WALL. POWER-WASH ENTIRE BUILDING. COORDINATE W/ AAP. C.M. FOR BRICK REPAIR, RE-CAULK AROUND ENTIRE PERIMETER OF THE BUILDING.
- 3 EXISTING ELECTRICAL EQUIPMENT. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 4 AREA OF SEALED FLOOR. ASHFORD FORMULA BY CURECRETE CHEMICAL COMPANY, INC. RE. CONCRETE FLOOR FINISH NOTS ON SHEET A1 FOR ADDITIONAL INFORMATION.
- 5 NEW STOREFRONT ENTRY DOORS AND GLAZING SYSTEM - SEE SHEET A6 FOR ADDITIONAL INFORMATION.
- 6 BI-LEVEL DRINKING FOUNTAIN. REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
- 7 WATER HEATER AND PAN/ MOUNTED ON MEZZANINE ABOVE WITH PAN ON MEZZANINE FLOOR. SEE PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
- 8 NEW WALL HYDRANT. REFER TO PLUMBING DRAWINGS.
- 9 EXISTING ALUMINUM STOREFRONT AND GLAZING. REFER TO SHEET A6 FOR ADDITIONAL INFORMATION.
- 10 EXISTING 6" DIAMETER PIPE STEEL COLUMN PLANT I-P-2.
- 11 HIDDEN LINE INDICATES FACE OF BRICK CLAD FACADE ABOVE THE COVERED WALKWAY BELOW. REPAIR ANY DAMAGE TO E.I.F.S. TO MATCH EXISTING E.I.F.S. FINISH. REFER TO ELEVATIONS FOR ADDITIONAL INFORMATION.
- 12 EXISTING CONCRETE WALK
- 13 INSTALL ACCESSIBLE ALUMINUM THRESHOLD ON EXTERIOR AND INTERIOR DOORS.
- 14 EXISTING GYP. BD. ON METAL FRAMING ON EXTERIOR CMU / FACE BRICK WALL TO REMAIN. GC TO PATCH AND REPAIR AS REQUIRED. GC TO PROVIDE ALL REQUIRED WALL / CORNER TREATMENTS AT OPENINGS IN HEAVY TRAFFIC FLOW AREAS.
- 15 NEW STEEL CONCRETE-FILLED SAFETY BOLLARD. PAINTED. SEE FINISH SCHEDULE ON A6. SEE DET. 4/1-1.
- 16 CONCRETE SLAB GLOSS TRANSITION LINE. REFER TO FLOOR FINISH NOTS ON SHEET A1 FOR ADDITIONAL INFORMATION, AND MERCH. PLAN ON A3 FOR FINAL DIMENSIONED LOCATION.
- 17 NEW EAS SYSTEM - SEE ELECTRICAL PLANS. COORDINATE FINAL PLACEMENT WITH SUPPLIER.
- 18 DRAWINGS STORAGE TUBE MOUNTED TO PLYWOOD BACKERBOARD.
- 19 EXISTING WALL HYDRANT, G.C. TO ENSURE PROPER WORKING ORDER.
- 20 EXISTING PLYWOOD BACKBOARD. REFER TO SHEET E4 FOR ADDITIONAL INFORMATION.
- 21 EXISTING PLANTING AREA CIRCLES TO REMAIN. REMOVE ALL LANDSCAPE IN CIRCLES AND REFILL W/ MULCH. CLEAN ALL LANDSCAPE ELSEWHERE ON THE ENTIRE SITE.
- 22 EXISTING SIDEWALK W/ CURB. NEW ASPHALT RAMP. FLUSH W/ TOP OF CURB AND METAL GUARDRAILS. SEE DETAILS ON A1.1
- 23 EXISTING LAVATORY & SINK BASIN CABINET, G.C. TO ENSURE PROPER WORKING ORDER.
- 24 EXISTING SAFETY BOLLARD TO REMAIN. RE-PAINT. SEE FINISH SCHEDULE ON A6.

1. CONCRETE FLOOR TO BE MACHINE TROWELED FINISH THROUGHOUT.
2. CONTRACTOR IS RESPONSIBLE FOR INSTALLING TOILETS SO AS TO COMPLY WITH ALL APPLICABLE CODES AND ACCESSIBILITY STANDARDS.
3. ORDERING AND COSTING ALL MATERIALS AND SUPPLIES. ORDER, GO TO INSTALL BACKFLOW PREVENTER IN MAIN SERVICE WATER LINE AS REQUIRED BY LOCAL CODE.
4. CONTRACTOR IS RESPONSIBLE FOR PROVIDING FIRE EXTINGUISHERS MODEL #2A10BC ABC RATING, QUANTITY AND LOCATION AS REQUIRED BY FIRE MARSHAL. (MINIMUM OF 4)
5. OMITTED
6. PREPARE FLOOR SLAB AS REQUIRED FOR APPLICATION OF FLOOR SEALER.
7. VCT - AFTER INSTALL FLOOR SLAB BE STRIPPED AND WAXED.






- A. PROTECT FINISHED POLISHED CONCRETE FLOORING FROM FOOT TRAFFIC FOR A MINIMUM 12 HOURS AFTER APPLICATION OF CONCRETE DENSIFIER-CHEMICAL HARDENER.
- B. PROTECT INSTALLED POLISHED CONCRETE FLOORING FROM CHEMICAL REACTION PROCESS IS COMPLETE BY COMPLYING WITH THE PRECAUTIONS LISTED UNDER PROJECT CONDITIONS.
- C. CLEAN FLOOR REGULARLY IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS BECAUSE WATER WILL ACCELERATE THE SEALING AND SCRUBBING WILL IMPART A SHINE.
- D. CLEAN UP SPILLS IMMEDIATELY AND SPOT-TREAT STAINS WITH GOOD DEGREASER OR OIL EMULSIFIER.
- E. PRECAUTIONS AND CLEANING ARE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR UNTIL SUBSTANTIAL COMPLETION.





HARDWARE SCHEDULE		
GROUP #1 - EXTERIOR EGRESS DOOR		
QTY.	DESCRIPTION	NUMBER - FINISH
1	THRESHOLD	PEMKO 171A
1	SWEEP	PEMKO 315CN
1	GASKETING	PEMKO 303AS
1	DOOR VIEWER	ROCKWOOD 622
GROUP #2 - TOILET ROOMS		
QTY.	DESCRIPTION	NUMBER - FINISH
3	HINGES	ASSA ABLOY TA2714 - US26D
1	PRIVACY SET	YALE PB 4602LN - 626
GROUP #3 - ALUMINUM STOREFRONT DOORS		
QTY.	DESCRIPTION	NUMBER - FINISH
2	CONTINUOUS GEARED HINGE	PEMKO CFM SLF-HD1
1	MORTISE DEADLOCK	ADAMS RITE M1850SN - 628
1	MORTISE CYLINDER	YALE K620 1 1/4" MK - 626
1	CYLINDER CORE	YALE K600 CMK - 626
1	CYLINDER T-TURN	ADAMS RITE 4066 - 130
2	DOOR PULL	ROCKWOOD BF157 MTG-TYPE 1HD - US32D
	PUSH BAR	ROCKWOOD T47 MTG-TYPE 3 - US32D
2	SURFACE CLOSER	NORTON UNJ8501 - 689
2	FLOOR STOP	ROCKWOOD 480H EXP - US26D
1	THRESHOLD	PEMKO 271A
2	DOOR SWEEP	PEMKO 315CN
1	GASKETING	BY DOOR MANUFACTURER
1	DECAL	ROCKWOOD 660
2	DUST PROOF STRIKE	TRIMCO
2	FLUSHBOLT (NO MANUAL)	TRIMCO
GROUP #4 - RECEIVING DOOR		
DESCRIPTION		
G.C. TO PROVIDE NEW ROLLING DOOR BY "OVERHEAD" TO MATCH EXISTING. FIELD VERIFY TYPE AND SIZE. FINISH TO MATCH EXISTING.		
GROUP #5 - TRASH ENCLOSURE DOOR		
QTY.	DESCRIPTION	NUMBER - FINISH
NOTES		
1. ALL DOOR HARDWARE SHALL BE SATIN NICKEL FINISH OR BRUSHED ALUM. FINISH		
2. CONTROLS AND OPERATING MECHANISMS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5LBF. NO THUMB TURN PERMITTED.		
3. AUDIBLE DETEX (V40) AT ALL SECONDARY EGRESS DOORS		
4. ALL HARDWARE LISTED AS BASIS OF DESIGN. SUBSTITUTES WILL BE CONSIDERED ONLY WITH PRIOR AUTHORIZATION AS AN EQUAL TO SPECIFIED HARDWARE.		
5. FLOOR STOPS IN VESTIBULE SHALL BE LOCATED TO PREVENT DOORS FROM HITTING ADJACENT GLAZING.		
6. THUMB TURN IS PERMITTED IF AT ENTRY DOORS THE FOLLOWING SIGNAGE IS PROVIDED MIN 1" LETTERS STATING "THIS DOOR SHALL REMAIN UNLOCKED DURING BUSINESS HOURS"		
7. AAP WILL REPLACE THE CYLINDER CORES AT TIME OF BUILDING TURNOVER.		
8. DOOR TO BE A MAX 5 LBF MAX OPENING FORCE AND CLOSING SPEED FROM 90 DEG TO 12 DEG NOT FASTER THEN 5 SECONDS.		
9. G.C. TO ENSURE THAT THE THRESHOLD DOES NOT EXCEED 1/2" FROM EITHER SIDE.		

DOOR SCHEDULE									
DOOR #	DOOR LOCATION	DOOR SIZE	MATERIAL		DOOR ELEV.	FRAME		HARD-WARE	NOTES
			DOOR	FRAME		HEAD	JAMB		
101	STOREFRONT	NEW - (2) 3'-0" X 7'-0" X 1 3/4"	AL.	AL.	A	-	-	3	FRAME BY DOOR MFR. / VAP STANDARD CLEAR / PROVIDE FULLY ACCESSIBLE HARDWARE
101B	REAR EXIT	EX.	EX.	EX.	C	-	-	1	REMOVE ALL SIGNS FROM DOOR BEFORE PAINTING, PAINT TO MATCH BRICK
102	LAVATORY	NEW - 3'-0" X 7'-0" X 1 3/4"	H.M.	K.D. H.M.	B	2/A2.1	2/A2.1	2	UNDERCUT DOOR 1" FOR EXHAUST AIR MAKE-UP
103	LAVATORY	NEW - 3'-0" X 7'-0" X 1 3/4"	H.M.	K.D. H.M.	B	2/A2.1	2/A2.1	2	UNDERCUT DOOR 1" FOR EXHAUST AIR MAKE-UP
104	STAGING	NEW ROLLING DOOR IN EXISTING OPENING.	METAL	METAL	D	-	-	4	G.C. TO PROVIDE NEW ROLLING DOOR TO MATCH EXISTING. FIELD VERIFY.
105	OFFICE	EX.	EX.	EX.	B	-	-	-	EXISTING DOOR, FRAME & HARDWARE. G.C. TO ENSURE PROPER WORKING ORDER
106	BREAK ROOM	EX.	EX.	EX.	B	-	-	-	EXISTING DOOR, FRAME & HARDWARE. G.C. TO ENSURE PROPER WORKING ORDER

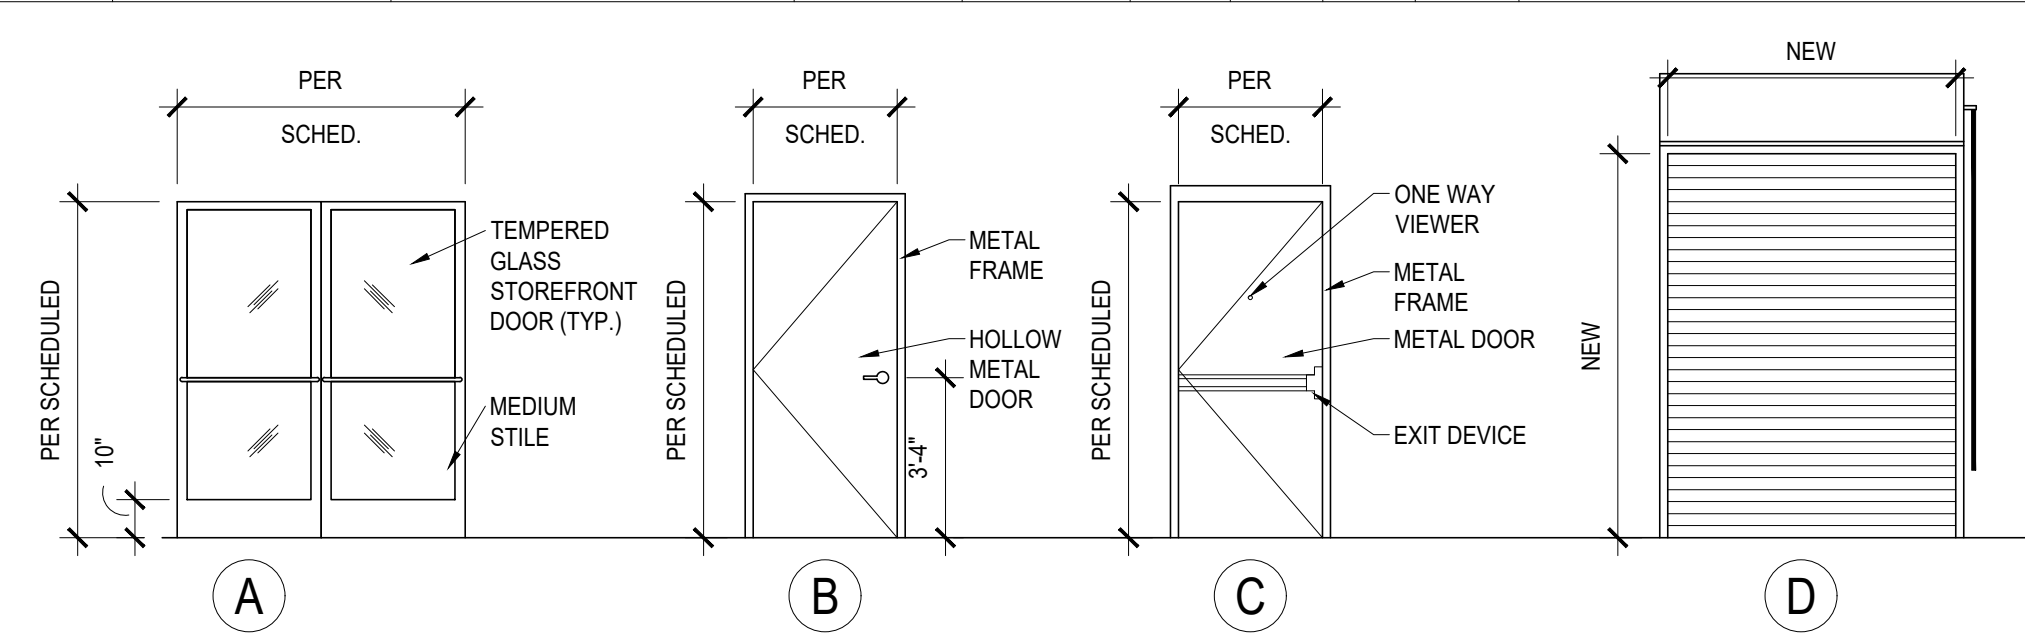

1 DOOR ELEVATIONS SCALE: 1/4"=1'-0" PAINT INSIDE OF EXTERIOR DOORS AND FRAMES IP-2

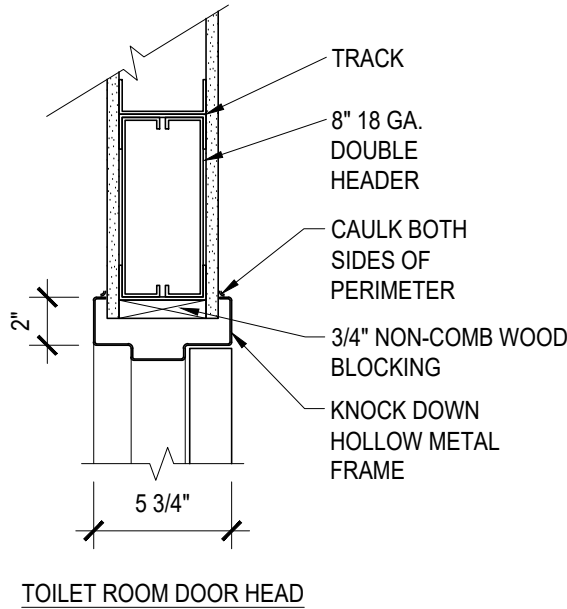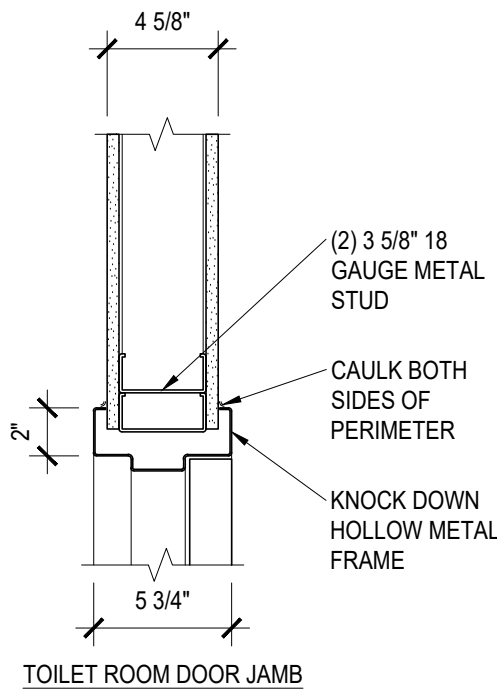

2 JAMB /HEAD DETAIL SCALE: 1 1/2"=1'-0"

EXTERIOR PAINT SPECIFICATIONS FOR ADVANCE AUTO PARTS - NEW CONSTRUCTION & REPAINT / REMODEL UPDATED JANUARY 9, 2025)

NOTE: COLD WEATHER APPLICATION

- MINIMUM AMBIENT / SUBSTRATE TEMPERATURE OF 35 DEGREES (UNLESS OTHERWISE NOTED)
- APPLICATION MUST ALLOW FOR 3-4 HOURS ABOVE 35 DEGREES FOR COATINGS TO DRY TO TOUCH
- FULL CURE TIME OF 48 HOURS NEEDED AT 35 DEGREES OR ABOVE (LOWER TEMPS WILL EXTEND CURE TIME)
- DO NOT APPLY IF RAIN, SNOW, OR HEAVY DEW IS EXPECTED WITHIN 48 HOURS
- MINIMUM PRODUCT STORAGE TEMPERATURE OF 40 DEGREES REQUIRED

- 1.0 EXTERIOR BLOCK WALLS (SMOOTH & SPLIT-FACE) - A1, B1, Y1, BK

NEW:
1)SURFACE PREPARATION: PRESSURE WASH WITH A MINIMUM OF 2000 PSI TO REMOVE ANY DIRT, MUD, EXCESS MORTAR, ETC. FROM THE BLOCK. MAKE SURE BLOCK IS THOROUGHLY DRY PRIOR TO APPLICATION OF ANY COATINGS.
2)PRIMER / FILLER: PPG SPEEDHIDE 6-150I H-FILL BLOCK FILLER OR PPG PERMA CRETE 4-100XI BLOCK SURFACER (LOW TEMP ONLY). BLOCK FILLER MUST BE SPRAYED AND BACK-ROLLED WITH LONG NAP ROLLERS. BLOCK TO BE FILLED PINHOLE-FREE. PRIOR TO PROCEEDING WITH FINISH COAT.
3)FINISH: 2 COATS PPG SPEEDHIDE 6-2110XI EXTERIOR SATIN FINISH. APPLICATION TO MEET THE REQUIREMENTS OF THE PRODUCT DATA SHEET AT 1.4 - 1.8 MILS DFT PER COAT. FINISH COAT SHOULD BE SPRAYED AND BACK ROLLED TO PRODUCE A PINHOLE-FREE SURFACE. COLOR TO BE AAP-A1 - PPG0985-3 SILVER BAND, AAP-B2 UPPER ACCENT - LOWER ACCENT PPG0986-5 STEAMSHIP
AAP-ACCENT STRIPE - ADVANCE AUTO PARTS YELLOW - AAP BLACK SIGN BAND USE PPG PSX ONE 750 POLYSILOXANE GLOSS - REFER TO FINISH SCHEDULE FOR SITE SPECIFIC COLOR REQUIREMENTS.
** A SITE VISIT IS TO BE PERFORMED BY A PPG PAINT REPRESENTATIVE PRIOR TO FILLER OR PRIMER APPLICATION AND AFTER FINISH TO INSURE SOUND APPLICATION. REFER TO THE RESPONSIBILITY MATRIX FOR CONTACT INFORMATION**

REPAINT:
1)SURFACE PREPARATION: REQUIREMENTS SAME AS ABOVE.
2)PRIMER / FILLER: PPG SEAL-GRIP 17-921XI ACRYLIC PRIMER SEALER.
3)FINISH: 2 COATS. PPG SPEEDHIDE 6-2110XI EXTERIOR SATIN FINISH. APPLICATION TO MEET THE REQUIREMENTS OF THE PRODUCT DATA SHEET AT 1.4 - 1.8 MILS DFT PER COAT.
COLOR TO BE AAP-A1 - PPG0985-3 SILVER BAND UPPER ACCENT - AAP-B2 LOWER ACCENT-PPG0986-5 STEAMSHIP
AAP-Y1 ACCENT BAND - ADVANCE AUTO PARTS YELLOW USE PPG PSX ONE 750 POLYSILOXANE GLOSS
REFER TO FINISH SCHEDULE FOR SITE SPECIFIC COLOR REQUIREMENTS.

** A SITE VISIT IS TO BE PERFORMED BY A PPG PAINT REPRESENTATIVE PRIOR TO FILLER OR PRIMER APPLICATION AND AFTER FINISH TO INSURE SOUND APPLICATION. REFER TO THE RESPONSIBILITY MATRIX FOR CONTACT INFORMATION**

- 1.1 PRE-FINISHED METAL & METAL BACK DOOR FINISHES - A1, B1, Y1, BK

NOTE: MINIMUM APPLICATION TEMPERATURE OF 45 DEGREES FOR ALL METAL FINISHES

REPAINT & NEW (IF NEEDED):
1)SURFACE PREPARATION: SURFACE MUST BE CLEAN, DRY AND IN SOUND CONDITION. POWER WASH TO REMOVE ALL OIL, GREASE, DIRT, LOOSE RUST, VISIBLE CONTAMINANTS, PEELING PAINT AND OTHER CONTAMINATION TO ENSURE ADEQUATE ADHESION USING A MINIMUM OF 2000 PSI WATER BLAST. DO NOT USE ANY HYDROCARBON CLEANERS, USE A WATER-BASED CLEANER / DEGREASER SUCH AS CLEAR MAGIC OR SIMPLE GREEN AND RINSE THOROUGHLY, AND ALLOW TO DRY.
2)PRIMER: 1 COAT (MINIMUM) PPG 90-1912 PITT-TECH DTM ACRYLIC PRIMER SEALER
3)FINISH: 2 COATS (MINIMUM) PPG 90-1610 PITT-TECH SEMI-GLOSS ACRYLIC FINISH.
AAP-BK - ADVANCE AUTO PARTS BLACK

- 1.2 PRE-FINISHED METAL & METAL BACK DOOR FINISHES - BK

NOTE: MINIMUM APPLICATION TEMPERATURE OF 45 DEGREES FOR ALL METAL FINISHES

NEW & REPAINT:
1)SURFACE PREPARATION: SURFACE MUST BE CLEAN, DRY AND IN SOUND CONDITION. POWER WASH TO REMOVE ALL OIL, GREASE, DIRT, LOOSE RUST, VISIBLE CONTAMINANTS, PEELING PAINT AND OTHER CONTAMINATION TO ENSURE ADEQUATE ADHESION USING A MINIMUM OF 2000 PSI WATER BLAST. DO NOT USE ANY HYDROCARBON CLEANERS, USE A WATER-BASED CLEANER / DEGREASER SUCH AS CLEAR MAGIC OR SIMPLE GREEN AND RINSE THOROUGHLY, AND ALLOW TO DRY.
2)PRIMER: 1 COAT (MINIMUM) PITT-GUARD 97-948 GRAY EPOXY PRIMER DEPENDING UPON LOCAL REGULATIONS. APPLY IN ACCORDANCE TO THE PRODUCT DATA SHEET.
3)FINISH: 2 COATS (MINIMUM) PPG DURATHANE 95-3303 DTM URETHANE SPECIAL FORMULA
AAP-BK - BLACK

- 1.5METAL HANDRAILS


NOTE: MINIMUM APPLICATION TEMPERATURE OF 45 DEGREES FOR ALL METAL FINISHES

1)SURFACE PREPARATION: SURFACE MUST BE CLEAN, DRY AND IN SOUND CONDITION. POWER WASH TO REMOVE ALL OIL, GREASE, DIRT, LOOSE RUST, VISIBLE CONTAMINANTS, PEELING PAINT AND OTHER CONTAMINATION TO ENSURE ADEQUATE ADHESION USING A MINIMUM OF 2000 PSI WATER BLAST. DO NOT USE ANY HYDROCARBON CLEANERS, USE A WATER-BASED CLEANER / DEGREASER SUCH AS CLEAR MAGIC OR SIMPLE GREEN AND RINSE THOROUGHLY, AND ALLOW TO DRY.
PRIME, AS NEEDED. SPOT PRIME BARE AREAS WITH PPG 4160 RUST INHIBITIVE PRIMER FOR METAL SURFACES, OR FOR ALL OTHER SURFACES.
PRIMER: PPG 90-1912 PITT-TECH DTM ACRYLIC PRIMER SEALER
FINISH: PPG PITT-TECH 90-1580 SAFETY YELLOW GLOSS ACRYLIC ENAMEL

- 1.6 PARKING LOT BOLLARDS, MANDATED SAFETY REQUIREMENTS

1)SURFACE PREPARATION: SURFACE MUST BE CLEAN, DRY AND IN SOUND CONDITION. POWER WASH IF NEEDED TO REMOVE ALL VISIBLE CONTAMINANTS, PEELING PAINT AND OTHER CONTAMINATION TO ENSURE ADEQUATE ADHESION USING A MINIMUM OF 2000 PSI WATER BLAST. DO NOT USE ANY HYDROCARBON CLEANERS, USE A WATER-BASED CLEANER / DEGREASER SUCH AS CLEAR MAGIC OR SIMPLE GREEN AND RINSE THOROUGHLY, AND ALLOW TO DRY.
PRIME, AS NEEDED. SPOT PRIME BARE AREAS WITH PPG 4160 RUST INHIBITIVE PRIMER FOR METAL SURFACES, OR FOR ALL OTHER SURFACES.
PRIMER: PPG 90-1912 PITT-TECH DTM ACRYLIC PRIMER SEALER
FINISH: PPG PITT-TECH 90-1580 SAFETY YELLOW GLOSS ACRYLIC ENAMEL

REFER TO PRODUCT DATA SHEETS AND LABEL FOR SPECIFIC APPLICATION INSTRUCTIONS AND DRY TIMES.

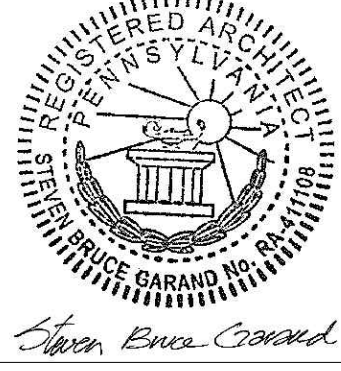

John E. Connelley

221 GROVE CITY RD,
SLIPPERY ROCK, PA 16057

STORE # TBD

Advance Auto Parts

221 GROVE CITY RD,
SLIPPERY ROCK, PA 16057

STORE # TBD

STORE # TBD

STORE # TBD

STORE # TBD

STORE # TBD

DOOR SCHEDULE, DETAILS AND NOTES

A2.1




- [illegible]

DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

A3



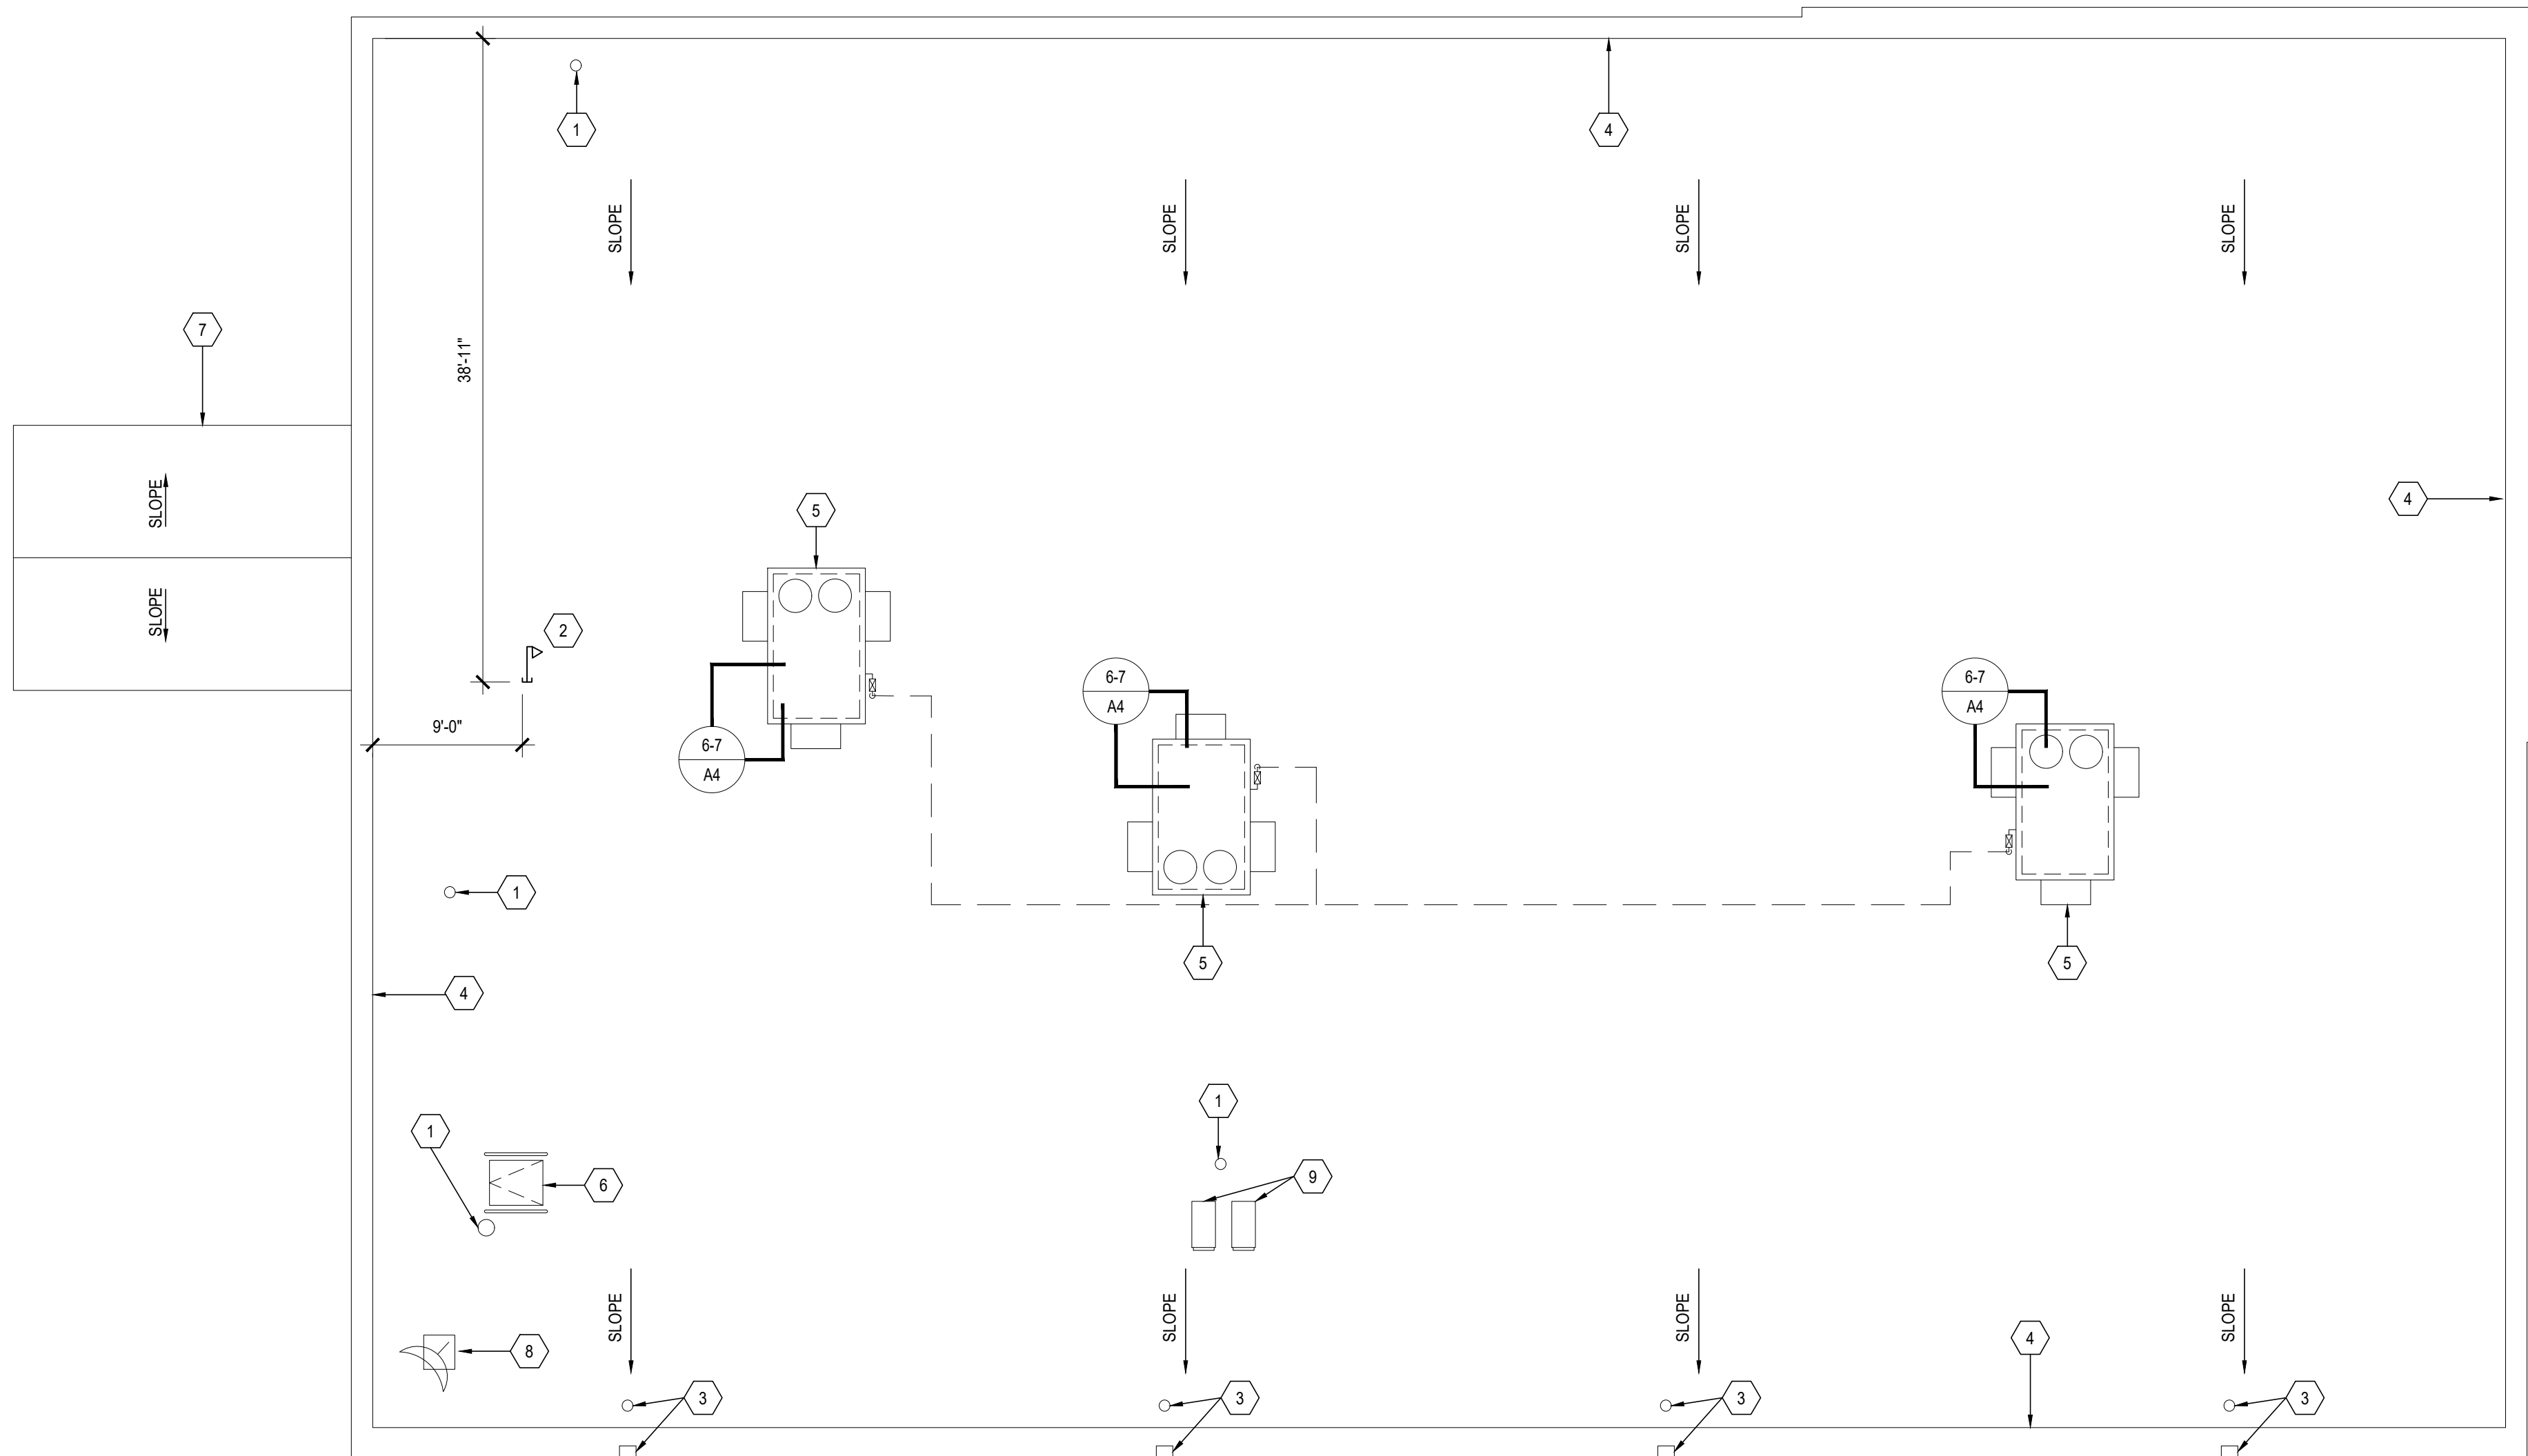


ROOF PLAN KEY NOTES:

- 1 EXISTING VENT CAPS. SEAL ANY UNUSED VENTS.
- 2 SATELLITE WEATHER HEAD PENETRATION, REFER TO DETAIL 5/A4.
- 3 EXISTING SCUPPERS AND ROOF DRAIN. G.C. TO CLEAN PRIOR TO TURNOVER
- 4 EXISTING ROOF PARAPET WALL & METAL COPING TO REMAIN.
- 5 RTU - SEE MECHANICAL PLANS.
NOTE: EXISTING UNITS ARE TO BE REMOVED AND REPLACED WITH NEW UNITS. SEE DETAILS THIS SHEET FOR ADDITIONAL SUPPORT DETAILS.
- 6 EXISTING ROOF HATCH TO REMAIN. G.C. TO ENSURE PROPER WORKING ORDER.
- 7 EXISTING DRIVE THRU CANOPY ROOF TO REMAIN.
- 8 EXISTING SATELLITE WEATHER HEAD CEILING TOWER. G.C. TO REMOVE ALL EQUIPMENT NOT ATTACHED TO THE ROOF AND ENSURE WEATHER TIGHT.
- 9 EXISTING MECHANICAL EQUIPMENT TO BE REMOVED. G.C. TO REMOVE ALL EQUIPMENT NOT ATTACHED TO THE ROOF AND ENSURE WEATHER TIGHT.

ROOF PLAN GENERAL NOTES:

- 1. ROOF IS EXISTING TO REMAIN. G.C. TO COORDINATE WITH AAP CM AND LANDLORD FOR ANY WORK REQUIRED PRIOR TO STARTING.


1 ROOF PLAN
SCALE: 1/8" = 1'-0"
TRUE NORTH
PLAN NORTH

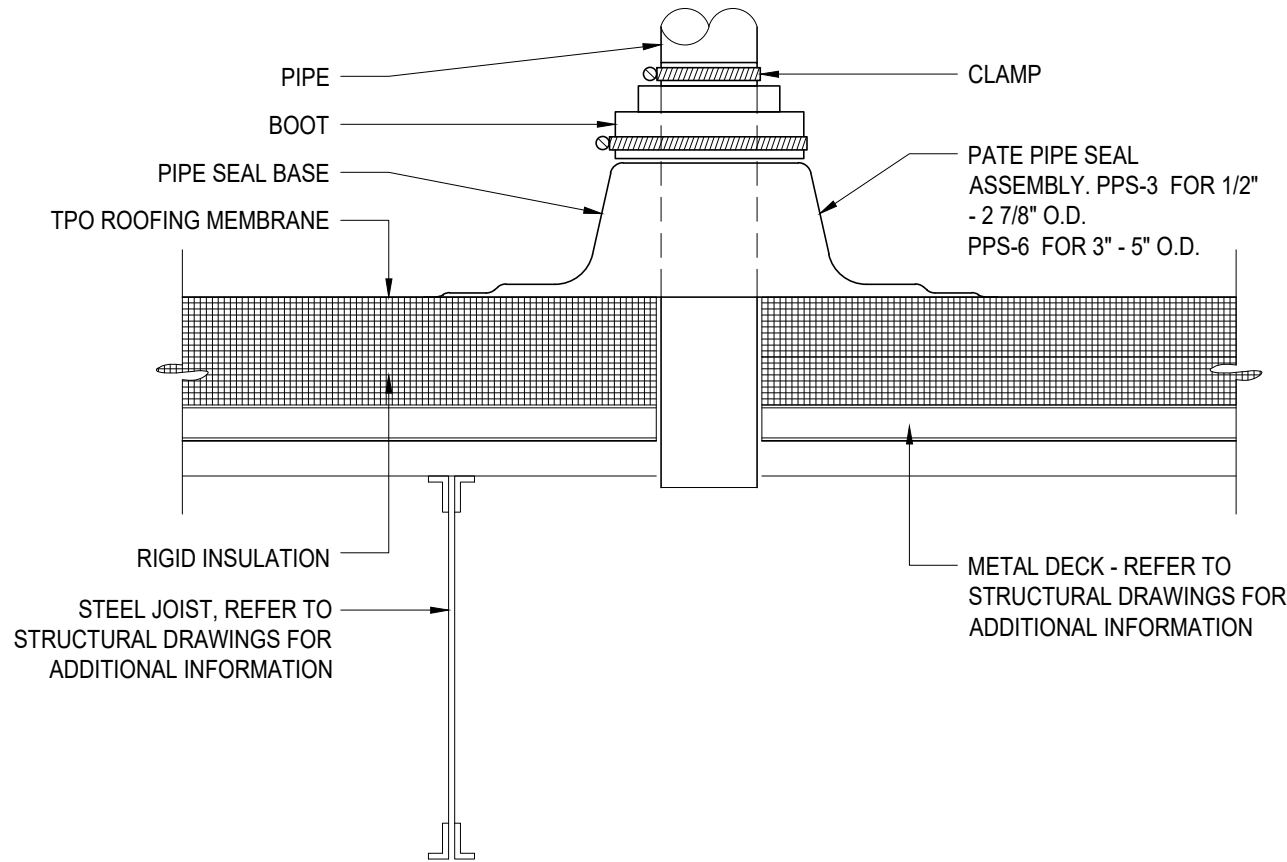


2 PIPE FLASHING DETAIL
SCALE: 1 1/2"=1'-0"

3 NOT USED
SCALE: 1 1/2"=1'-0"


4 NOT USED
SCALE: 1 1/2"=1'-0"

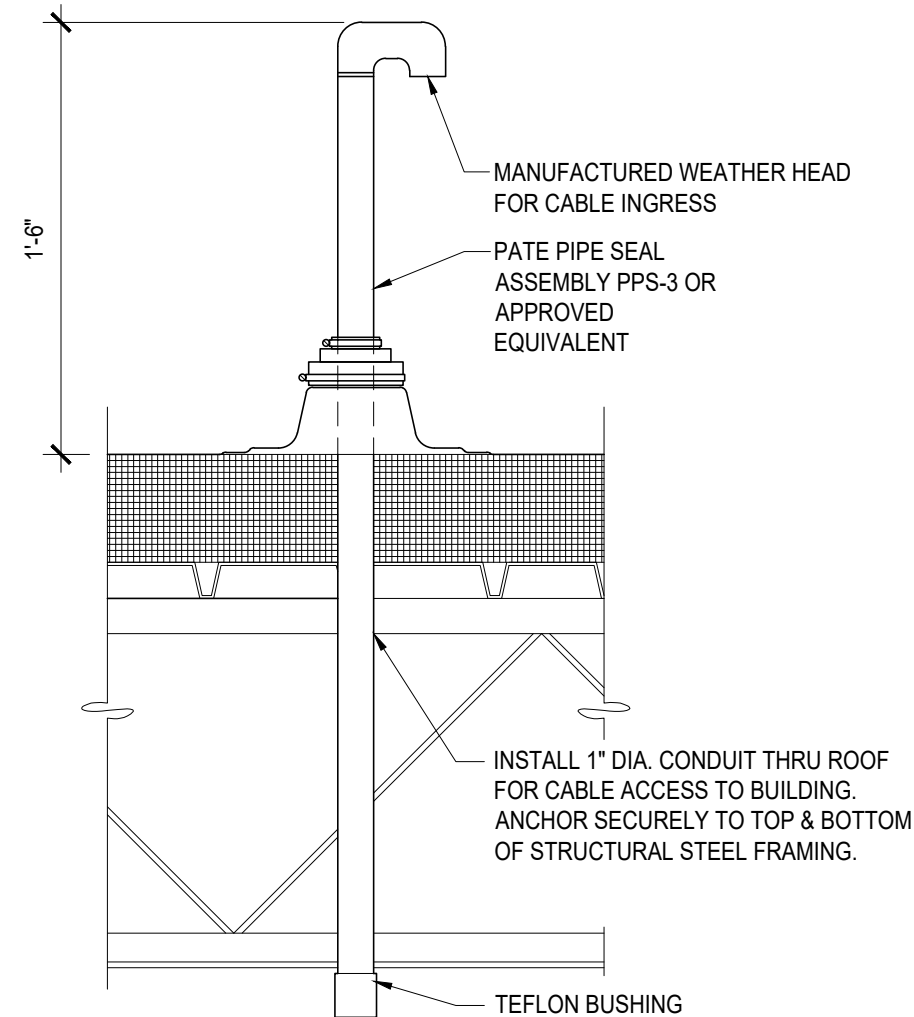


5 CELL TOWER BOOSTER CONDUIT DETAIL
SCALE: 1 1/2"=1'-0"

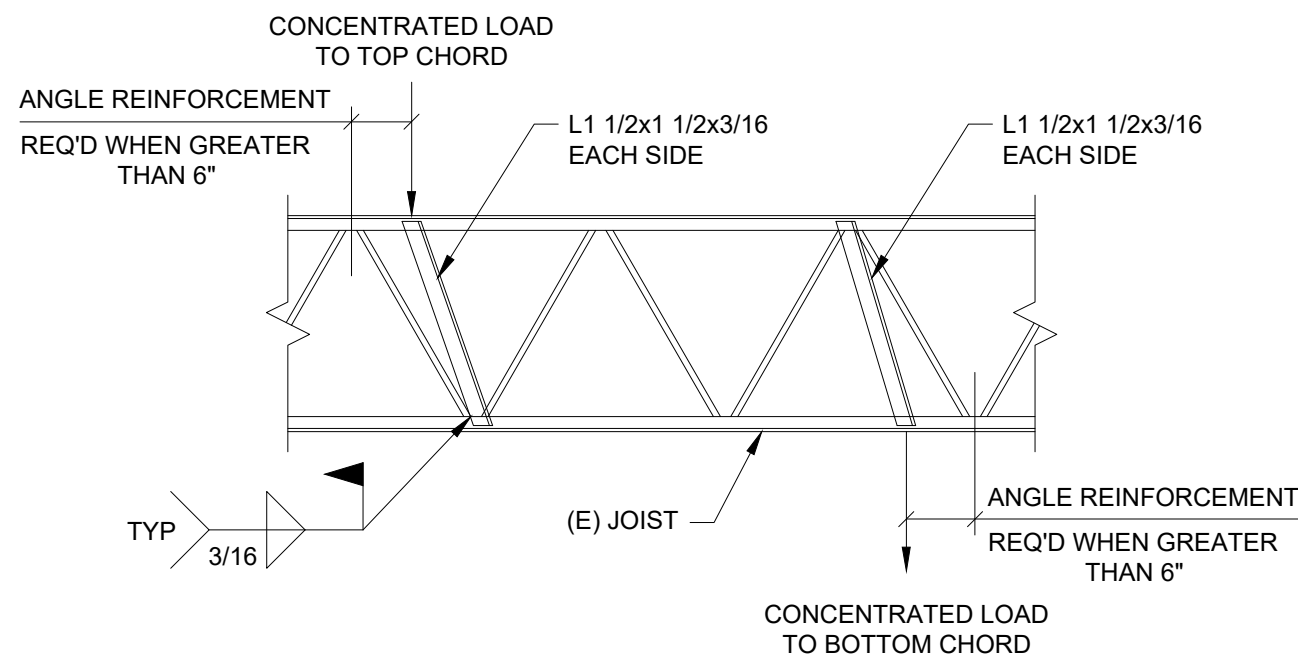


TYPICAL EXISTING JOIST REINFORCING DETAIL

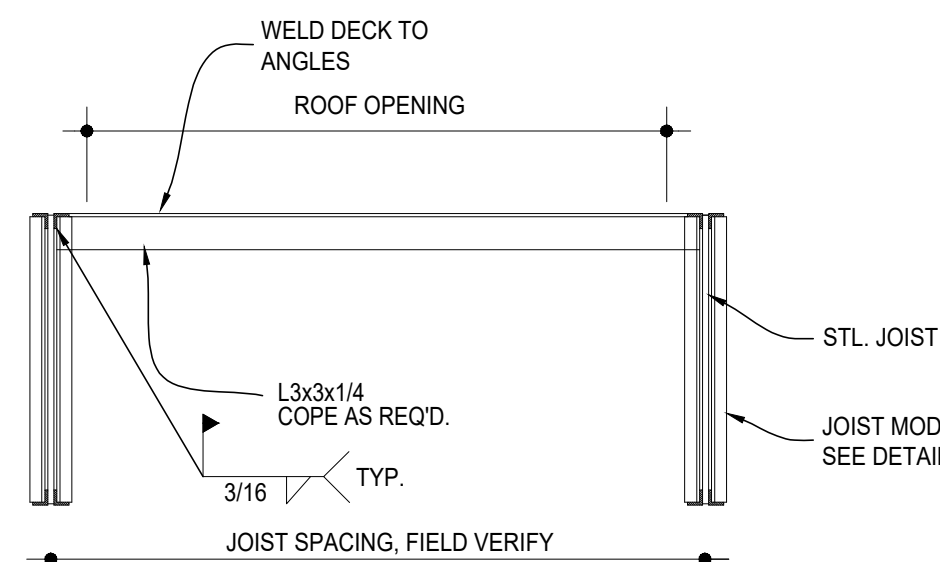

6 ROOF EQUIPMENT SUPPORT DETAIL
SCALE:

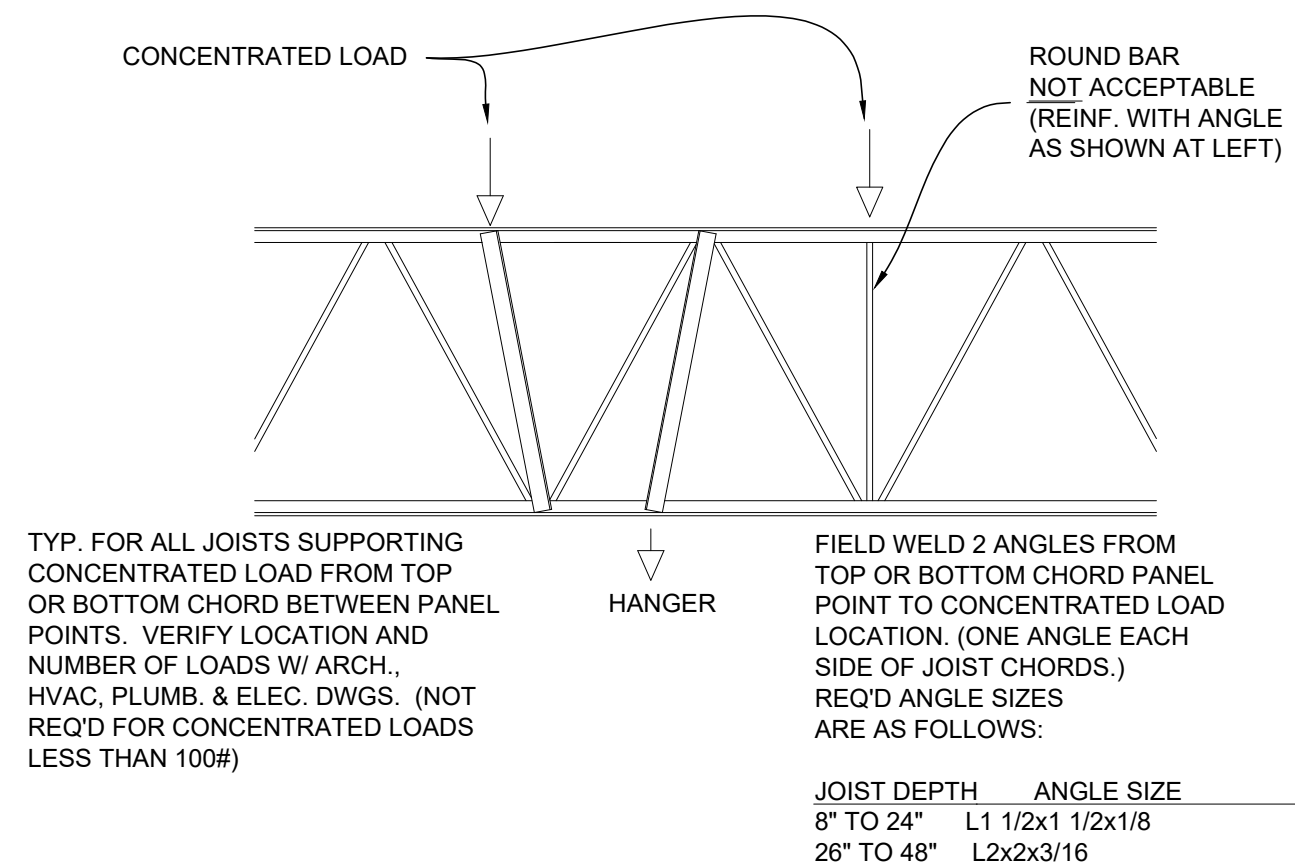


7 TYP JOIST MODIFICATION DETAIL
SCALE:

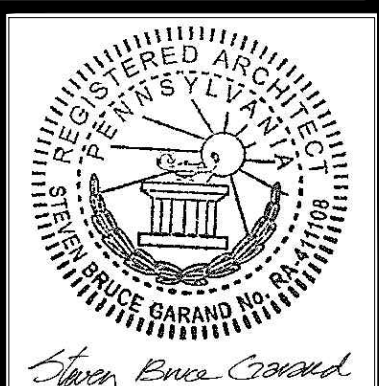

REV	DATE	DESCRIPTION

DATE	GROSS SQ. FT.
6-18-26	11,261 S.F.
PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF

VERSION Q1-26 83x83
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

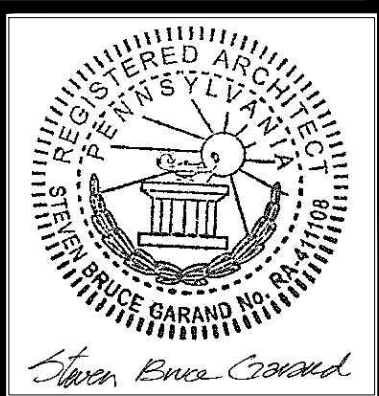

REVISIONS		DESCRIPTION
REV	DATE	

DATE	GROSS SQ. FT.
6-18-26	11,261 S.F.
PROJECT # 330	
DRAWN BY: STAFF	
CHECK BY: STAFF	

VERSION Q1-26 83x83
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

REFLECTED
CEILING PLAN

A5

CEILING PLAN KEY NOTES

- EXISTING LAY IN CEILING GRID WITH NEW PAD/TILES. SEE FINISH SCHEDULE ON A1.
- EXISTING LIGHT HOUSING TO BE REUSED. BALLASTS AND BULBS TO BE REMOVED. NEW LED BULBS TO BE INSTALLED IN EACH LIGHT FIXTURE.
- EXISTING GYP. BD. SOFFIT.
- EXISTING GYP. BD. CEILING.
- EXISTING ROOF HATCH AND LADDER.
- EXISTING UNIT HEATER. SEE MECH PLAN
- EXISTING SUPPLY AIR DIFFUSERS. SEE MECH PLAN. GC TO CLEAN PRIOR TO TURNOVER
- EXISTING SECURITY SHUTTER.
- EXISTING ACCESS PANEL.
- OPEN TO DECK ABOVE
- EXISTING ROOF DRAIN.
- EXISTING RETURN AIR DIFFUSER. SEE MECH PLANS.
- EXISTING EXTERIOR WALL PACK LIGHTS TO BE REPLACED. SEE ELECTRICAL PLANS
- NEW EXIT SIGN / EMERGENCY LIGHT. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- ACT-1 2X4 LAY IN CEILING. SEE FINISH SCHEDULE ON A2.
- NEW SUPPLY AIR DIFFUSERS. SEE MECH PLANS.
- NEW WALL PACK LIGHT - CENTER OVER DOOR. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- NEW EMERGENCY LIGHT W/ BATTERY B.U. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION. WHERE FIXTURE OCCURS AT DOOR, CENTER OVER DOOR.
- ~~SUSPENDED LED LIGHT FIXTURE. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.~~
- SURFACE MOUNTED LED LIGHT FIXTURE. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- EXISTING TOILET ROOM EXHAUST FAN. GC TO CLEAN PRIOR TO TURNOVER. ENSURE PROPER WORKING ORDER.
- NEW TOILET ROOM EXHAUST FAN. SEE MEP PLANS
- WATER HEATER - REFER TO PLUMBING SHEETS FOR ADDITIONAL INFORMATION.
- LOCATION OF 2" POWER AND DATA DROPS. ENSURE DROPS CLEAR ALL LIGHTING FIXTURES. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- ELECTRICAL OUTLET FOR GREETER / SECURITY MONITOR. RE: ELECTRICAL SHEETS
- AIR CURTAIN. SEE MECHANICAL PLANS.
- CEILING EDGE TREATMENT AT EXISTING LAY-IN CEILING. SEE DETAIL 2/A5 THIS SHEET.
- NEW LIGHTING TO MATCH EXISTING. HUNG FROM ABOVE TO MATCH THE CEILING HEIGHT. ELECTRICAL SHEETS.

***NOTE:


ELECTRICAL CONTRACTOR TO RUN POWER TO CASHWRAPS AFTER CASHWRAPS ARE SET.

3.0

2.0

1.0


1 REFLECTED CEILING PLAN
SCALE: 1/8" = 1'-0"

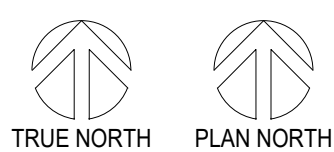


GENERAL NOTES:

- ALL ITEMS TO BE SUSPENDED (SUSPENDED CEILING, ELECTRICAL EQUIPMENT, MECHANICAL EQUIPMENT, PLUMBING EQUIPMENT, ETC.) SHALL BE SUSPENDED FROM THE STRUCTURE ABOVE. UNLESS SPECIFICALLY STATED OTHERWISE BY THE STRUCTURAL ENGINEER. VERIFY WITH ARCHITECT/ STRUCTURAL ENGINEER PRIOR TO HANGING FROM BOTTOM CORD. IF NO STRUCTURE IS AVAILABLE OVERHEAD FOR ATTACHMENT PROVIDE UNISTRUT SUPPORTS AS REQUIRED.
- ~~ALL OVERHEAD APPURTENANCES IN MAIN SALES TO BE PAINTED EXCEPT LIGHT FIXTURES & INSULATION. AUDIO VISUAL AND FIRE PROTECTION DEVICES - GUST WORK. CONDENSING GAS PIPING TO BE PAINTED. VERIFY SCOPE WITH A/E. PROVIDE HANGERS AT EACH END OF EACH LIGHT FIXTURE.~~
- ATTACH SUPPORTS FOR HANGING SIGNS TO STEEL JOIST BOTTOM CHORD AT PANEL POINTS.
- ~~PROVIDE HANGERS AT EACH END OF EACH LIGHT FIXTURE.~~
- PAINT ALL INTERIOR GYPSUM BOARD CEILING, SOFFIT, BOTTOM AND BACK SIDES OF ALL SUSPENDED WALLS WHERE EXPOSED.


2 SOFFIT DETAIL
SCALE: 1 1/2"=1'-0"

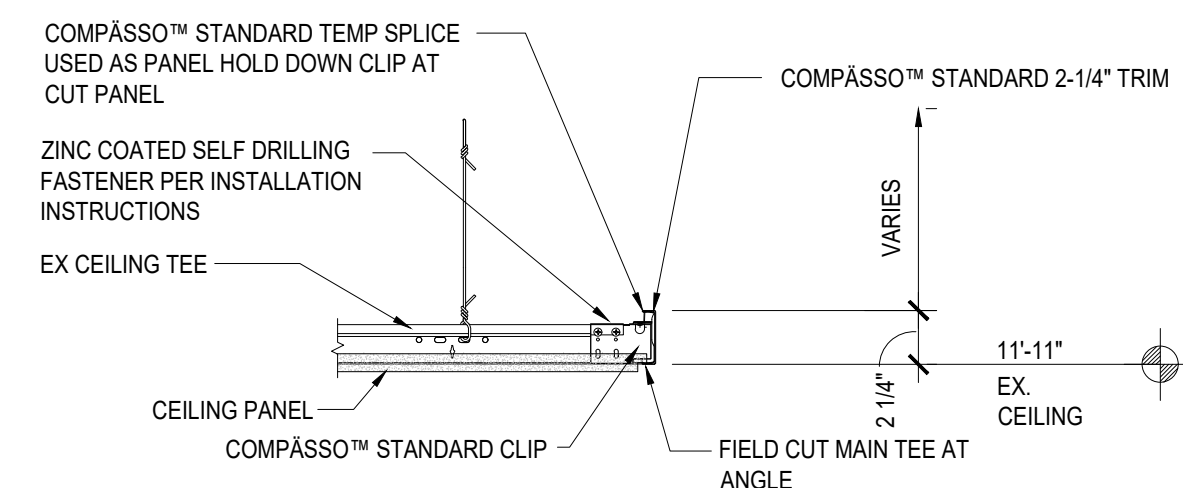


3 REFLECTED CEILING MEZZANINE PLAN
SCALE: 1/8" = 1'-0"

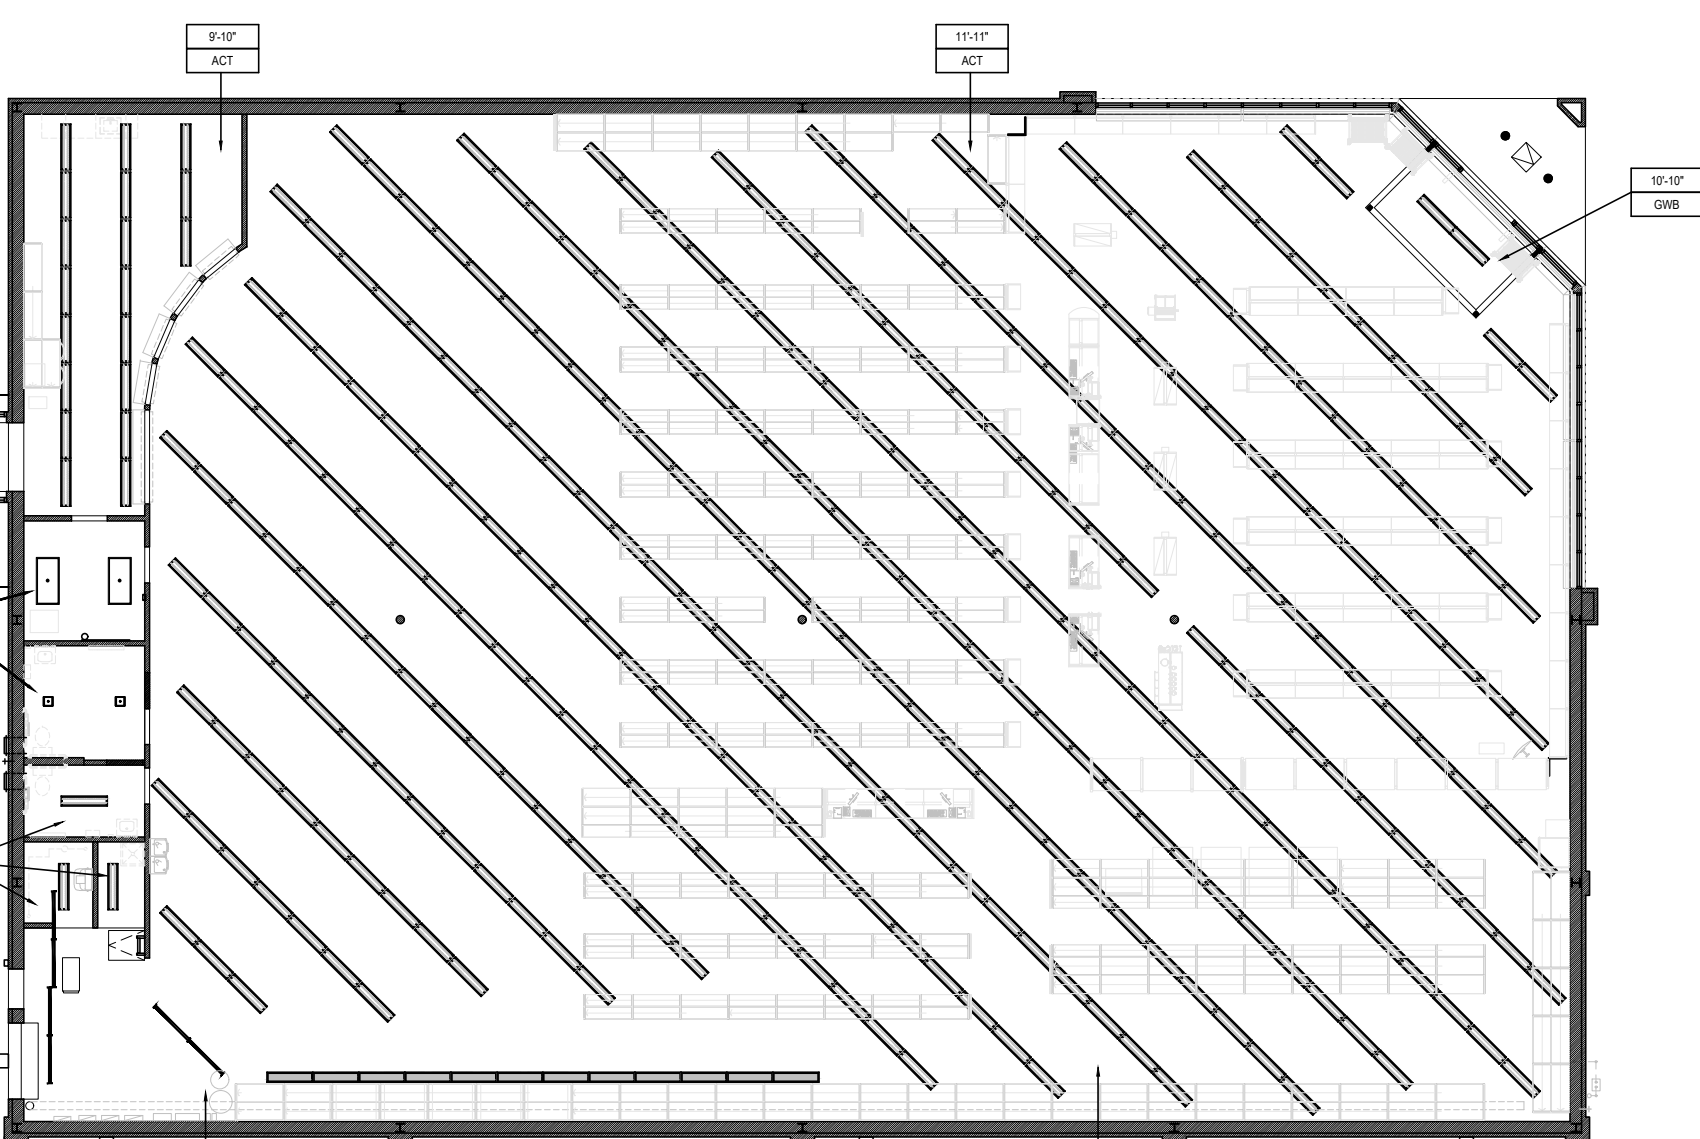




THIS PLAN FOR REFERENCE ONLY TO SHOW THE PLACEMENT OF THE FLOOR FIXTURES AS IT PERTAINS TO THE LIGHTING LOCATIONS.

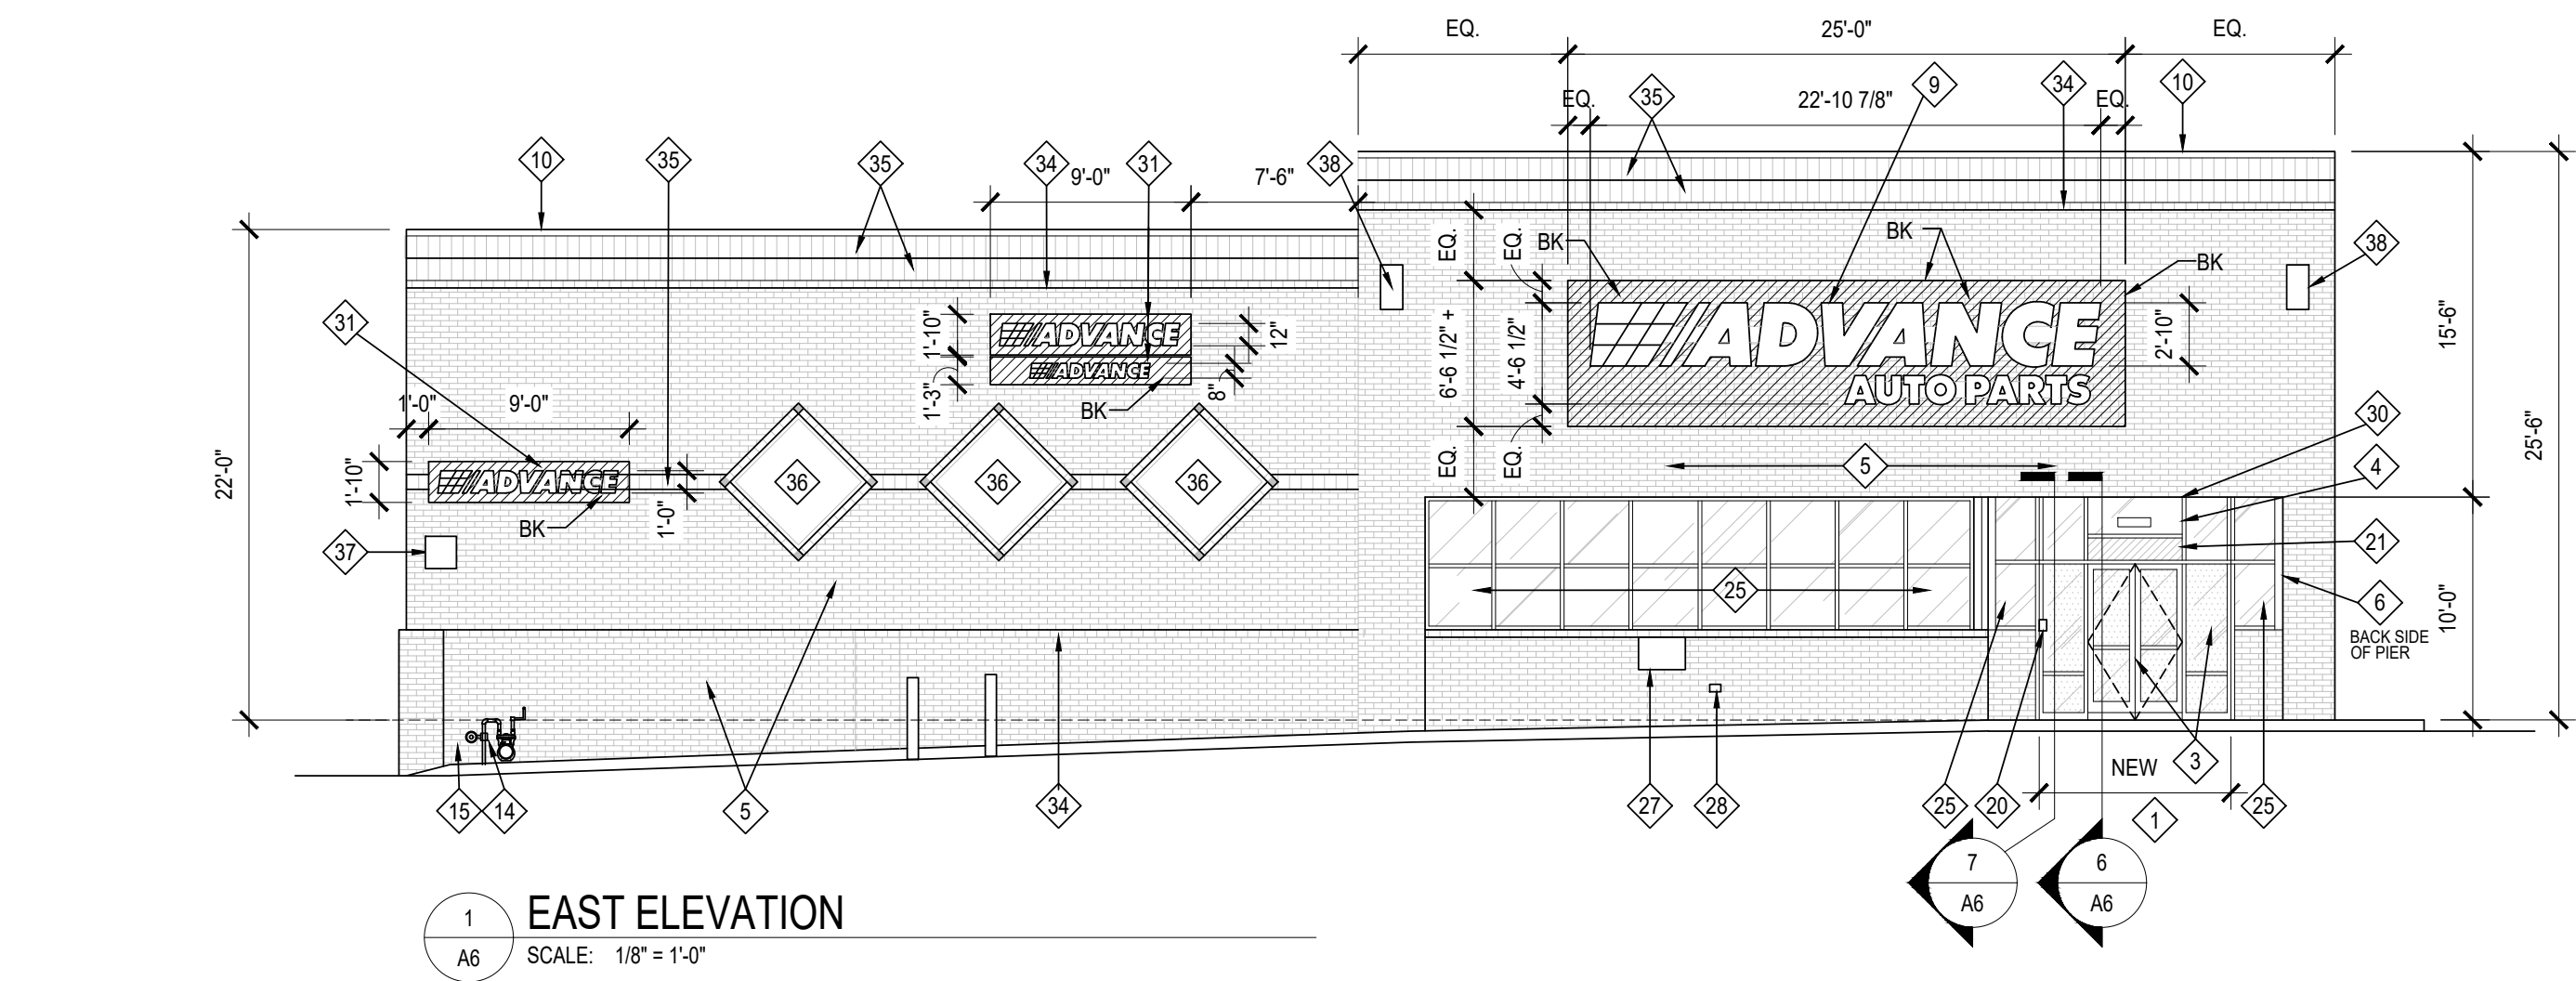

PAINTING NOTE:
G.C. TO PAINT BLACK AREA SIGNBAND TO THE NEAREST
GROUT JOINT BASED ON THE 6'-6 1/2" DIMENSION.

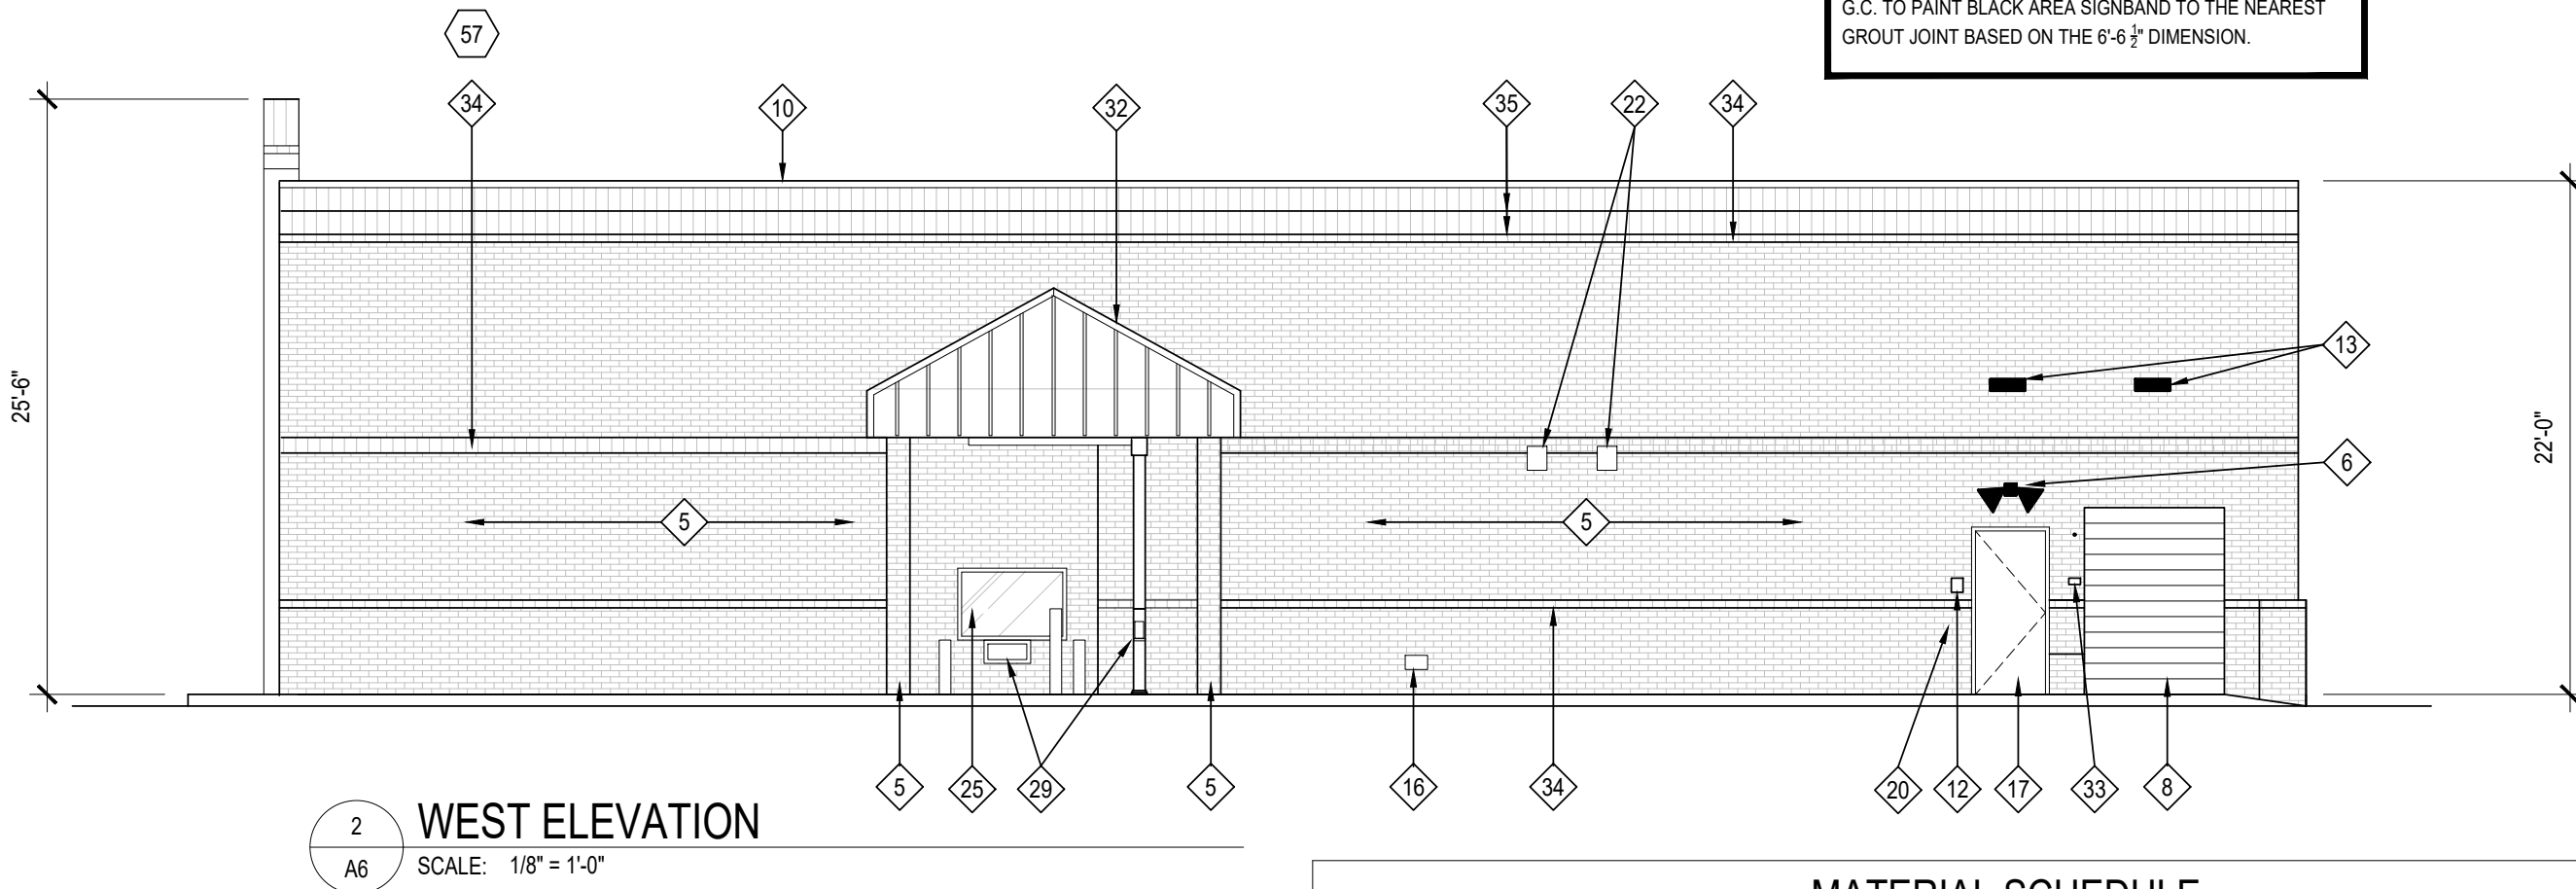

MATERIAL SCHEDULE		
MATERIAL:	EXTERIOR PAINT:	LOCATION:
BK	ADVANCE AUTO PARTS BLACK	PRE-FINISHED METAL (FACTORY FINISH), STUCCO, EIFS, BLOCK - BLACK SIGNBAND
RAILS	BLACK	HANDRAILS (EXTERIOR PAINT ONLY)
SAFETY	SAFETY YELLOW	BOLLARDS, MANDATED SAFETY AREAS

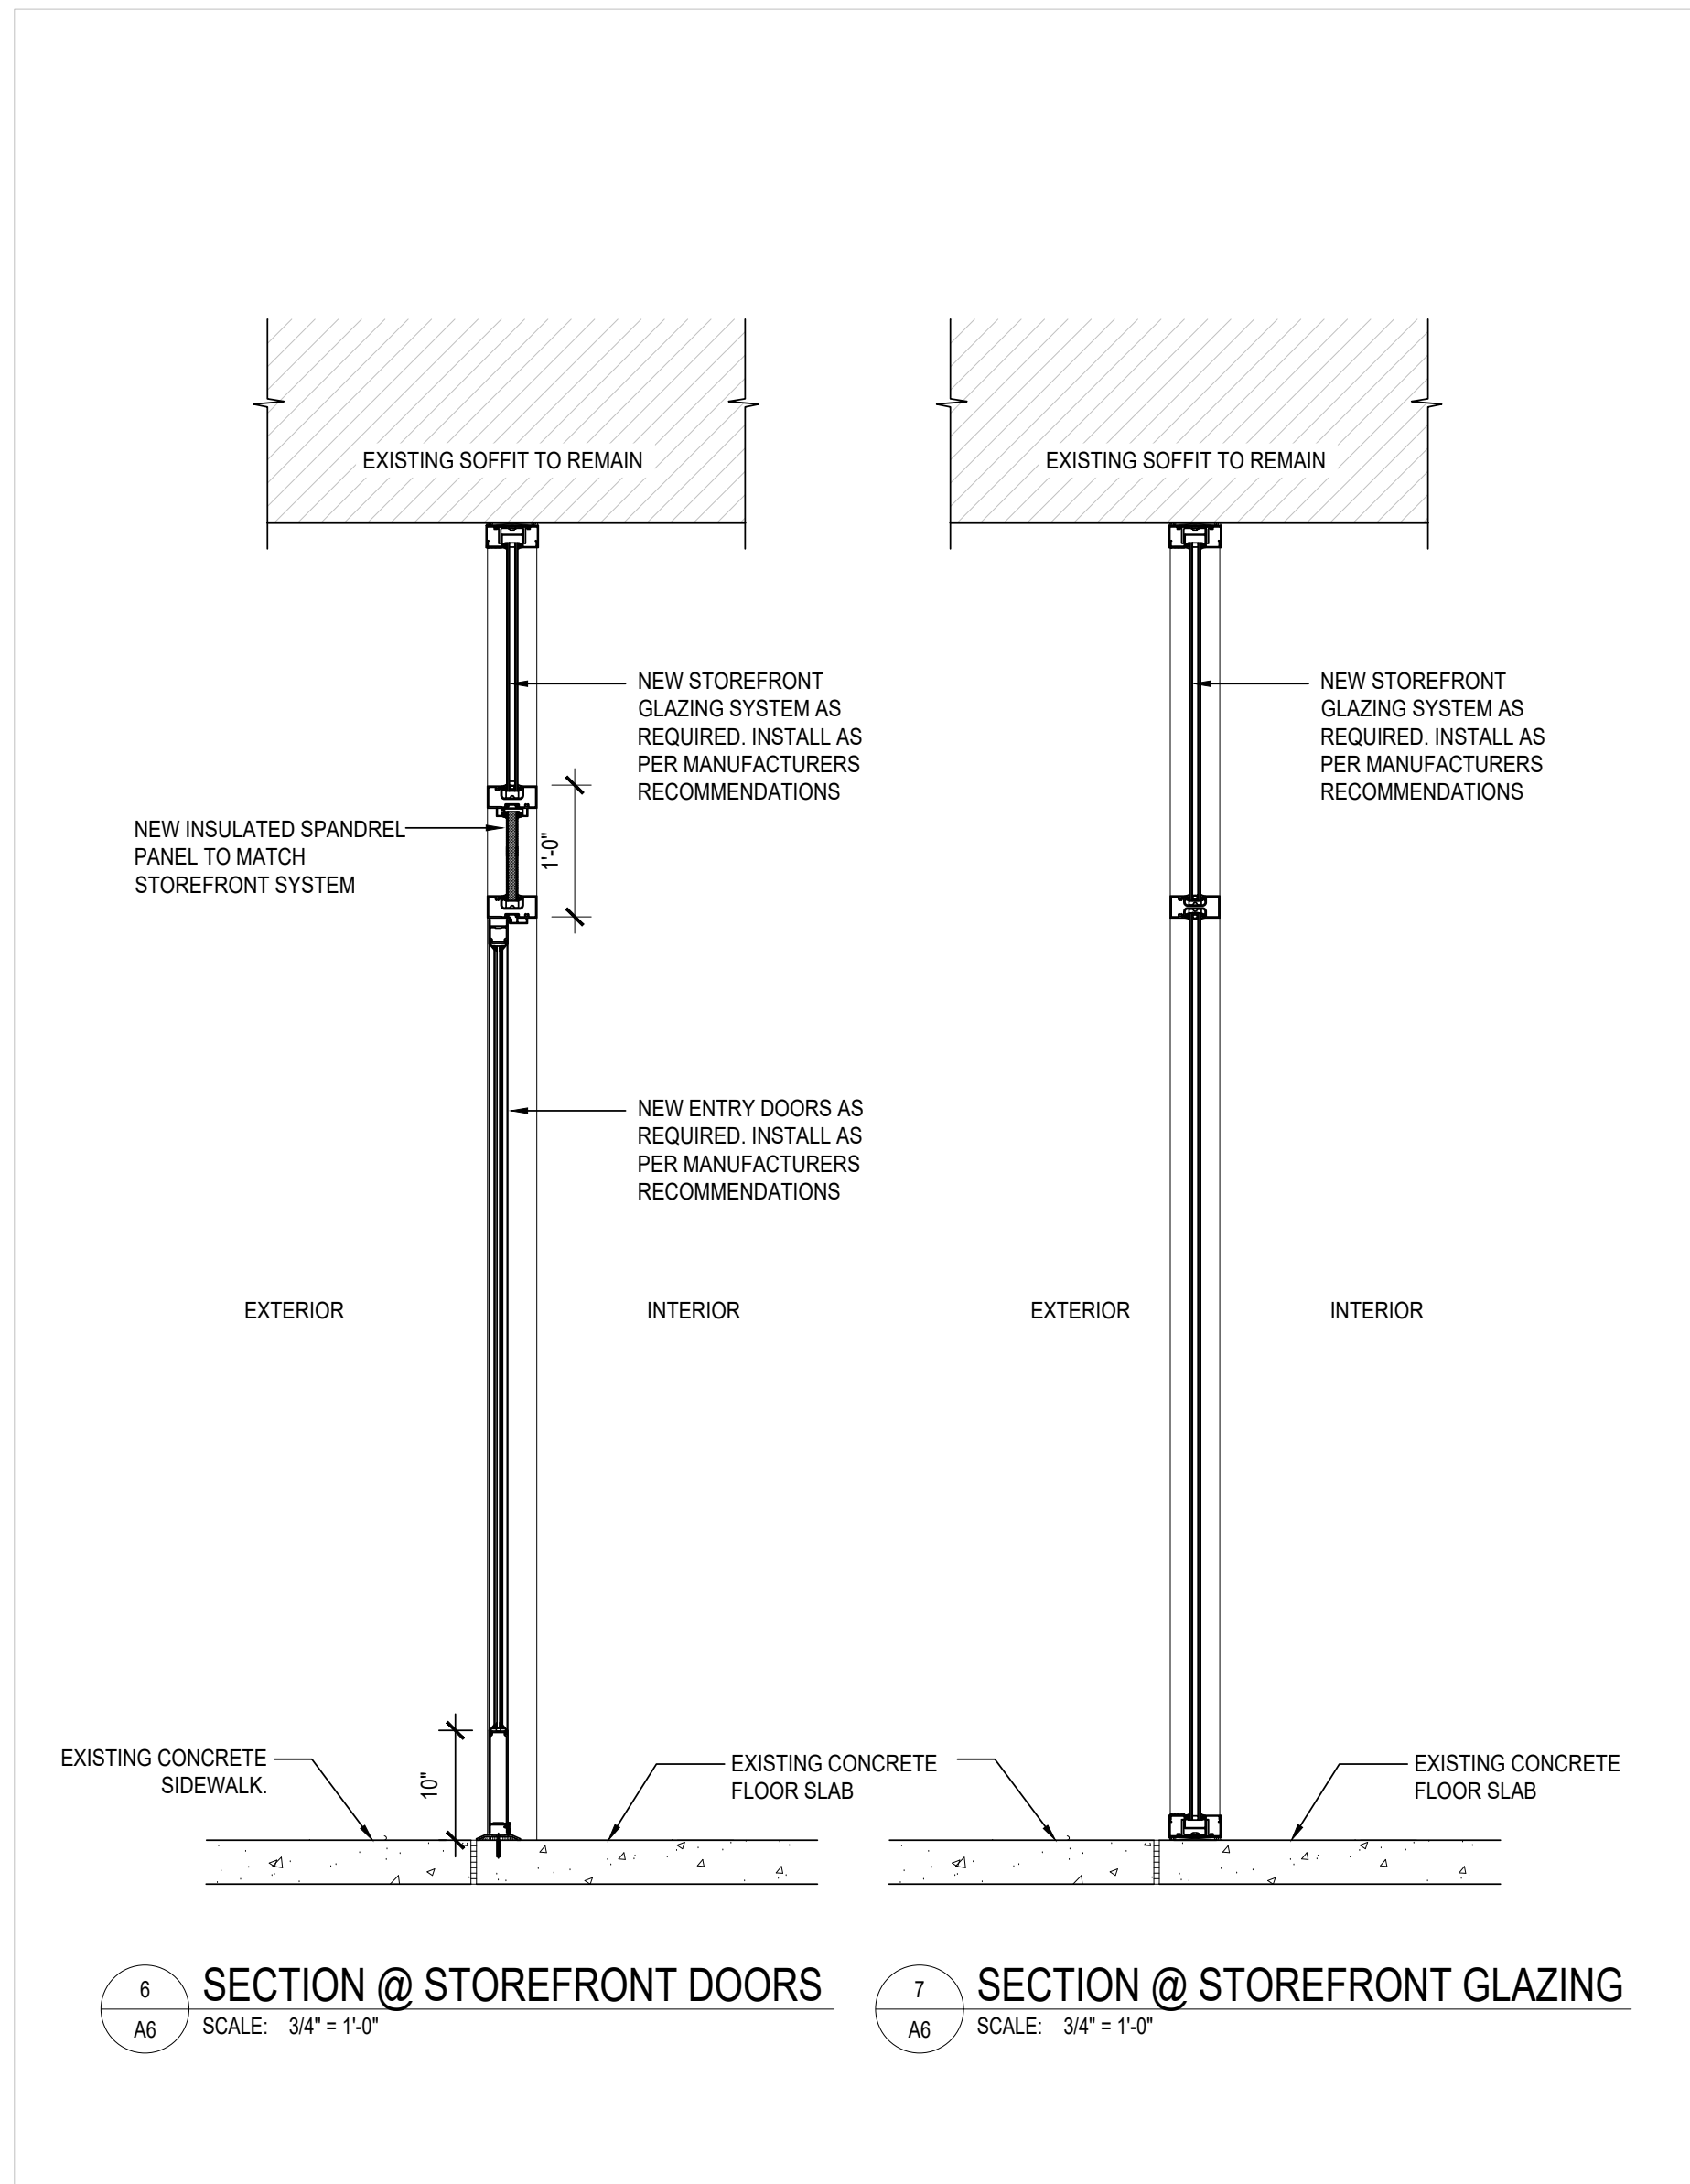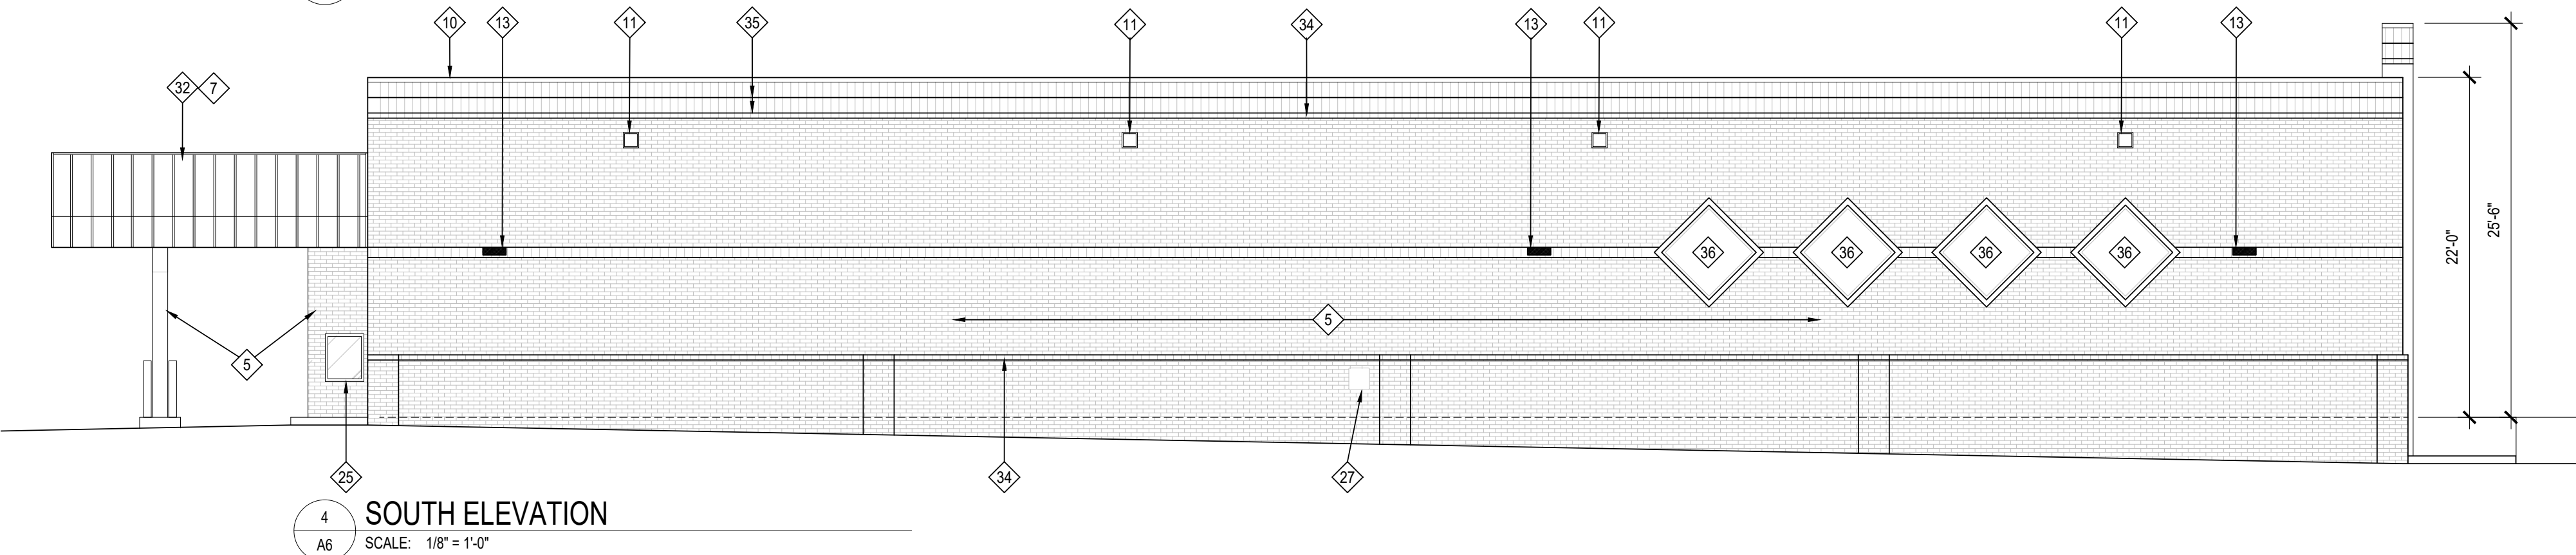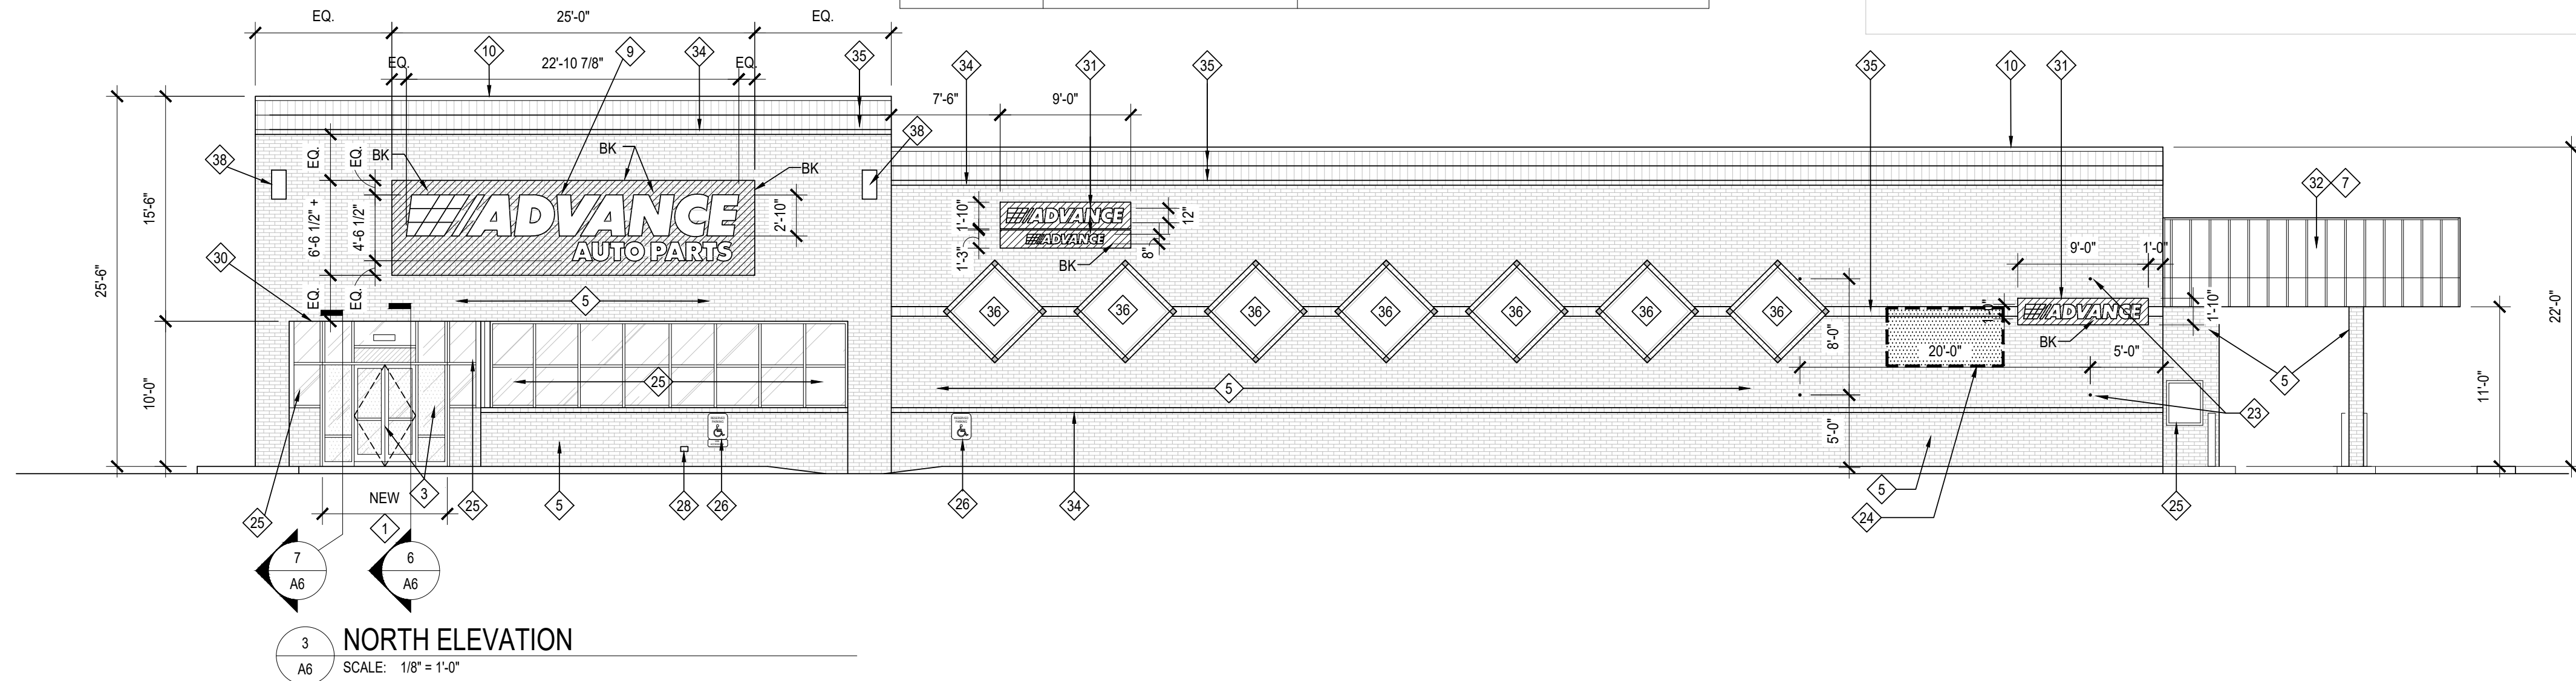


EXTERIOR ELEVATION KEY NOTES:


- 1 PROVIDE KAWNEER 451 - 2" x 4 1/2" MULLION PROFILE, CENTER SET, EXTERIOR LOADED FLUSH GLAZE STOREFRONT SYSTEM WITH 1" CLEAR LOW 'E' INSULATED GLASS. STOREFRONT SYSTEM COLOR TO BE CLEAR ANODIZED ALUMINUM. REFER TO RESPONSIBILITY MATRIX FOR ADDITIONAL INFORMATION. NO SUBSTITUTIONS. SEALANT COLOR TO MATCH SYSTEM. COORDINATE WITH REP PRIOR TO ORDERING.
- 2 EXISTING MASONRY CONTROL JOINT.
- 3 HATCH AREA REPRESENTS AREA OF TEMPERED GLAZING.
- 4 G.C. TO PROVIDE & INSTALL 5 3/4" VINYL WHITE ON BLACK ADDRESS NUMBERS BY MFR. (FAST SIGNS) ON FRONT WINDOWS CENTERED OVER DOOR, BOTTOM EDGE OF NUMBER SHALL SET 4" ABOVE FRAME - REFER TO DETAIL 5/A6 FOR ADDITIONAL INFORMATION.
- 5 EX. EXTERIOR BRICK WALL WITH BRICK BUMP-OUTS OR EXISTING EXTERIOR BRICK COLUMN ENCLOSURE. POWER-WASH ENTIRE BUILDING. CAULK AROUND ALL GLAZED OPENINGS AND AT ALL COPING, AND AT THE BASE OF THE ENTIRE PERIMETER OF THE BUILDING. COORD. WITH AAP C.M. FOR ALL BRICK REPAIR.
- 6 EMERGENCY LIGHT, REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- 7 LINE OF EXISTING EXTERIOR CANOPY (BEYOND).
- 8 EXTERIOR ROLLING DOOR.
- 9 REFER TO ELECTRICAL DRAWINGS FOR SIGNAGE REQUIREMENTS. SIGNAGE IS PERMITTED SEPARATELY AND INSTALLED BY OTHERS. SIGNAGE IS SHOW FOR REFERENCE ONLY.
- 10 EXISTING METAL COPING, PAINT TO MATCH ADJACENT BRICK (TYP).
- 11 EXISTING THRU-WALL METAL ROOF OVERFLOW DRAINS, G.C. TO CLEAN PRIOR TO TURNOVER.
- 12 EXISTING SENSOR FOR REMOTE READING OF UTILITIES, TO REMAIN.
- 13 WALL MOUNTED LIGHT FIXTURE - REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION. QUANTITIES AND LOCATION VARY PER SITE.
- 14 EXISTING GAS SERVICE ENTRANCE, GAS METER AND PIPING THRU WALL.
- 15 WALL HYDRANT, REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
- 16 EXISTING WALL HYDRANT, REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
- 17 EXISTING HOLLOW METAL DOOR AND FRAME, PAINT TO MATCH COLOR OF ADJACENT BRICK WALL SURFACE.
- 18 ELECTRICAL SCHEDULE, REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
- 19 EXISTING ELECTRIC METER, CABINET AND MISC. ELECTRICAL EQUIPMENT. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 20 EXISTING KNOX BOX. TO COORDINATE WITH FIRE MARSHAL FOR TYPE AND FINAL LOCATION.
- 21 SPANDREL PANEL. SEE SHEET DETAIL 5/A6.
- 22 EXISTING RESTROOM EXHAUST FAN CAP- REFER TO MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 23 INSTALL 4 - 1/2" - GALVANIZED STEEL ANCHOR EYE BOLTS. EPOXY SET INTO MASONRY WALL FOR FUTURE SIGN BANNER.
- 24 FUTURE SIGN BANNER
- 25 EXISTING GLAZING SYSTEM AND WINDOWS, CLEAN GLASS AND FRAMES PRIOR TO TURNOVER. PROVIDE WINDOW TREATMENT AT DRIVE-THRU WINDOWS
- 26 EXISTING H.C. PARKING SIGN ON WALL TO REMAIN.
- 27 NEW "NO PARKING/TOWING" SIGN.
- 28 EXISTING EXTERIOR ELECTRICAL OUTLET BOXES, SEE ELECTRICAL PLANS
- 29 EXISTING THRU-WALL "DIEBOLD" PASS-THRU DRAWER, TO BE REMOVED AND PROVIDE AND SECURE A METAL PLATE OVER THE OPENING, PAINT PLATE AND ALL EXISTING ITEMS UNDER THE CANOPY TO MATCH BRICK.
- 30 EXISTING COVERED ENTRY CEILING TO BE PAINTED, SEE FINISH SCHEDULE.
- 31 EX. WALL MOUNTED SIGN ILLUMINATED BOXES TO REMAIN. SIGN VENDOR TO PROVIDE NEW GRAPHICS AND NEW FINISHES AND ENSURE PROPER WORKING OF ELECTRICAL CIRCUITS. ALL SIGN INSTALLATION WORK BY SIGN VENDOR.
- 32 EXISTING SLOPED STANDING SEAM METAL ROOF. SEE GENERAL NOTE 5 BELOW.
- 33 EXISTING DOOR BUZZER TO REMAIN, G.C. TO ENSURE PROPER WORKING ORDER.
- 34 EXISTING BRICK SINGLE STACKED BAND.
- 35 EXISTING BRICK SOLDIER-COURSE BAND.
- 36 EXISTING SPANDREL PANEL.
- 37 EXISTING TRAFFIC SIGN TO REMAIN.
- 38 EXISTING CMU MEDALLION TO REMAIN.

GENERAL NOTES:

1. ALL EXTERIOR SIGNS ARE PROVIDED AND INSTALLED BY ADVANCE AUTO PARTS. ALL ELECTRICAL CONNECTIONS ARE BY ELECTRICAL CONTRACTOR. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
2. PROVIDE SEALANT AT ALL UNLIKE MATERIALS.
3. G.C. TO POWERWASH OUTSIDE OF ENTIRE BUILDING.
4. G.C. TO COORDINATE WITH CM FOR ANY CMU REPAIR.
5. G.C. TO PAINT ALL METAL ROOFING AND UNDERSIDE OF CANOPY AT DRIVE THRU TO MATCH EXISTING.

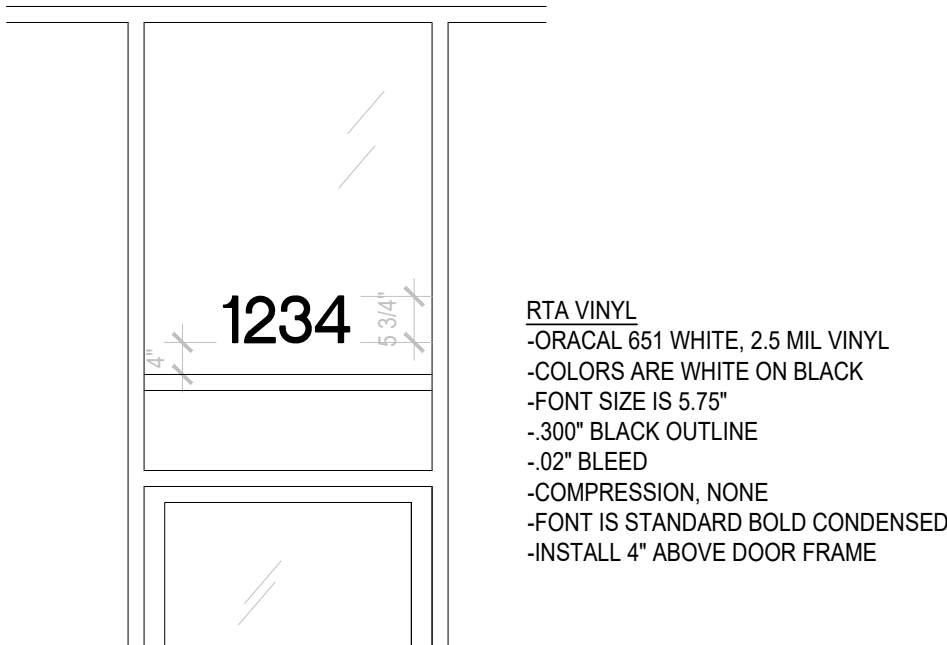

5 ADDRESS DETAIL
A6 SCALE: 1/2" = 1'-0"

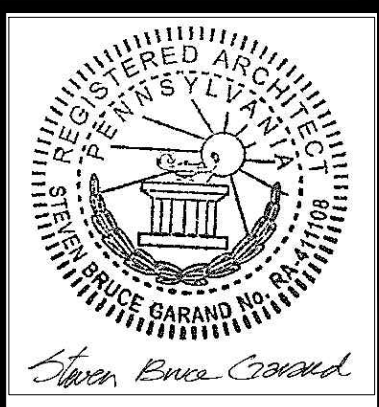

Advance Auto Parts
221 GROVE CITY RD,
SLIPPERY ROCK, PA 16057
STORE # TBD


REVISIONS		DESCRIPTION
REV	DATE	

DATE	GROSS SQ. FT.
6-18-26	11,261 S.F.
PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF


VERSION Q1-26 83x83
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY RESERVED.

EXTERIOR
ELEVATIONS

A6

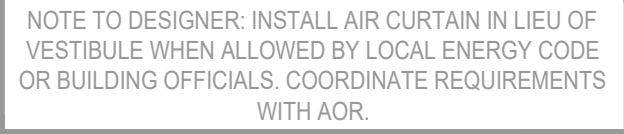


1. REFER TO THE INTERNATIONAL ENERGY CONSERVATION CODE CLIMATE ZONE MAP FOR NOTES 6 & 7 ABOVE

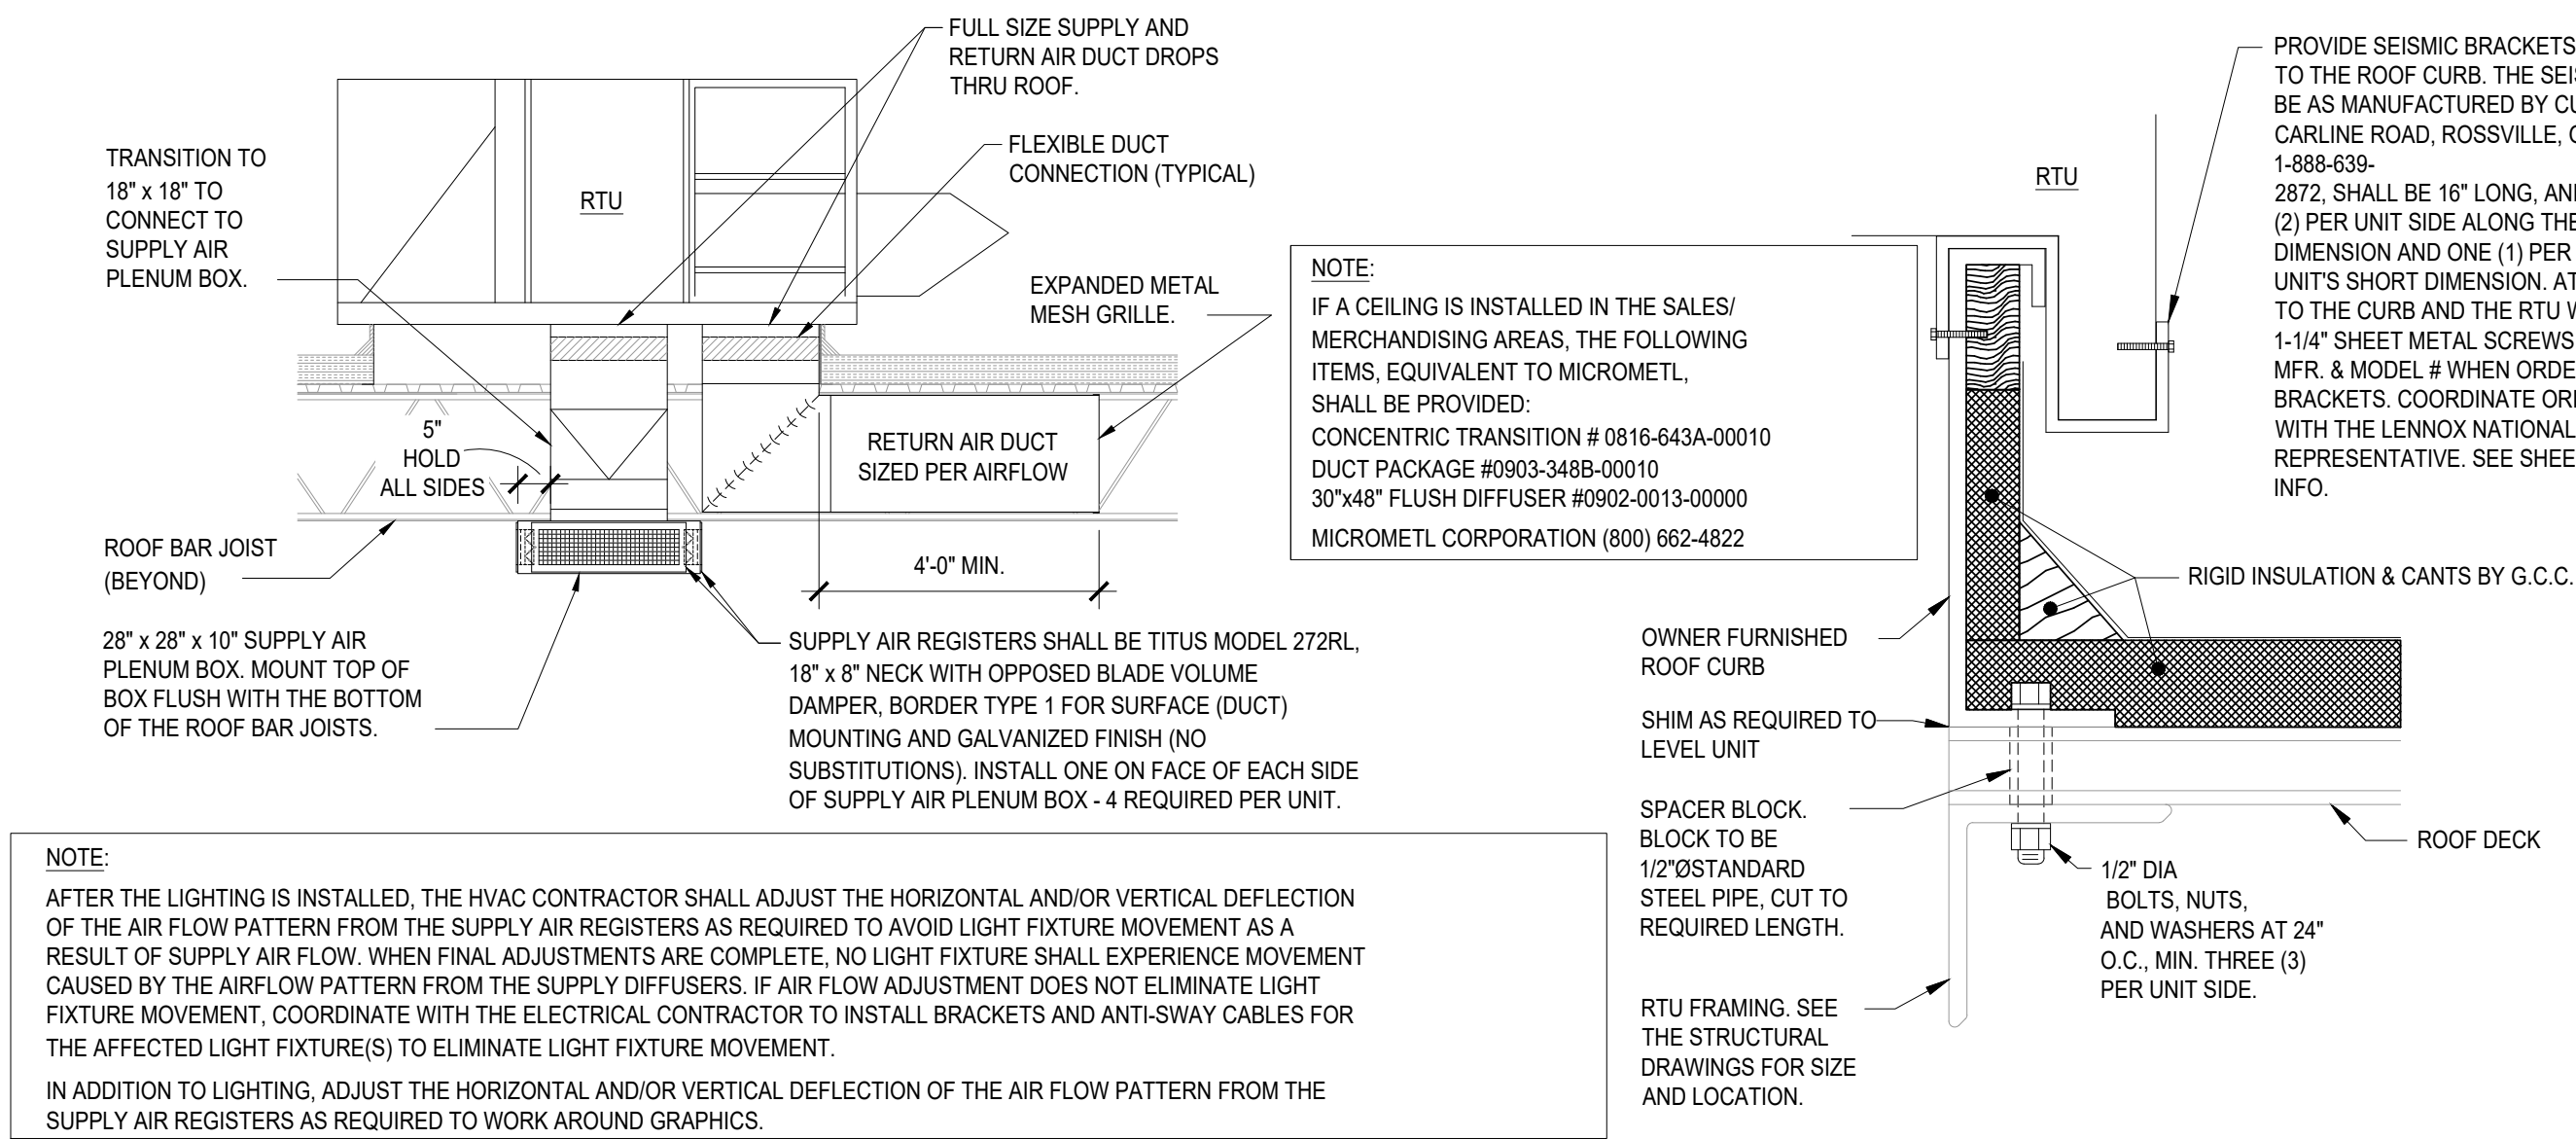

1 RTU DUCT INSTALLATION DETAIL
SCALE: NONE

2 RTU ANCHORING DETAIL
SCALE: NONE

ROOF TOP UNIT SCHEDULE		(COORDINATE ORDERING AND DELIVERY WITH THE LENNOX NATIONAL ACCOUNT REPRESENTATIVE. REFER TO SHEET T1 FOR CONTACT DATA.)																				
ZONE	MARK	LENNOX MODEL #	NOM TONS	SUPPLY FAN			VOLTS / PHASE	GAS HEATING MBH		INT. HTG. CAP. MBH @ 45 DEG. F AMBIENT	ELEC. RESISTANCE STRIP HEATER KW	COOLING DATA					MCA	MOCP	SEER2 / EER2 IEER / EER	WEIGHT (LBS.)*	ACCESSORIES / NOTES	
				HP	CFM	ESP		INPUT	OUTPUT			TOTAL	SENSIBLE	AMB.	DB	WB						
A	RTU-1	LGT060HSE	5.0	1.0	2,000	1.0	208 / 3	150.0	121.0	N/A	N/A	63.4	44.7	95	80	67	26	35	16.4 / 12.5	872	1,2,3,4,5,6,8,9,10,11	
A	RTU-2, 3	LGT120HSE	10.0	1.0	4,000	3.75	208 / 3	130.0	104.0	N/A	N/A	118.3	76.0	95	80	67	48	60	16.1 / 12.1	1366	1,2,3,4,5,6,7,8,9,10,11	
B	RTU-1, 4	LCH060HSE	5.0	1.0	1,700	0.6	208 / 3	150.0	120.0	N/A	N/A	61.0	43.0	95	80	67	33	45	12.7 / 11.1	863	1,2,3,4,5,6,8,9,10,11	
B	RTU-2, 3	LCH060HSE	5.0	1.0	1,700	0.6	208 / 3	150.0	120.0	N/A	N/A	61.0	43.0	95	80	67	33	45	12.7 / 11.1	863	1,2,3,4,5,6,7,8,9,10,11	
C	RTU-1, 4	KHB060HSE	5.0	1.0	1,725	0.6	208 / 3	N/A	N/A	N/A	N/A	59.6	42.4	95	80	67	51	60	12.5 / 10.0	1,009	1,2,3,4,5,6,8,10,11	
C	RTU-2, 3	KHB060HSE	5.0	1.0	1,725	0.6	208 / 3	N/A	N/A	N/A	N/A	59.6	42.4	95	80	67	51	60	12.5 / 10.0	1,009	1,2,3,4,5,6,7,8,10,11	
D	RTU-1, 4	LCH060HSE	5.0	1.0	1,725	0.6	208 / 3	N/A	N/A	N/A	N/A	61.2	43.4	95	80	67	35	45	12.7 / 11.1	808	1,2,3,4,5,6,8,10,11	
D	RTU-2, 3	LCH060HSE	5.0	1.0	1,725	0.6	208 / 3	N/A	N/A	N/A	N/A	61.2	43.4	95	80	67	33	45	12.7 / 11.1	808	1,2,3,4,5,6,7,8,10,11	
ACCESSORIES / NOTES:																						
1. FACTORY INSTALLED ECONOMIZER.												MCA - MINIMUM CIRCUIT AMPS										
2. FACTORY INSTALLED BAROMETRIC RELIEF.												MOCP - MAXIMUM OVERCURRENT PROTECTION										
3. FACTORY INSTALLED POWER DISCONNECT SWITCH.												* - APPROX. WEIGHT INCLUDES ACCESSORIES (CURB, ECONOMIZER, ETC.)										
4. FACTORY INSTALLED NON-POWERED CONVENIENCE OUTLET. ELECTRICAL CONTRACTOR TO PROVIDE POWER TO OUTLET.																						
5. FACTORY INSTALLED RETURN AIR SMOKE DETECTOR. (VERIFY LOCAL CODE REQUIREMENTS WHETHER SMOKE DETECTOR IS IN THE SUPPLY OR RETURN AIR DUCT.) (ADD ONLY IF NOT REQUIRED BY LOCAL CODE.)																						
6. MANUFACTURER'S STANDARD 14" HIGH ROOF CURB SHIPPED WITH THE UNIT AND FIELD INSTALLED.																						
7. MANUFACTURER'S CO2 DEMAND-CONTROLLED VENTILATION WALL SENSOR SHIPPED WITH THE UNIT. FURNISH TO THE ELECTRICAL CONTRACTOR FOR INSTALLATION.																						
8. FACTORY SUPPLIED SMOKE DETECTOR.																						
9. MANUFACTURER'S GAS PIPING KIT SHIPPED WITH THE UNIT AND FIELD INSTALLED.																						
10. PROVIDE FACTORY INSTALLED THROUGH-THE-BASE CONDENSATE DRAIN CONNECTION WITH P-TRAP. IF ALLOWED BY CODE, PROVIDE AND INSTALL 1-1/4" CONDENSATE DRAIN LINE W/4" DEEP (MIN.) P-TRAP AND ROUTE TO NEAREST ROOF DRAIN OR ROOF SCUPPER/GUTTER SYSTEM AT REAR OF STORE.																						
11. FIELD SUPPLIED AND INSTALLED 2" PLEATED THROWAWAY FILTERS.																						

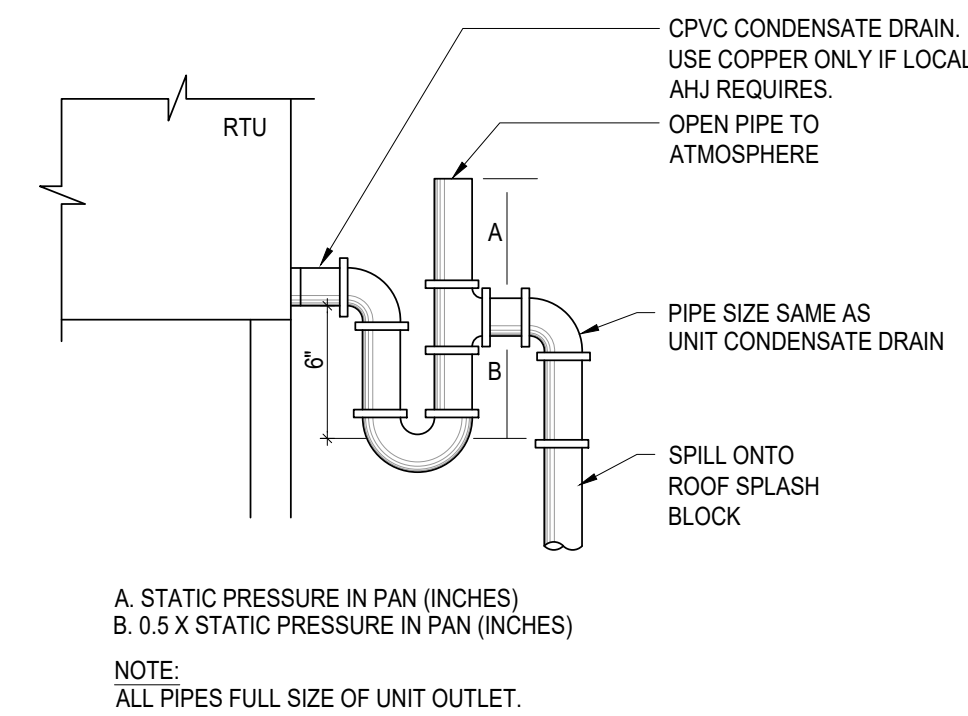

3 RTU CONDENSATE DETAIL
SCALE: NONE

OUTSIDE AIR CALCULATIONS	
(BASED ON 2012 INTERNATIONAL MECHANICAL CODE)	
OUTSIDE AIR REQUIRED	
A. BUILDING AREA:	
SALES, MERCHANDISE & TOILET AREAS:	11,287 S.F.
TOTAL FLOOR AREA (NET):	11,287 S.F.
B. OUTSIDE AIR REQUIRED:	
PEOPLE LOAD:	
15 PEOPLE / 1,000 SQ FT = 15 * 11,287 = 169 PEOPLE	
11,287 SQ FT * 0.12 CFM / SQ FT	1,354 CFM
169 PEOPLE * 7.5 CFM / PERSON	1,267 CFM
TOTAL OUTSIDE AIR CFM REQUIRED:	2,621 CFM
OUTSIDE AIR PROVIDED	
RTU-1	= 550 CFM
RTU-2 (CO2 SENSOR)	= 1,040 CFM
RTU-3 (CO2 SENSOR)	= 1,040 CFM
TOTAL O.A. PROVIDED	= 2,630 CFM

GAS LOAD CALCULATIONS	
EQUIPMENT:	LOAD:
RTU-1	150.0
RTU-2	130.0
RTU-3	130.0
TOTALS:	410.0 MBH

LENNOX / CARRIER RTU EQUIPMENT NOTES

FOR COMPLETE INFORMATION/PRICING ON THE RTU EQUIPMENT PACKAGE, CONTACT THE ADVANCE AUTO PARTS ACCOUNT REPRESENTATIVE AT LENNOX/CARRIER NATIONAL ACCOUNTS. REFER TO SHEET T1 FOR CONTACT DATA.

ANY CHANGES/VARIATIONS TO THE ORIGINAL RTU EQUIPMENT PACKAGE SHOULD BE BROUGHT TO THE ATTENTION OF THE ACCOUNT REPRESENTATIVE AT LENNOX/CARRIER NATIONAL ACCOUNTS AT THE TIME OF QUOTATION.

THE RTU EQUIPMENT PACKAGE MUST BE ORDERED FROM LENNOX/CARRIER NATIONAL ACCOUNTS. NO SUBSTITUTIONS WILL BE ALLOWED.

NOTE: ORDERING PROCEDURES THE SUCCESSFUL HVAC CONTRACTOR SHALL PLACE THE ORDER FOR THE RTU EQUIPMENT PACKAGE DIRECTLY WITH THE LENNOX/CARRIER NATIONAL ACCOUNT REPRESENTATIVE. THE HVAC CONTRACTOR WILL BE RESPONSIBLE FOR THE EQUIPMENT WARRANTY, DELIVERY COORDINATION, RECEIVING AND INSTALLATION.

MECHANICAL SYMBOLS AND ABBREVIATIONS LEGEND

A.F.F.	ABOVE FINISHED FLOOR	---G---G---	GAS PIPING OF SIZE NOTED		AIR DEVICE TYPE		AIR DEVICE DESIGNATION
AMB.	AMBIENT TEMPERATURE	---D---D---	CONDENSATE DRAIN PIPING OF SIZE NOTED		EQUIPMENT TYPE		EQUIPMENT DESIGNATION
BHP	BRAKE HORSEPOWER	---U---U---	UNION		EQUIPMENT MARK		
BTUH	BRITISH THERMAL UNITS PER HOUR		DUCT MOUNTED SMOKE DETECTOR				
CL, °C	CENTERLINE		SUPPLY AIR DIFFUSER				
CO2	CARBON DIOXIDE		RETURN OR EXHAUST GRILLE				
CONTR.	CONTRACTOR		VOLUME DAMPER (VD)				
CFM	CUBIC FEET PER MINUTE		THERMOSTAT				
DB	DRY BULB TEMPERATURE		CARBON DIOXIDE SENSOR				
DIA.	DIAMETER		PIPE RISER				
DN.	DOWN		PIPE DROP				
E.A.	EXHAUST AIR		SHUT OFF VALVE				
EF	EXHAUST FAN		CHECK VALVE				
ESP	EXTERNAL STATIC PRESSURE						
EXH	EXHAUST						
FIN. FL.	FINISHED FLOOR						
FLA	FULL LOAD AMPERES						
HP	HORSEPOWER						
MBH	ONE THOUSAND (1000) BTUH						
MFR.	MANUFACTURER						
N.J.C.	NOT IN CONTRACT						
NOM.	NOMINAL						
N.T.S.	NOT TO SCALE						
O.A.	OUTSIDE AIR						
OAI	OUTSIDE AIR INTAKE						
QBD	OPPOSED BLADE DAMPER						
R.A.	RETURN AIR						
RPM	REVOLUTIONS PER MINUTE						
RTU	ROOF TOP UNIT						
S.F.	SQUARE FEET						
S.P.	STATIC PRESSURE						
TSP	TOTAL STATIC PRESSURE						
TYP	TYPICAL						
UH	UNIT HEATER						
WB	WET BULB TEMPERATURE						
W.C.	WATER COLUMN						


NOTE: THIS LEGEND IS FOR REFERENCE ONLY. NOT ALL SYMBOLS AND ABBREVIATIONS WILL BE USED. NOT ALL SYMBOLS AND ABBREVIATIONS USED ARE INCLUDED IN LEGEND. IF QUESTIONS ARISE DUE TO THE USE OF ANY SYMBOL OR ABBREVIATION THE CONTRACTOR SHALL CONTACT THE PROJECT ENGINEER IMMEDIATELY FOR DEFINITION(S) AND/OR CLARIFICATION(S).

REV	DATE	DESCRIPTION
1	6-10-26	11,287 S.F.

DATE: 6-10-26
GROSS SQ. FT.: 11,287 S.F.


PROJECT # 330
DRAWN BY: XXXX
CHECK BY: XXXX

VERSION Q1-26 83x83
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.


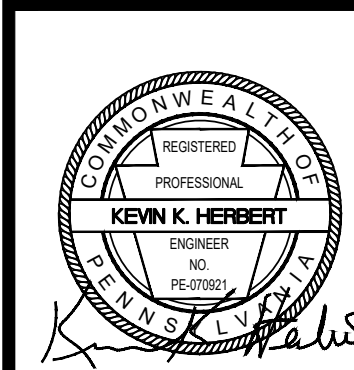


HVAC SCHEDULES AND DETAILS


M2

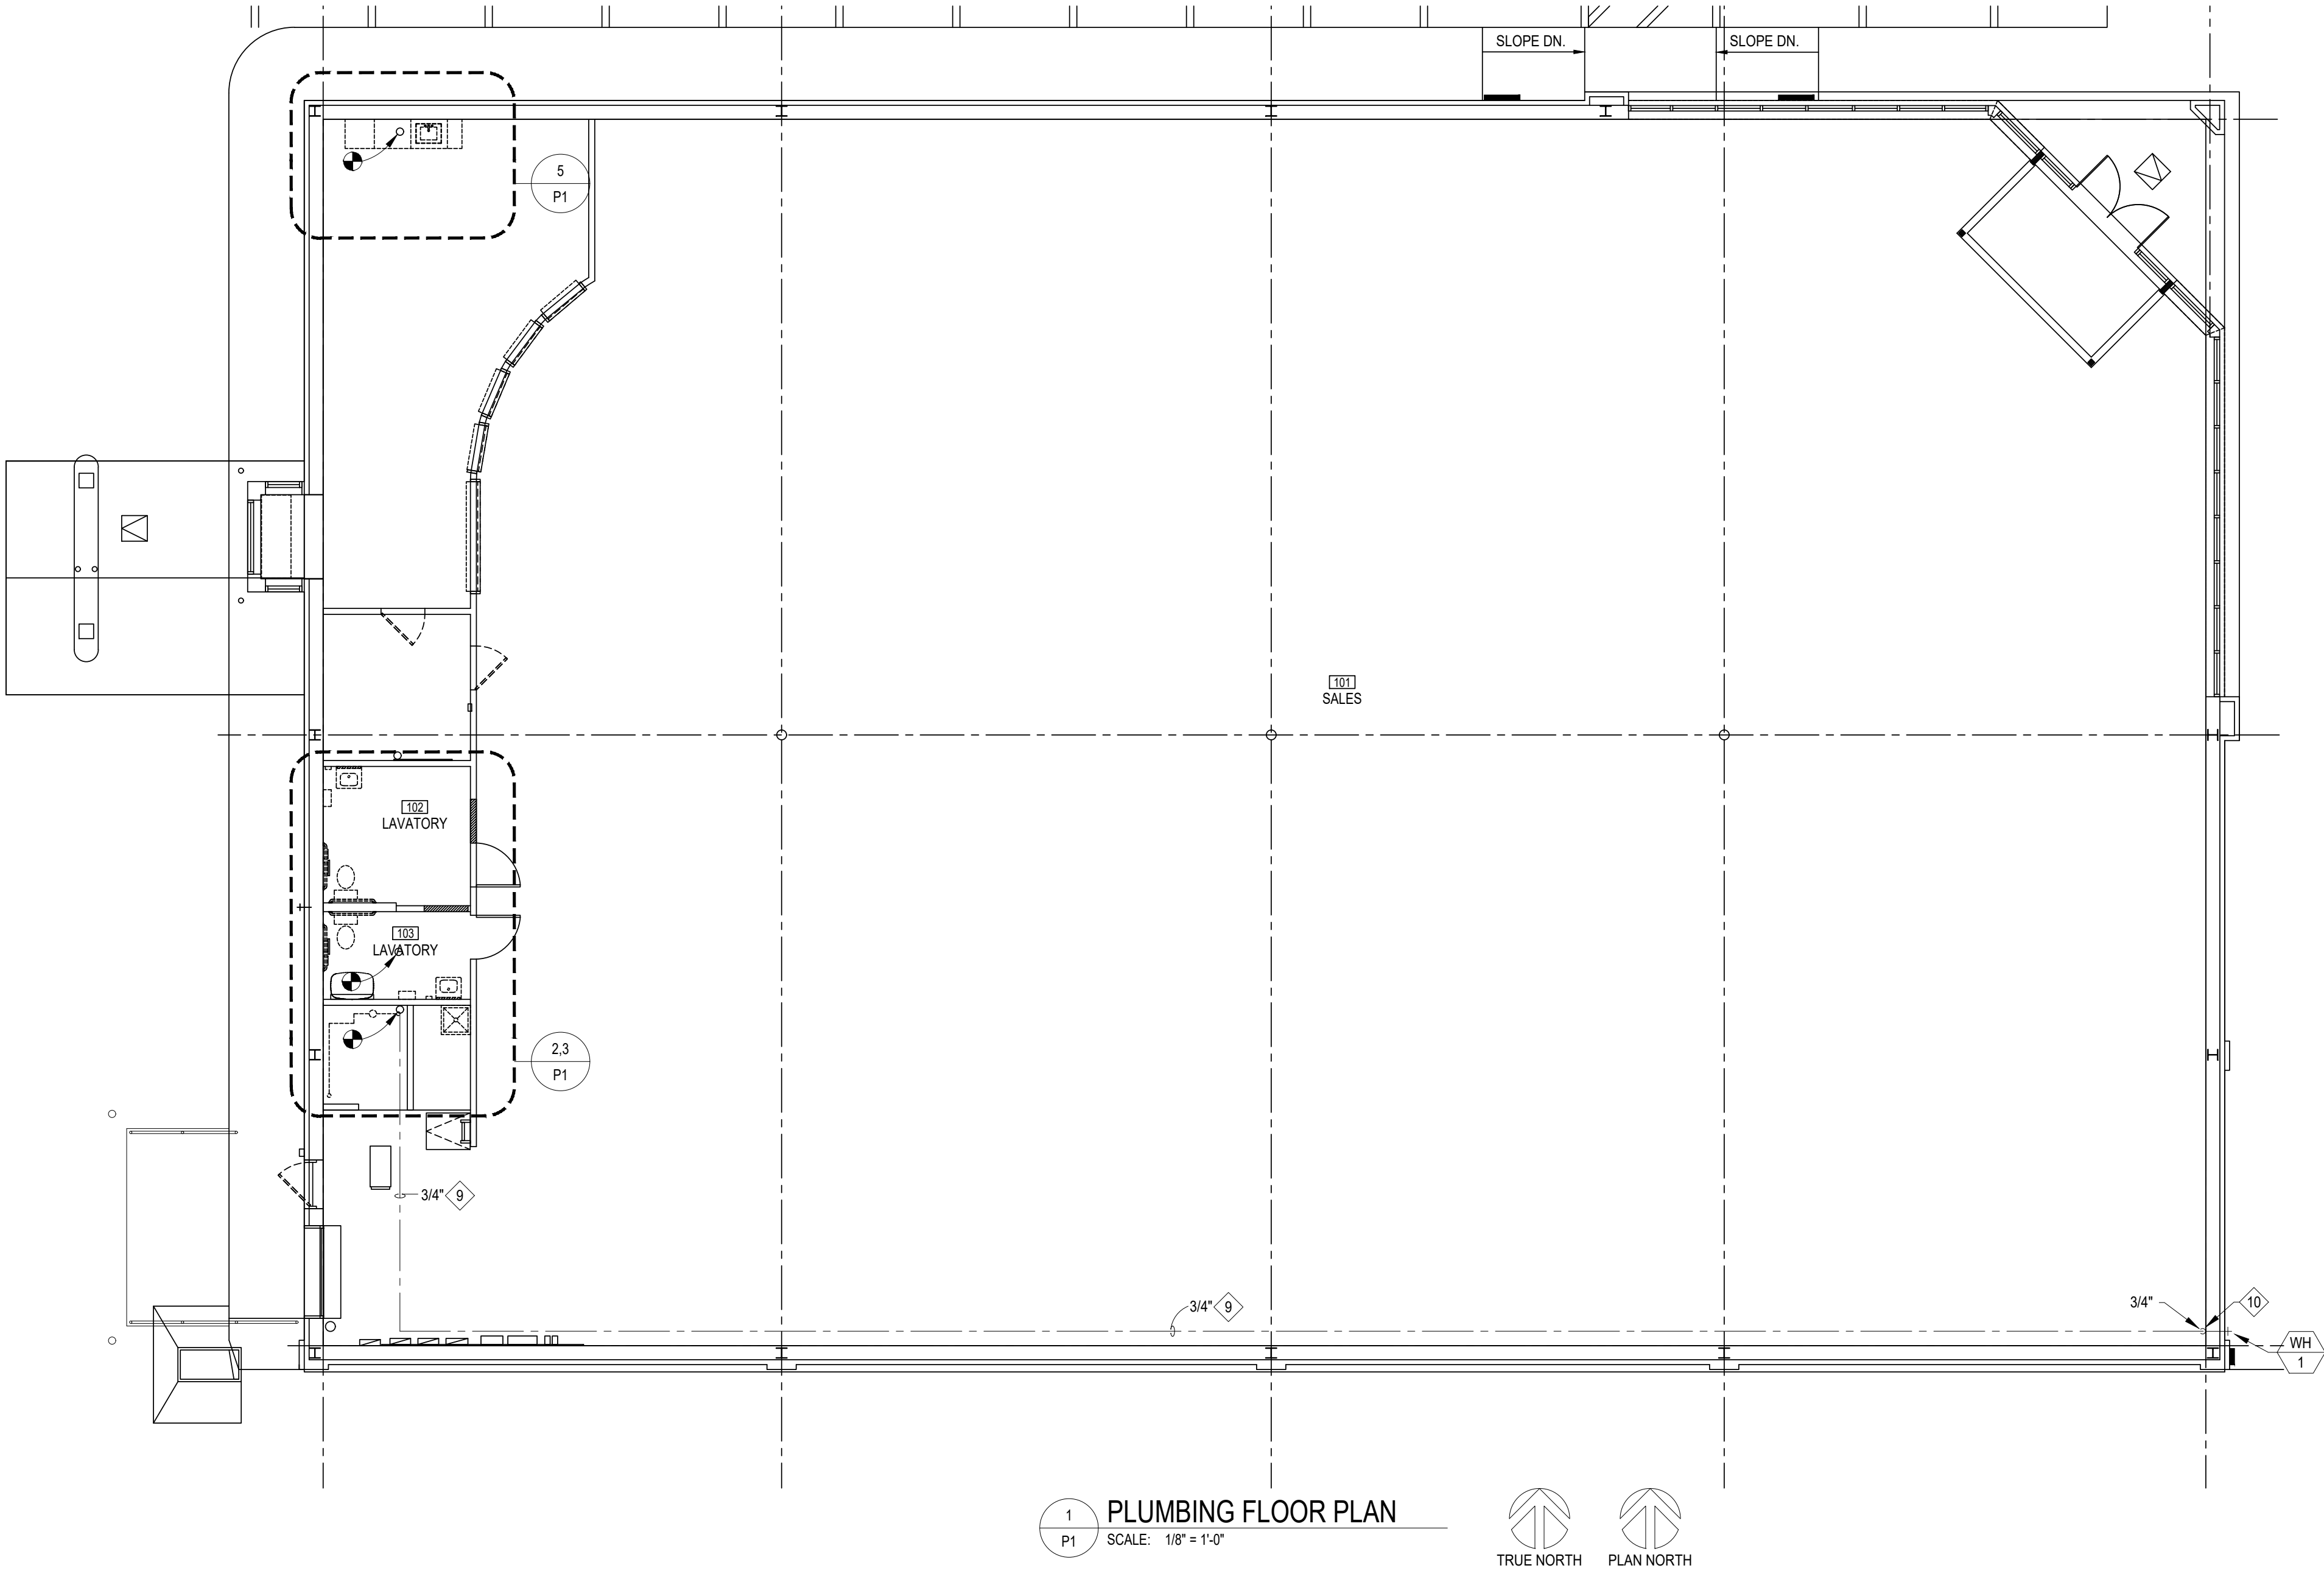


1 PLUMBING FLOOR PLAN
P1 SCALE: 1/8" = 1'-0"

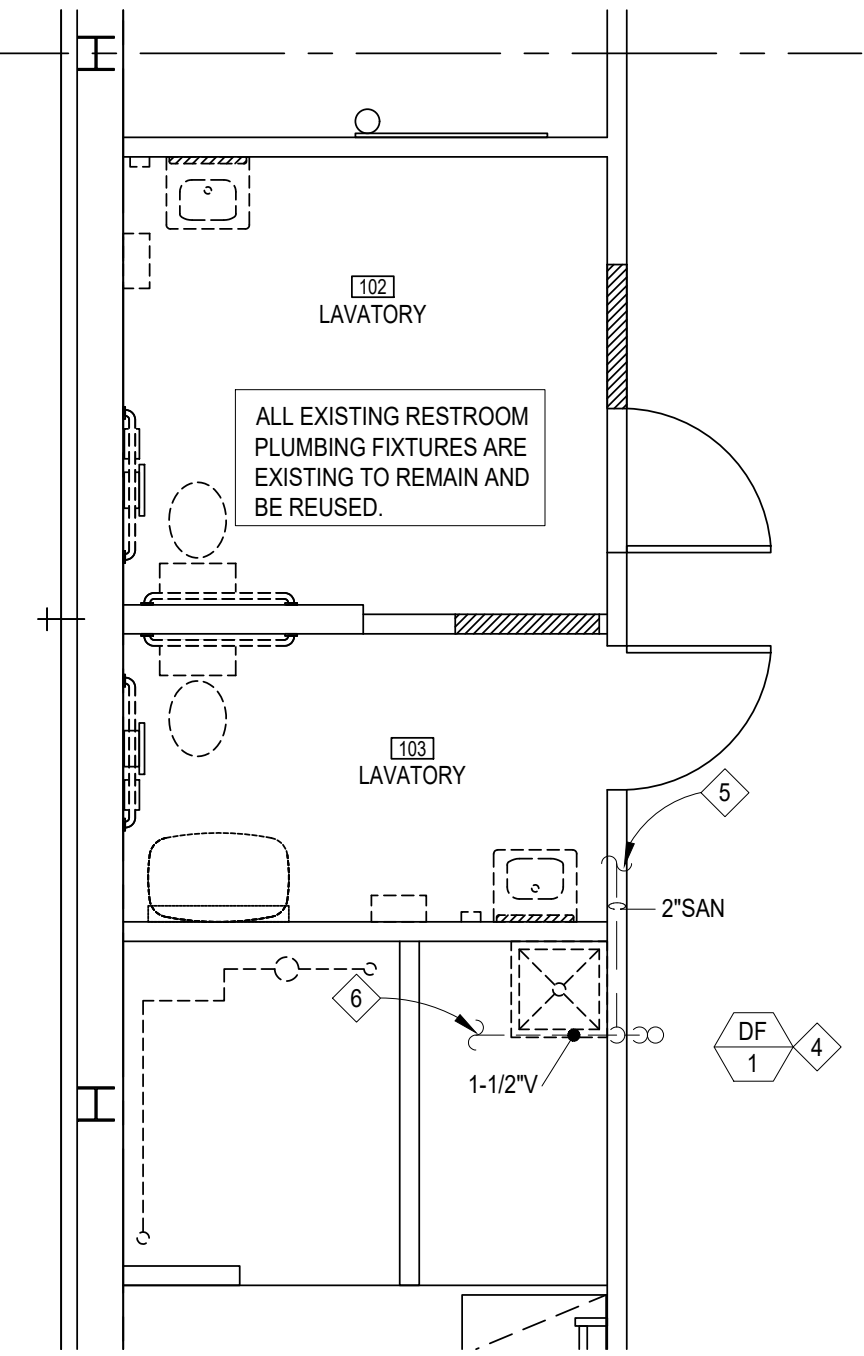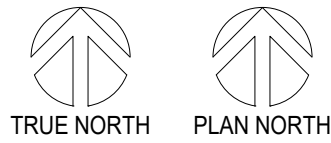

2 ENLARGED WASTE & VENT PIPING PLAN
P1 SCALE: 1/4" = 1'-0"

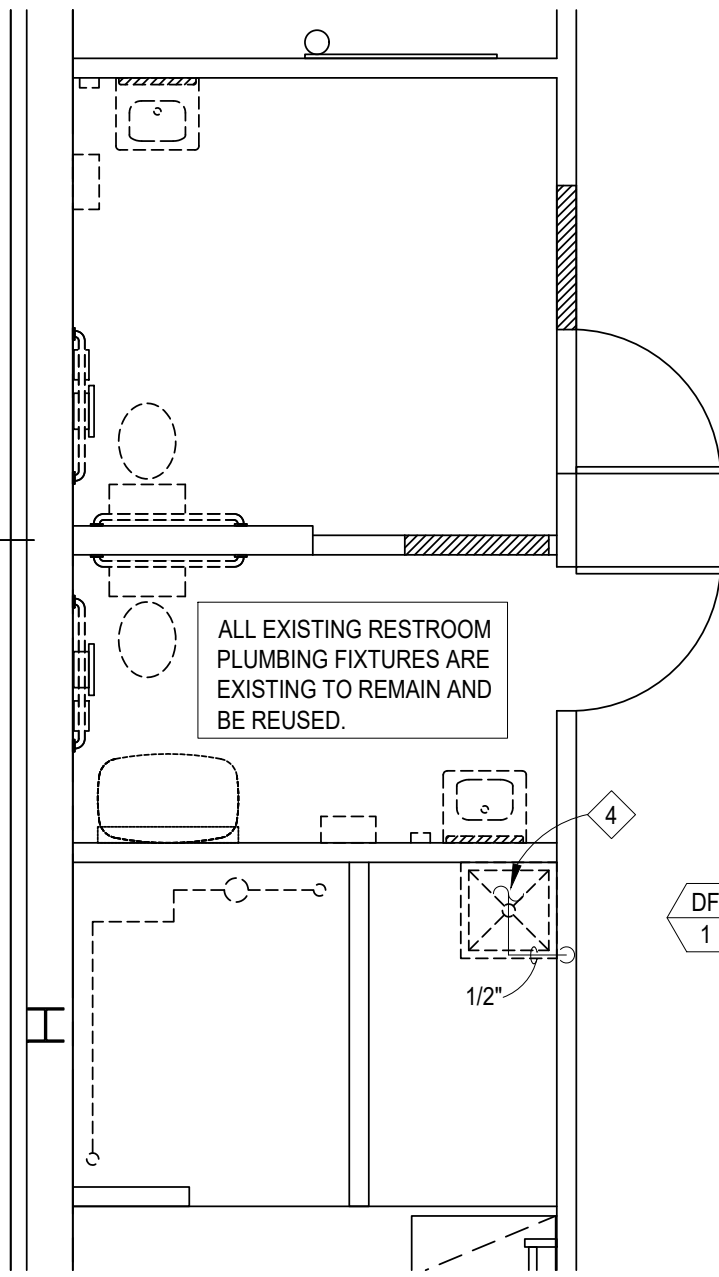


3 ENLARGED WATER PIPING PLAN
P1 SCALE: 1/4" = 1'-0"

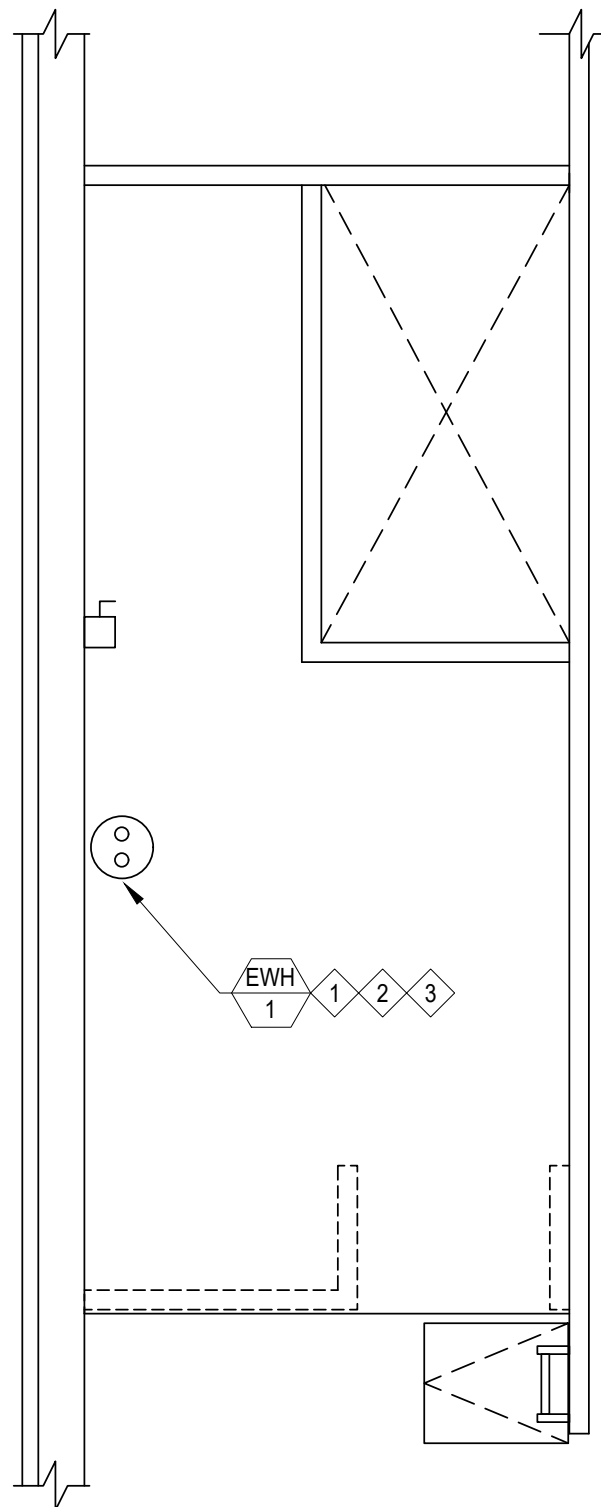

4 ENLARGED WATER MEZZANINE PIPING PLAN
P1 SCALE: 1/4" = 1'-0"

PLUMBING GENERAL NOTES:

- PRIOR TO SUBMITTING A BID, THIS CONTRACTOR AND HIS SUBCONTRACTORS SHALL VISIT THE JOB SITE AND FULLY ACQUAINT THEMSELVES WITH THE EXISTING CONDITIONS OF THE PROJECT. THIS CONTRACTOR AND HIS SUBCONTRACTORS SHALL BE RESPONSIBLE FOR REVIEW OF GENERAL NOTES, SPECIFICATIONS AND ALL OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ADVANCE AUTO PARTS (AAP) OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- THE INSTALLATION SHALL COMPLY WITH, AND BE INSTALLED IN ACCORDANCE WITH ALL LEGALLY CONSTITUTED AUTHORITIES AND CODES HAVING JURISDICTION.
- DRAWINGS AND SPECIFICATIONS GOVERN WHERE THEY EXCEED CODE REQUIREMENTS.
- THE CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF EXISTING UTILITIES AT THE POINTS OF CONNECTION OF NEW SERVICES BEFORE THE START OF CONSTRUCTION. COORDINATE ALL PIPING WITH BUILDING FOOTINGS, STRUCTURE, FOUNDATIONS, UNDERGROUND UTILITIES BY OTHER TRADES, ETC.
- REFER TO THE ARCHITECTURAL DRAWINGS FOR THE EXACT LOCATION AND MOUNTING HEIGHT OF PLUMBING FIXTURES. PLUMBING FIXTURE LOCATION DIMENSIONS INDICATED ON THE ARCHITECTURAL PLANS OR AS REQUIRED TO COMPLY WITH APPLICABLE ACCESSIBILITY STANDARDS SHALL BE HELD. VERIFY ALL INSTALLATION DIMENSIONS PRIOR TO PIPING OR FIXTURE ROUGH-IN.
- PROVIDE SHUT OFF VALVES AT ALL PLUMBING FIXTURE WATER SUPPLY CONNECTIONS. VALVES SHALL BE LINE SIZE UNLESS OTHERWISE NOTED AND SHALL BE QUARTER-TURN BALL VALVES (NO EXCEPTIONS). REFER TO THE SPECIFICATIONS FOR CLARIFICATION.
- UNLESS OTHERWISE NOTED, ALL PIPING IN FINISHED AREAS SHALL BE RUN CONCEALED. EXPOSED PIPING, WHERE NECESSARY, SHALL BE RUN AS HIGH AS POSSIBLE AND TIGHT TO WALLS. DO NOT INSTALL DOMESTIC WATER PIPING IN EXTERIOR WALLS.
- INSULATE HOT AND COLD WATER PIPING PER THE PLUMBING SPECIFICATIONS ON SHEET MP1. PROVIDE PIPE AND VALVE COVERINGS EQUAL TO TRUEBRO "LAV GUARD" ON ALL EXPOSED PIPING UNDER THE LAVATORIES AND WATER CLOSETS.
- PROVIDE ACCESS PANELS WITH CHROME PLATED COVERS FOR ALL CONCEALED VALVES.
- THE PLUMBING SYSTEM LAYOUT SHALL BE IN CAREFUL COORDINATION WITH THE DRAWINGS, DETERMINING PROPER ELEVATION FOR ALL COMPONENTS OF THE SYSTEM. THE GENERAL LAYOUT SHALL BE FOLLOWED AS SHOWN ON THE DRAWINGS IN ALL CASES, EXCEPT WHERE OTHER DISCIPLINES MAY INTERFERE.
- CAP ALL PIPING OPENINGS DURING CONSTRUCTION UNTIL FINAL CONNECTIONS TO EQUIPMENT AND ACCESSORIES ARE MADE.
- UNLESS OTHERWISE NOTED, SANITARY SEWER PIPING 3" AND SMALLER SHALL BE SLOPED AT 1/4" PER FOOT AND SANITARY SEWER PIPING 4" AND LARGER SHALL BE SLOPED AT 1/8" PER FOOT IN THE DIRECTION OF FLOW.
- PROVIDE TRAP PRIMER VALVES WHERE REQUIRED BY LOCAL BUILDING CODES. PROVIDE 1/2" COPPER TRAP PRIMER PIPING WITH NO JOINTS UNDER THE FLOOR SLAB TO CONNECT TO THE FLOOR DRAIN P-TRAP. PROVIDE ONE SUPPLY PIPE PER FLOOR DRAIN ROUTED DIRECTLY FROM THE TRAP PRIMER VALVE OR ASSOCIATED DISTRIBUTION UNIT. SLOPE TRAP PRIMER SUPPLY PIPING BELOW THE FLOOR AT 1% MINIMUM IN THE DIRECTION OF FLOW. PROVIDE A 12" x 12" ACCESS PANEL IN THE TOILET ROOM WALL.
- ALL WORK SHALL BE COORDINATED WITH THE OTHER TRADES TO AVOID INTERFERENCE WITH THE PROGRESS OF CONSTRUCTION.
- ALL WORK SHALL BE PERFORMED BY A LICENSED PLUMBING CONTRACTOR IN A FIRST CLASS WORKMANLIKE MANNER. THE COMPLETED SYSTEMS SHALL BE FULLY OPERATIVE AND CODE COMPLIANT.
- CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS, INSPECTIONS, TESTS, AND ASSOCIATED FEES.
- THIS CONTRACTOR SHALL GUARANTEE ALL MATERIALS AND WORKMANSHIP FREE FROM DEFECTS FOR A PERIOD OF NOT LESS THAN ONE (1) YEAR FROM DATE OF ACCEPTANCE. CORRECTION OF ANY DEFECTS SHALL BE COMPLETED WITHOUT ADDITIONAL CHARGE AND SHALL INCLUDE REPLACEMENT OR REPAIR OF ANY OTHER PHASE OF THE INSTALLATION WHICH MAY HAVE BEEN DAMAGED.
- PROVIDE FLOOR DRAINS NEAR ALL BACKFLOW VALVES IN PREMISES FOR RELIEF DRAINAGE. IF POSSIBLE LOCATE ASSEMBLY NEAR MOP BASIN, AND DISCHARGE INTO FIXTURE.

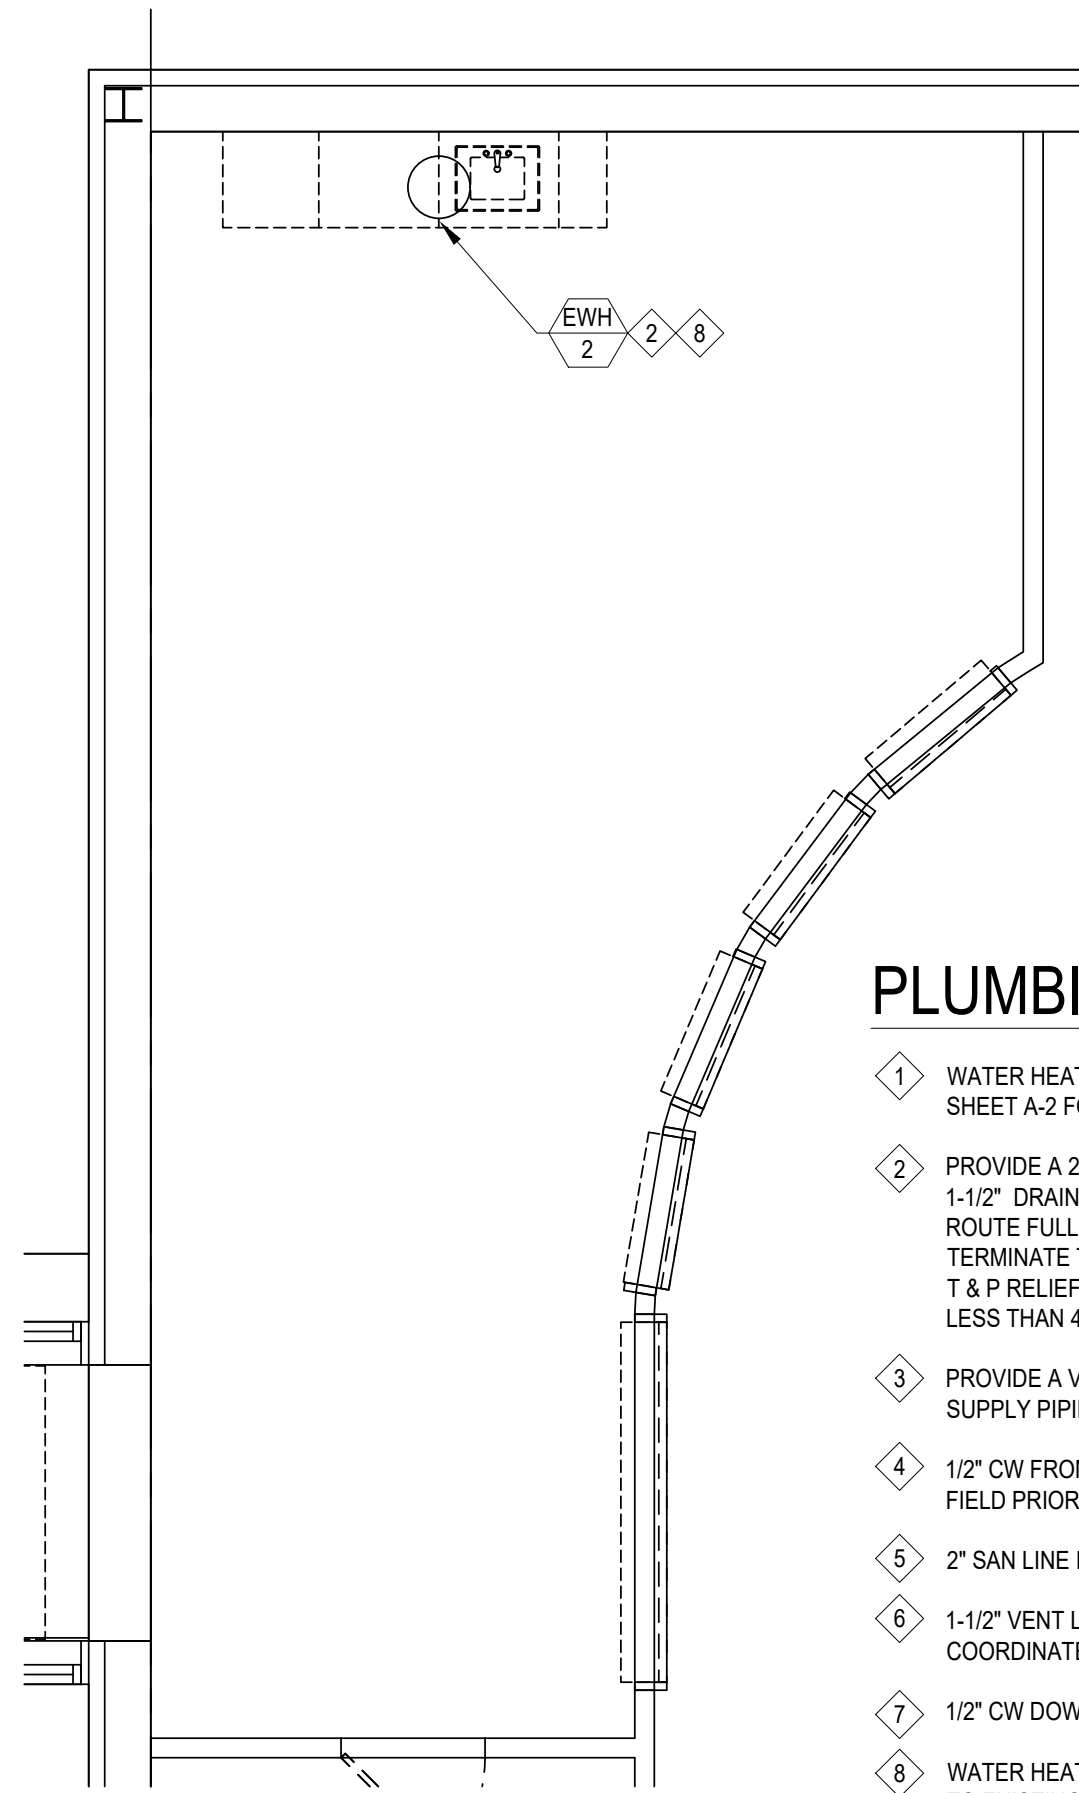

5 ENLARGED WATER PHARMACY PIPING PLAN
P1 SCALE: 1/4" = 1'-0"


PLUMBING PLAN KEY NOTES:

- WATER HEATER (EWH-1) TO BE MOUNTED ON METAL SHELF ABOVE MOP SINK BY GC. SEE ARCHITECTURAL SHEET A-2 FOR MORE INFORMATION. PC TO RECONNECT TO EXISTING HOT AND COLD WATER LINES.
- PROVIDE A 2" DEEP GALVANIZED WATERPROOF SAFE PAN UNDER THE WATER HEATER WITH A 1-1/2" DRAIN LINE TO THE MOP SINK. TERMINATE THE DRAIN LINE WITH A MIN. 3" AIR GAP. ROUTE FULL SIZE T & P RELIEF LINE WITHOUT TRAP TO DISCHARGE INTO THE MOP SINK. TERMINATE THE T & P RELIEF PIPING WITH THE APPROPRIATE AIR GAP. DRAIN LINE AND T & P RELIEF PIPING SHOULD BE CONCEALED IN THE TOILET ROOM WALL AND DISCHARGED LESS THAN 4" ABOVE THE MOP SINK BASIN.
- PROVIDE A VACUUM RELIEF VALVE EQUAL TO WATTS MODEL LFN36 AT THE HIGH POINT OF THE WATER HEATER SUPPLY PIPING.
- 1/2" CW FROM DF TO BE ROUTED AND CONNECTED TO A MINIMUM 3/4" CW LINE. COORDINATE ROUTING IN FIELD PRIOR TO THE START OF CONSTRUCTION.
- 2" SAN LINE IN WALL TO BE ROUTED TO EXISTING SANITARY LINE OF SAME OR LARGER SIZE.
- 1-1/2" VENT LINE UP IN CEILING SPACE. PC TO CONNECT TO A MINIMUM 1-1/2" EXISTING VENT LINE. COORDINATE ROUTING IN FIELD PRIOR TO THE START OF CONSTRUCTION.
- 1/2" CW DOWN IN WALL TO DRINKING FOUNTAIN.
- WATER HEATER (EWH-2) TO BE INSTALLED UNDER SINK AS A ONE FOR ONE REPLACEMENT. PC TO RECONNECT TO EXISTING HOT AND COLD WATER LINES.
- ROUTE PIPING AS HIGH AS POSSIBLE ABOVE THE BOTTOM CHORD OF THE ROOF BAR JOISTS WITH ALLOWANCE FOR SLOPE AS REQUIRED. INSULATE PIPING PER THE PLUMBING SPECIFICATIONS ON SHEET MP1.
- MOUNT THE WALL HYDRANT AT 24" ABOVE FIN. GRADE. PROVIDE SILICONE SEALANT ALL AROUND THE WALL HYDRANT BOX TO PROVIDE A WATERTIGHT WALL PENETRATION.

REV	DATE	DESCRIPTION

DATE	GROSS SQ. FT.
6-10-26	11,287 S.F.
PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF
VERSION Q1-26 83x83	


ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

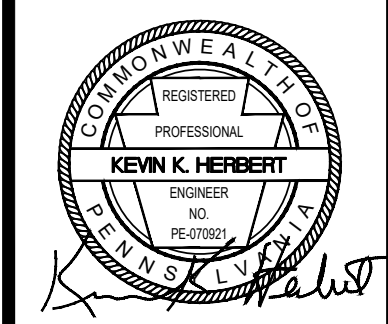


PLUMBING
FLOOR PLANS

P1

1. WATER HEATER (EWH-1) TO BE MOUNTED ON METAL SHELF ABOVE MOP SINK BY GC. SEE ARCHITECTURAL SHEET A-2 FOR MORE INFORMATION. PC TO RECONNECT TO EXISTING HOT AND COLD WATER LINES.
2. PROVIDE A 2" DEEP GALVANIZED WATERPROOF SAFE PAN UNDER THE WATER HEATER WITH A 1-1/2" DRAIN LINE TO THE MOP SINK. TERMINATE THE DRAIN LINE WITH A MIN. 3" AIR GAP. ROUTE FULL SIZE T & P RELIEF LINE WITHOUT TRAP TO DISCHARGE INTO THE MOP SINK. TERMINATE THE T & P RELIEF PIPING WITH THE APPROPRIATE AIR GAP. DRAIN LINE AND T & P RELIEF PIPING SHOULD BE CONCEALED IN THE TOILET ROOM WALL AND DISCHARGED LESS THAN 4" ABOVE THE MOP SINK BASIN.
3. PROVIDE A VACUUM RELIEF VALVE EQUAL TO WATTS MODEL LFN36 AT THE HIGH POINT OF THE WATER HEATER SUPPLY PIPING.
4. 1/2" CW FROM DF TO BE ROUTED AND CONNECTED TO A MINIMUM 3/4" CW LINE. COORDINATE ROUTING IN FIELD PRIOR TO THE START OF CONSTRUCTION.
5. 2" SAN LINE IN WALL TO BE ROUTED TO EXISTING SANITARY LINE OF SAME OR LARGER SIZE.
6. 1-1/2" VENT LINE UP IN CEILING SPACE. PC TO CONNECT TO A MINIMUM 1-1/2" EXISTING VENT LINE. COORDINATE ROUTING IN FIELD PRIOR TO THE START OF CONSTRUCTION.
7. 1/2" CW DOWN IN WALL TO DRINKING FOUNTAIN.
8. WATER HEATER (EWH-2) TO BE INSTALLED UNDER SINK AS A ONE FOR ONE REPLACEMENT. PC TO RECONNECT TO EXISTING HOT AND COLD WATER LINES.
9. ROUTE PIPING AS HIGH AS POSSIBLE ABOVE THE BOTTOM CHORD OF THE ROOF RAR JOISTS WITH ALLOWANCE FOR SLOPE AS REQUIRED. INSULATE PIPING PER THE PLUMBING SPECIFICATIONS ON SHEET MP1.
10. MOUNT THE WALL HYDRANT AT 24" ABOVE FIN. GRADE. PROVIDE SILICONE SEALANT ALL AROUND THE WALL HYDRANT BOX TO PROVIDE A WATERTIGHT WALL PENETRATION.

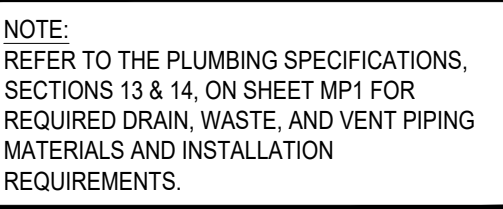

PLUMBING FIXTURE SCHEDULE		REFER TO THE RESPONSIBILITY MATRIX ON SHEET T1 FOR NATIONAL ACCOUNT CONTACT DATA. (NO SUBSTITUTIONS)
MARK	DESCRIPTION	
DF 1	OASIS - MODEL PCA3CL - WALL MOUNTED 3/4" LEVEL DRINKING FOUNTAIN WITH SELF-CLOSING FRONT AND SIDE PUSHBAR ACTUATORS, FLEXIBLE BUBBLER GUARD, EXTERNAL STREIGHT HEIGHT ADJUSTMENT, STAINLESS STEEL TOP, LEAD-FREE WATERWAY AND CANE AROUND. INSTALL PER MFRS. RECOMMENDATIONS AND IN ACCORDANCE WITH ALL APPLICABLE ACCESSIBILITY STANDARDS.	
EW1 1	BRADFORD WHITE - MODEL LE-16U3-1 - ELECTRIC WATER HEATER WITH 6 GALLON CAPACITY, GLASS-LINED TANK WITH 150 PSI WORKING PRESSURE, 2 KW ZINC PLATED COPPER SHEATH IMMERSION TYPE ELEMENT, FACTORY INSTALLED DRAIN VALVE AND FACTORY INSTALLED ANODE ROD, OPERATING AT 120V, SINGLE PHASE. PROVIDE FIELD INSTALLED WATTS MODEL 100XL TEMPERATURE / PRESSURE RELIEF VALVE PIPED TO DISCHARGE AS NOTED ON THE PLANS AND IN ACCORDANCE WITH ALL APPLICABLE CODES. SET WATER HEATER TEMPERATURE CONTROL AT 125 DEGS. F.	
EW2 2	AMERICAN STANDARD - MODEL CE-2.5-A-01P USE ELECTRIC WATER HEATER WITH 2.5 GALLON CAPACITY, GLASS-LINED TANK WITH 150 PSI WORKING PRESSURE, 1.5 KW ZINC PLATED COPPER SHEATH IMMERSION TYPE ELEMENT, FACTORY INSTALLED DRAIN VALVE AND FACTORY INSTALLED ANODE ROD. OPERATING AT 120V, SINGLE PHASE. PROVIDE FIELD INSTALLED WATTS MODEL 100XL TEMPERATURE / PRESSURE RELIEF VALVE PIPED TO DISCHARGE AS NOTED ON THE PLANS AND IN ACCORDANCE WITH ALL APPLICABLE CODES. SET WATER HEATER TEMPERATURE CONTROL AT 125 DEGS. F.	
ET 1	MITROL - MODEL THERM-TROL ST-5 THERMAL EXPANSION TANK WITH FACTORY PRE-CHARGE, POLY-PROPYLENE LINER, 150 PSI MAXIMUM WORKING PRESSURE, 200 DEG. F MAX. TEMPERATURE RATING, 2 GAL. TANK VOLUME, 0.9 GAL. MAX. ACCEPTANCE VOLUME AND 3/4" NPTM CONNECTION. INSTALL PER MFRS. RECOMMENDATIONS. ADJUST PRE-CHARGE TO SYSTEM FILL PRESSURE.	
WH 1	WOODFORD - MODEL B66 - FREEZEPROOF ANTI-SIPHON CLOSE-COUPLED WALL HYDRANT WITH CHROME WATER BOX, ANTI-SIPHON VACUUM BREAKER AND LOOSE TEE. KEY INSTALL AT 24" ABOVE FINISHED GRADE. PROVIDE LOOSE TEE KEY TO ADVANCE AUTO PARTS REPRESENTATIVE AT PROJECT CLOSE-OUT.	

PLUMBING SYMBOLS AND ABBREVIATIONS LEGEND			
A.F.F.	ABOVE FINISHED FLOOR		COLD WATER PIPING
C.L.	CENTERLINE		HOT WATER PIPING
COL.	COLUMN		SOIL/SEWER/WASTE PIPING
CONTR.	CONTRACTOR		VENT PIPING
C.W.	COLD WATER		UNION
DEL.	DELIVERY		STRAINER
DF.	DRINKING FOUNTAIN		FLOOR PENETRATION
DN.	DOWN		BACKFLOW PREVENTER
DOM.	DOMESTIC		PIPE RISER
ET	THERMAL EXPANSION TANK		PIPE DROP
EWC	ELECTRIC WATER COOLER		SHUT OFF VALVE
EWB	ELECTRIC WATER HEATER		CHECK VALVE
FCO	FLOOR CLEANOUT		POINT OF CONNECTION/ELEVATION/INVERT
FD	FLOOR DRAIN		EQUIPMENT TYPE EQUIPMENT MARK
FIN. FL.	FINISHED FLOOR		EQUIPMENT DESIGNATION
FLA	FULL LOAD AMPS		KEYED NOTES ON DRAWING
HP	HORSE POWER		DRAWING REVISIONS
H.W.	HOT WATER		
LAV	LAVATORY		
MSB	MOP SINK BASIN		
N.I.C.	NOT IN CONTRACT		
N.T.S.	NOT TO SCALE		
P.D.	PRESSURE DROP		
RPZ	REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER		
SAN.	SANITARY		
T&P	TEMPERATURE AND PRESSURE		
TP	TRAP PRIMER		
TPY.	TYPICAL		
UR	URINAL		
V.T.R.	VENT THRU ROOF		
WC	WATER CLOSET		
WCO	WALL CLEANOUT		
WHA	WATER HAMMER ARRESTER		

NOTE: THIS LEGEND IS FOR REFERENCE ONLY. NOT ALL SYMBOLS AND ABBREVIATIONS WILL BE USED. NOT ALL SYMBOLS AND ABBREVIATIONS USED ARE INCLUDED IN LEGEND. IF QUESTIONS ARISE DUE TO THE USE OF ANY SYMBOL OR ABBREVIATION THE CONTRACTOR SHALL CONTACT THE PROJECT ENGINEER IMMEDIATELY FOR DEFINITION(S) AND/OR CLARIFICATION(S).


[illegible]

<u>DATE</u>	<u>GROSS SQ. FT.</u>
6-10-26	11,287 S.F.

PROJECT # 330
DRAWN BY: STAFF
CHECK BY: STAFF
VERSION 04.26.22-23

VERSION QT-26 83x93

ALL REPORTS, PLANS, SPECIFICATIONS,
FIELD DATA, NOTES AND OTHER
DOCUMENTS, INCLUDING ALL
DOCUMENTS ON ELECTRONIC MEDIA,
PREPARED BY THE DESIGN
PROFESSIONAL AS INSTRUMENTS OF
SERVICE SHALL REMAIN THE PROPERTY
OF THE DESIGN PROFESSIONAL.
DISSEMINATION MAY NOT BE MADE
WITHOUT PRIOR CONSENT OF THE
DESIGN PROFESSIONAL. ALL COMMON
LAW RIGHTS OF COPYRIGHT AND
OTHERWISE, ARE HEREBY SPECIFICALLY
RESERVED.

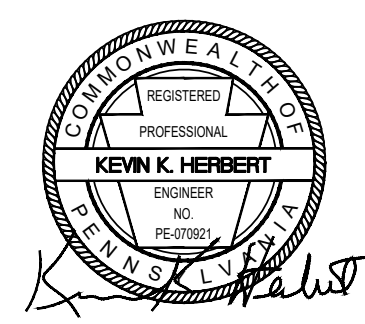

PLBG. SCHEDULE AND DETAILS

P2




NOTE TO CONTRACTOR:
THERE IS ONLY 8'-0" OF WALL SPACE ALLOTTED FOR ELECTRICAL EQUIPMENT INCLUDING EMS PANEL. THIS 8'-0" OF WALL SPACE SHALL NOT BE EXCEEDED AND THE PANELS SHALL BE INSTALLED IN LOCATIONS AS SHOWN.

POWER GENERAL NOTES:
1. PROVIDE NEW RECEPTACLES AND COVERS. COLOR SHALL BE WHITE.
2. ELECTRICAL CONTRACTOR SHALL PLACE CONDUIT DROPS AFTER COUNTERS ARE SET.

NOTE TO CONTRACTOR:
G.C. TO PLAN FOR AND INSTALL APPROXIMATELY 5 CONDUIT DROPS AND J-BOXES FOR THE INSTALLATION OF EMS, ADT CCTV, SECURITY / ALARM DEVICES. CONDUIT INSTALLATION TO BE COORDINATED WITH LOW VOLTAGE TECH'S WHILE ON SITE. CONDUITS AND BOXES TO BE PAINTED.


OUTLET COLOR DESIGNATION NOTE:
GENERAL NOTE - ALL IG OUTLETS TO BE ORANGE. ALL OTHER OUTLETS ARE WHITE UNLESS THEY ARE IG OR IN THE KICKPLATE. ALL KICKPLATE OUTLETS TO BE BLACK.

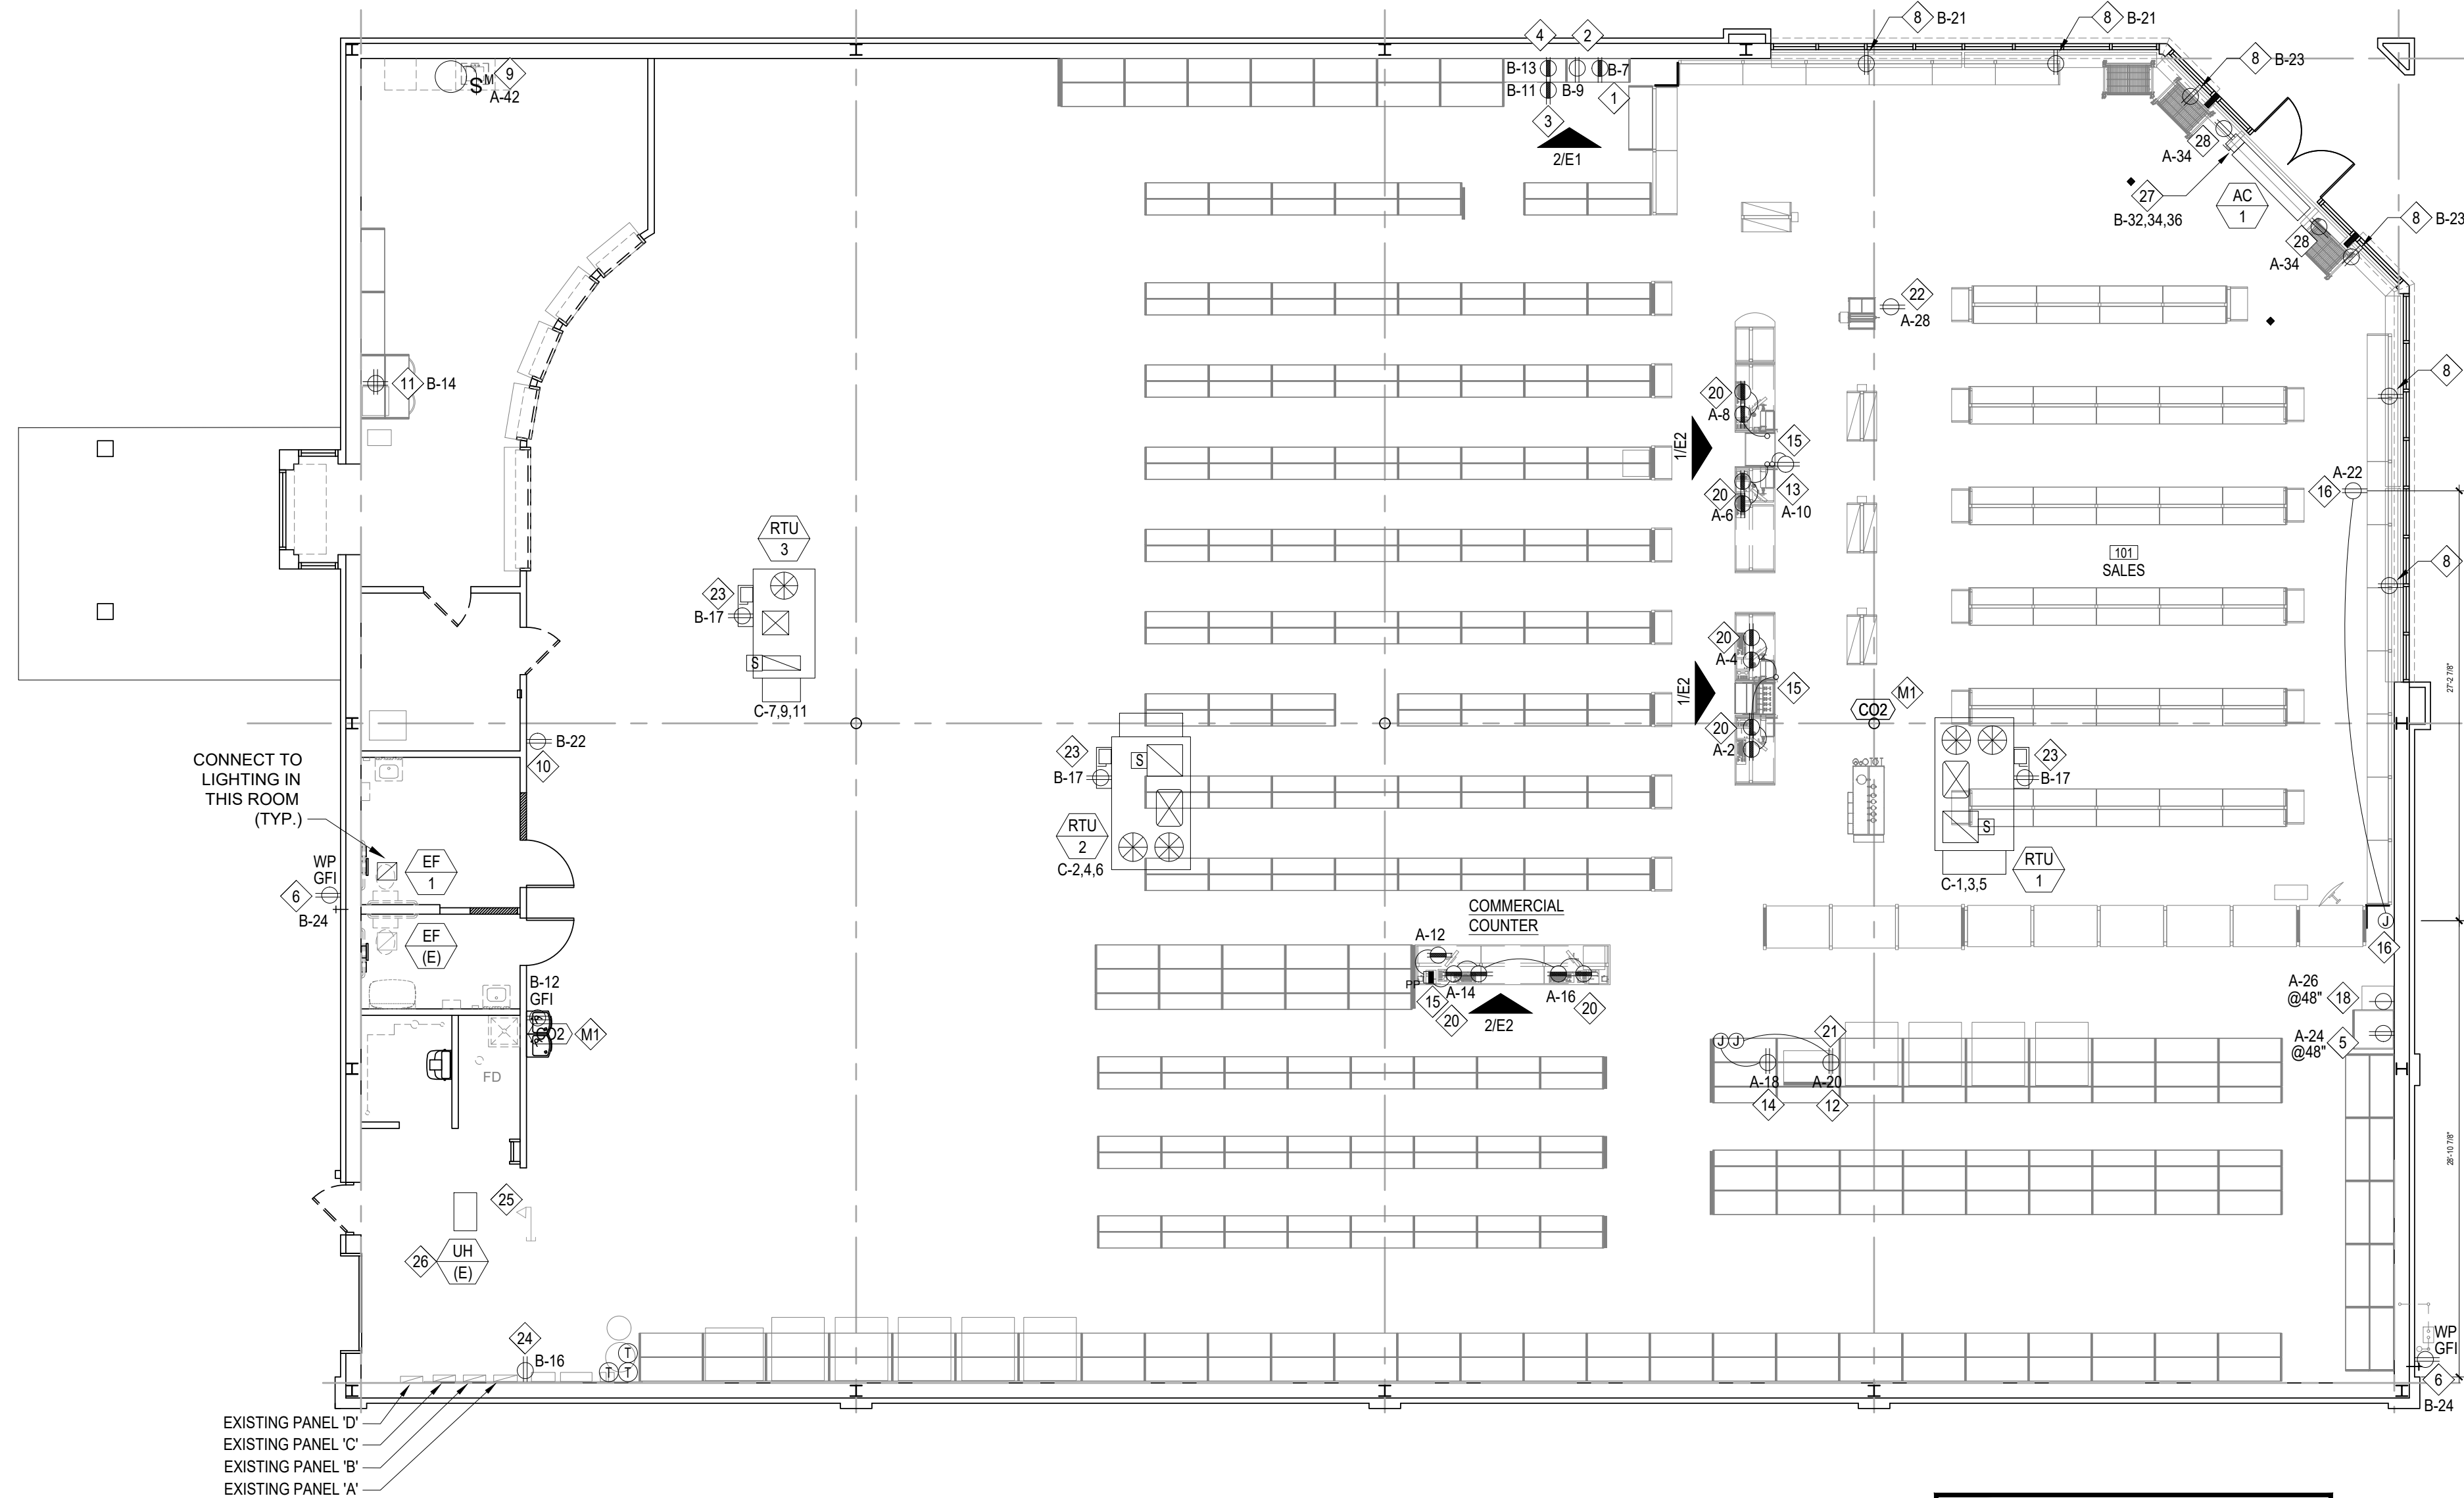

1 ELECTRICAL POWER PLAN
SCALE: 1/8"=1'-0"

EAS SYSTEM INSTALLATION NOTE:
BELOW ARE THE ITEMS THAT ARE RUN BY CONTROLTEK. ANY ADDITIONAL ITEMS REQUIRED NEED TO BE COORDINATED WITH THE CM PRIOR TO INSTALLATION.
1. NETWORK MUST BE AVAILABLE AND LIVE - CONTROLTEK WILL RUN A CAT5 CABLE FROM PEDESTALS TO NETWORK PANEL INTO THE PORT SWITCHES BELOW.
2. ARUBA 2830F SWITCH - SWITCH 1 PORT 1/10 ON THE NON-POS VLAN 2.
3. ARUBA S1500 SWITCH - SWITCH 0 PORT 0/09 ON THE NON-POS VLAN 2.

OUTLET LOCATIONS WHERE OFFICE DESK IS ADJACENT TO STOREFRONT GLAZING MOUNT UNISTRUT TO THE BACK OF THE UPRIGHT AND RUN WIRE OVER HEAD SO THAT IT DROPS DOWN FROM THE CEILING IN A CONDUIT OR POWER POLE. AFTER RUNNING THE CONDUIT DOWN TO THE UNISTRUT, MOUNT THE RECEPTACLES TO THE UNISTRUT AT HEIGHTS AS SHOWN BELOW.

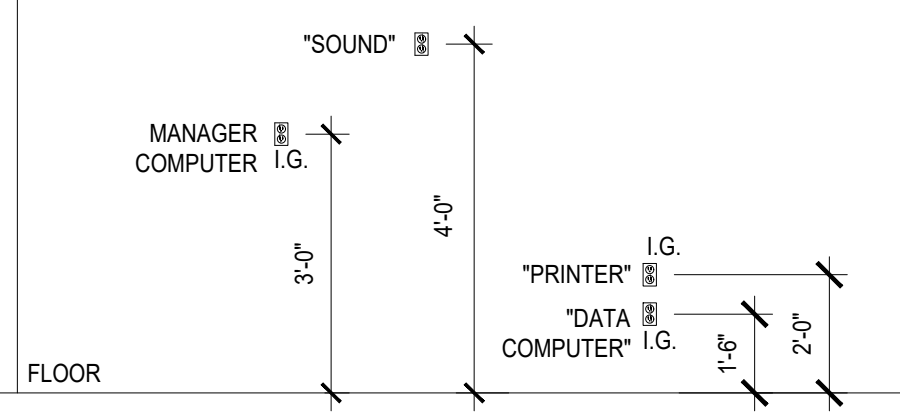

2 OFFICE OUTLET ELEVATIONS
SCALE: N.T.S.

POWER PLAN KEYED NOTES

- FURNISH AND INSTALL ONE (1) I.G. DUPLEX RECEPTACLE FOR MANAGER COMPUTER. MOUNT @36" AFF. SEE DETAIL 2/E1. LABEL RECEPTACLE "COMPUTER".
- FURNISH AND INSTALL ONE (1) DUPLEX RECEPTACLE FOR SOUND SYSTEM. MOUNT @48" AFF. SEE DETAIL 2/E1. LABEL RECEPTACLE "SOUND".
- FURNISH AND INSTALL ONE (1) DUPLEX RECEPTACLE FOR LASER PRINTER. MOUNT @24" AFF. SEE DETAIL 2/E1. LABEL RECEPTACLE "PRINTER".
- FURNISH AND INSTALL ONE (1) I.G. DUPLEX RECEPTACLE FOR DATA EQUIPMENT. MOUNT @18" AFF. SEE DETAIL 2/E1. LABEL RECEPTACLE "DATA".
- ALTERNATOR STARTER TESTER 20 AMP. 120V SINGLE STRAIGHT BLADE RECEPTACLE. CIRCUIT SHALL BE ON A DEDICATED CIRCUIT. LABEL OUTLET.
- FURNISH AND INSTALL ONE (1) 20A, 125V GROUND FAULT CIRCUIT INTERRUPTER (GFCI) DUPLEX RECEPTACLE WITH IN-USE WEATHERPROOF COVER. MOUNT + 24" AFF NEXT TO WALL HYDRANT.
- ON TELEPHONE AND SECURITY EQUIPMENT BACKBOARD, INSTALL TWO (2) QUADRAPLEX RECEPTACLES, SIDE BY SIDE AND 6" APART. PROVIDE DEDICATED CIRCUIT WITH LOCK-ON DEVICE ON BREAKER FOR RECEPTACLES. SEE RISER DIAGRAM AND PANEL SCHEDULES ON SHEET E4 FOR CLARIFICATION.
- PROVIDE RECEPTACLE MOUNTED ABOVE STOREFRONT AS REQ'D BY NEC CODE. INSTALLATION OF THE J-BOX AND POWER FOR THE SIGN RUN IS BY THE ELECTRICAL CONTRACTOR. COORDINATE FINAL LOCATION WITH SIGN VENDOR.
- FURNISH AND INSTALL A 30A TOGGLE SWITCH FOR WATER HEATER SERVICE DISCONNECT. MOUNT +48" ABOVE PLATFORM FLOOR ABOVE RESTROOMS. MAKE FINAL CONNECTIONS TO WATER HEATER. 3/4"C, 2#10, 1#10 GND.
- FURNISH AND INSTALL ONE (1) DUPLEX RECEPTACLE @24" AFF. FOR FLOOR CLEANER CHARGER. COORDINATE EXACT LOCATION WITH OWNER.
- FURNISH AND INSTALL ONE (1) QUADRAPLEX RECEPTACLE @36" AFF.
- FURNISH AND INSTALL ONE (1) DUPLEX RECEPTACLE @48" AFF FOR BATTERY CHARGER.
- FURNISH AND INSTALL ONE (1) DUPLEX RECEPTACLE FOR DRINK COOLER. FLUSH MOUNT OUTLET BOX IN BASE OF CABINET SO THAT OUTLET IS MOUNTED ON OUTSIDE OF CABINET. DUPLEX RECEPTACLE AND COVER PLATE SHALL BE FACTORY BLACK.
- FURNISH AND INSTALL A DUPLEX RECEPTACLE @18" AFF FOR WORK BENCH.
- 2" EMT TO BE USED FOR POWER DROP DOWN TO COUNTER. DRILL 2 1/8" HOLE W/ BUSHING FOR CONDUIT ENTRY IN COUNTER. SEE COUNTER DETAILS SHEET E2. ISOLATED GROUND CIRCUITS SHALL BE SEPARATE FROM NORMAL POWER CIRCUITS. DO NOT INSTALL EMT OR THE RECEPTACLES IN THE COUNTERS EXCEPT UNDER THE DIRECT SUPERVISION OF THE ADVANCE AUTO PARTS CONSTRUCTION PROJECT MANAGER. CONTRACTOR MAY SCALE DRAWINGS ONLY FOR THE ROUGH-IN LOCATION OF JUNCTION BOXES AND CIRCUITS BEFORE STORE FIXTURES ARE SET.
- SURFACE MOUNTED JUNCTION BOX, BOTTOM @12" AFF. ELECTRICIAN SHALL RETURN AT DESIGNATED TIME TO INSTALL MC CABLE TO DUPLEX RECEPTACLE IN TOE KICK OF FIXTURE. DUPLEX RECEPTACLE AND COVER PLATE SHALL BE FACTORY BLACK TO MATCH TOE KICK.
- ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING WITH LOCAL UTILITY COMPANY FOR THE INSTALLATION OF THE INCOMING TELEPHONE SERVICE CONDUITS. FURNISH AND INSTALL AT A MINIMUM ONE (1) 4" EMPTY PVC CONDUIT WITH LONG RADIUS STEEL ELBOWS AND A PULL ROPE AS REQUIRED BY LOCAL UTILITY CO. BURY A MINIMUM OF 24" BELOW GRADE FROM POINT AS DIRECTED BY LOCAL UTILITY CO. TO TELEPHONE BACKBOARD INSIDE BUILDING. PROVIDE #6 GROUND AT THE TELEPHONE BOARD AS SHOWN ON DETAIL 1/E4.
- FURNISH AND INSTALL A DUPLEX RECEPTACLE ON A SEPARATE CIRCUIT FOR BATTERY FAST CHARGER UNIT. LABEL CIRCUITS.
- PLYWOOD TELEPHONE AND SECURITY EQUIPMENT BACKBOARD BY GENERAL CONTRACTOR. REFER TO ARCHITECTURAL DRAWINGS. PREP/PRIME/PAINT BOARD WITH FIRE RETARDANT GRAY PAINT.
- FURNISH AND INSTALL ISOLATED GROUND RECEPTACLES AS INDICATED WITH DEDICATED ISOLATED GROUND CIRCUIT(S). ALL ISOLATED GROUND CIRCUITS SHALL BE KEPT SEPARATE FROM NORMAL CIRCUITS. REFER TO SHEET E2 FOR EXACT LOCATIONS.
- SURFACE MOUNTED JUNCTION BOX, BOTTOM @12" AFF. ELECTRICIAN SHALL RETURN AT DESIGNATED TIME TO INSTALL MC CABLE TO DUPLEX RECEPTACLE IN BATTERY CHARGING STATION. DUPLEX RECEPTACLE AND COVER PLATE SHALL BE FACTORY BLACK.
- GREETER/SECURITY MONITOR RECEPTACLE. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL A DUPLEX RECEPTACLE MOUNTED AT BOTTOM OF BAR JOIST. COORD. EXACT LOCN W/OWNER PRIOR TO ROUGH-IN.
- ROOF TOP UNIT FURNISHED WITH SERVICE DISCONNECT SWITCH AND A 20 AMP, 125 VOLT GFCI RECEPTACLE. ALL POWER WIRING SHALL ENTER UNIT THROUGH ROOF CURB TO POWER ENTRY SECTION OF UNIT. ALL POWER WIRING INSIDE UNIT SHALL BE IN FLEXIBLE CONDUIT. RECEPTACLE SHALL BE "LOOSE" AND WIRED BY ELECTRICAL CONTRACTOR TO CIRCUIT AS SHOWN. COORDINATE EXACT LOCATION WITH MECHANICAL. PROVIDE 120V POWER TO DUCT MOUNTED SMOKE DETECTOR.
- FURNISH AND INSTALL ONE (1) DUPLEX OUTLET FOR IRRIGATION TIMER. VERIFY LOCATION WITH SYSTEM INSTALLER. GENERAL CONTRACTOR TO PROVIDE SLEEVE THROUGH WALL FOR CONTROL WIRES. REFER TO UTILITY DRAWINGS FOR REQUIREMENTS. IRRIGATION TIMER CIRCUIT SHALL BE USED AS REQUIRED FOR RAIN GAUGE.
- 1" GALVANIZED RIGID STEEL CONDUIT W/ WEATHERHEAD ON ROOF FOR SATELLITE DISH CABLE (DISH AND CABLE BY OWNER VENDOR). CONDUIT SHALL PENETRATE ROOF AND EXTEND BELOW BAR JOIST. SECURE TO JOIST IN TWO PLACES FOR A STURDY MOUNT.
- EXISTING UNIT HEATER TO REMAIN.
- AIR CURTAIN FURNISHED WITH SERVICE DISCONNECT SWITCH AND THERMOSTAT. CONNECT TO CIRCUIT INDICATED.
- NEW EAS SYSTEM. G.C. TO LOCATE DUPLEX AND POWER MODULES AS REQUIRED. COORDINATE WITH CM.

NOTE: THE E.C. SHALL COORDINATE ALL MECHANICAL EQUIPMENT POWER REQUIREMENTS INCLUDING VOLTAGE, PHASE, AMPACITY, DISCONNECTS, ETC. WITH THE MECHANICAL CONTRACTOR PRIOR TO ANY WORK BEGINNING. NO ADDITIONAL COMPENSATION SHALL BE PROVIDED IF PROPER COORDINATION DOES NOT OCCUR.

ELECTRICAL POWER LEGEND

(ALL SYMBOLS MAY NOT NECESSARILY BE USED ON PROJECT).

SYMBOL:	DESCRIPTION:
	20 AMP, 125 VOLT DUPLEX RECEPTACLE MOUNTED 18" A.F.F., U.N.O. WHITE COLOR.
	QUADRAPLEX RECEPTACLE TWO 20 AMP, 125 VOLT DUPLEX RECEPTACLES MOUNTED 18" A.F.F., U.N.O. WHITE COLOR.
	20 AMP, 125 VOLT DUPLEX RECEPTACLE WITH ISOLATED GROUND MOUNTED 18" A.F.F., U.N.O. ORANGE COLOR.
	QUADRAPLEX IG RECEPTACLE TWO 20 AMP, 125 VOLT DUPLEX RECEPTACLES WITH ISOLATED GROUND MOUNTED 18" A.F.F., U.N.O. ORANGE COLOR.
	SPECIAL PURPOSE RECEPTACLE. REFER TO PLAN FOR SPECIFICATION.
	20 AMP, 277 VOLT SINGLE POLE SWITCH MOUNTED 48" A.F.F. U.N.O. WHITE COLOR
	20 AMP, 277 VOLT SINGLE POLE MANUAL MOTOR STARTER DISCONNECT SWITCH. MOUNTED 48" A.F.F., U.N.O.
	TIMED OVERRIDE SWITCH. MOUNT AT 48" A.F.F. SEE DETAIL 2/E4 FOR SPECIFICATION.
	JUNCTION BOX. SEE PLAN FOR REQUIREMENTS
	ELECTRICAL PANEL BOX. SEE PANEL SCHEDULES FOR REQUIREMENTS
	ELECTRIC MOTOR. MAKE FINAL CONNECTIONS
	ELECTRICAL DISCONNECT SWITCH. SEE PLANS FOR SPECIFICATION
	ELECTRICAL MOTOR STARTER / DISCONNECT SWITCH. SEE PLANS FOR SPECIFICATION
A-32	PANELBOARD AND CIRCUIT DESIGNATION. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR ALL CONDUIT AND CIRCUIT ROUTINGS BACK TO PANELBOARDS. CONTRACTOR MAY GROUP CIRCUITS WHICH EVER MAY BE THE CHEAPEST ROUTING METHOD. NO MORE THAN 3 CIRCUITS PER HOMERUN. NEUTRAL CONDUCTOR MAY ONLY SERVE THREE HOT CONDUCTORS OF DIFFERENT PHASES. CONTRACTOR IS RESPONSIBLE FOR ALL VOLTAGE LOSS AND CABLE DERATING PER N.E.C.
	VOICE OUTLET BOX. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL A 4 1/16" SQUARE OUTLET BOX WITH SINGLE GANG PLASTER RING. INSTALL A 3/4" EMPTY CONDUIT WITH PULL STRING UP TO 12" ABOVE SUSPENDED CEILING OR JOIST SPACE (IF NO CEILING EXISTS). PROVIDE INSULATED BUSHING ON EACH END OF CONDUIT. # INDICATES CABLE NUMBER.
	DATA OUTLET BOX. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL A 4 1/16" SQUARE OUTLET BOX WITH SINGLE GANG PLASTER RING. INSTALL A 3/4" EMPTY CONDUIT WITH PULL STRING UP TO 12" ABOVE SUSPENDED CEILING OR JOIST SPACE (IF NO CEILING EXISTS). PROVIDE INSULATED BUSHING ON EACH END OF CONDUIT. # INDICATES CABLE NUMBER.
	RTU THERMOSTAT LOCATION. TEMPORARY THERMOSTATS TO BE PROVIDED & INSTALLED BY M.C. MOUNT AT 5'-7" AFF. EMS VENDOR WILL REPLACE TEMPORARY THERMOSTATS DURING EMS INSTALLATION.
	CO2 SENSOR. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL CONDUIT AND OUTLET BOX AS REQUIRED. COORDINATE ALL REQUIREMENTS W/ HVAC CONTRACTOR.
	FACTORY INSTALLED DUCT SMOKE DETECTOR.

ELECTRICAL ABBREVIATIONS

AAP	ADVANCE AUTO PARTS	KW	KILOWATT
AFF	ABOVE FINISHED FLOOR	NIC	NOT IN CONTRACT
A	AMPERE	O.C.	ON CENTER
AWG	AMERICAN WIRE GAUGE	PH	PHASE
CB	CIRCUIT BREAKER	PNL	PANEL
ELEC	ELECTRICAL CONTRACTOR	SPECS	SPECIFICATIONS
EQUIP	EQUIPMENT	SW	SWITCH
ETR	EXISTING TO REMAIN	TEL	TELEPHONE
FA	FIRE ALARM	TYP	TYPICAL
FOIC	FURNISHED BY OWNER, INSTALLED BY ELEC. CONTR.	U.C.	UNDER COUNTER
G.GND	GROUND	U.O.N.	UNLESS OTHERWISE NOTED
GFI	GROUND FAULT INTERRUPTER	V	VOLT
GRMC	GALVANIZED RIGID METAL CONDUIT	W	WIRE
HP	HORSEPOWER	WP	WEATHERPROOF
IG	ISOLATED GROUND	XFMR	TRANSFORMER
J-BOX	JUNCTION BOX	RTU	ROOF TOP UNITS

GENERAL NOTES

- ELECTRICIAN IS TO RETURN TO THE JOB ON A DESIGNATED DAY TO:
* INSTALL ALL REQUIRED RECEPTACLES IN THE COUNTERS AS SHOWN.
* INSTALL RECEPTACLES FOR SUSPENDED GREETER MONITOR.
- ALL LOW VOLTAGE CABLES ARE FURNISHED AND INSTALLED BY ADVANCE AUTO AUTO PARTS NATIONAL ACCOUNT VENDOR. IF REQUIRED, CONTRACTOR TO PULL THE LOW VOLTAGE PERMIT FOR THE VENDOR AND VENDOR WILL REIMBURSE THE COST OF THE PERMIT.
- THE STORE MERCHANDISE PLAN IN THIS SET IS FOR THE CONTRACTOR'S REFERENCE ONLY. ADVANCE AUTO PARTS WILL SUPPLY AND INSTALL ALL STORE FIXTURES.
- BEFORE SUBMITTING THE PROPOSAL FOR THEIR WORK, THE CONTRACTOR SHALL VISIT THE SITE. THEY SHALL SATISFY THEMSELVES AS TO THE NATURE AND LOCATION OF THE WORK AND THE GENERAL CONDITIONS. THEY SHALL HAVE FULL KNOWLEDGE AS TO TRANSPORTATION, DISPOSAL, HANDLING AND STORAGE OF MATERIALS, AVAILABILITY OF WATER, ELECTRIC POWER AND ALL OTHER FACILITIES IN THE AREA WHICH WILL HAVE A BEARING ON THE PERFORMANCE OF THEIR WORK AND THE CONTRACT FOR WHICH THEY SUBMIT A PROPOSAL. FAILURE BY THE CONTRACTOR TO ACQUAINT THEMSELVES WITH ALL AVAILABLE INFORMATION SHALL NOT RELIEVE THEM OF ANY RESPONSIBILITY FOR PERFORMING THEIR WORK PROPERLY. ADDITIONAL COMPENSATION SHALL NOT BE ALLOWED FOR CONDITIONS INCREASING THE CONTRACTOR'S COST WHICH WERE NOT KNOWN TO OR APPRECIATED BY THEM WHEN SUBMITTING THEIR PROPOSAL. IF THE CONDITION WAS OBVIOUS AND COULD HAVE BEEN DISCOVERED BY THEM IF THEY HAD VISITED THE PROJECT AND HAD THOROUGHLY INFORMED THEMSELVES OF ALL EXISTING CONDITIONS WHICH WOULD AFFECT THEIR WORK.
- NO JUNCTION BOXES OR CONDUIT SHALL BE MOUNTED BELOW 12" A.F.F.

HVAC CONTROL KEYED NOTES

- CO2 SENSOR MOUNTED AT 7'-0" A.F.F. ON BACK SIDE OF COLUMN. FURNISH AND INSTALL CONDUIT, CONTROL WIRING, AND CONNECT TO EQUIPMENT INDICATED AS REQUIRED. PAINT EXPOSED CONTROL WIRING CONDUIT TO MATCH COLUMN.

Advance Auto Parts
221 GROVE CITY RD.
SLIPPERY ROCK, PA 16057
STORE # TBD


REV	DATE	DESCRIPTION

DATE	GROSS SQ. FT.
6-10-26	11,287 S.F.


PROJECT # 330
DRAWN BY: STAFF
CHECK BY: STAFF
VERSION Q1-26 83x83

ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

POWER PLAN
NOTES AND
DETAILS
E1

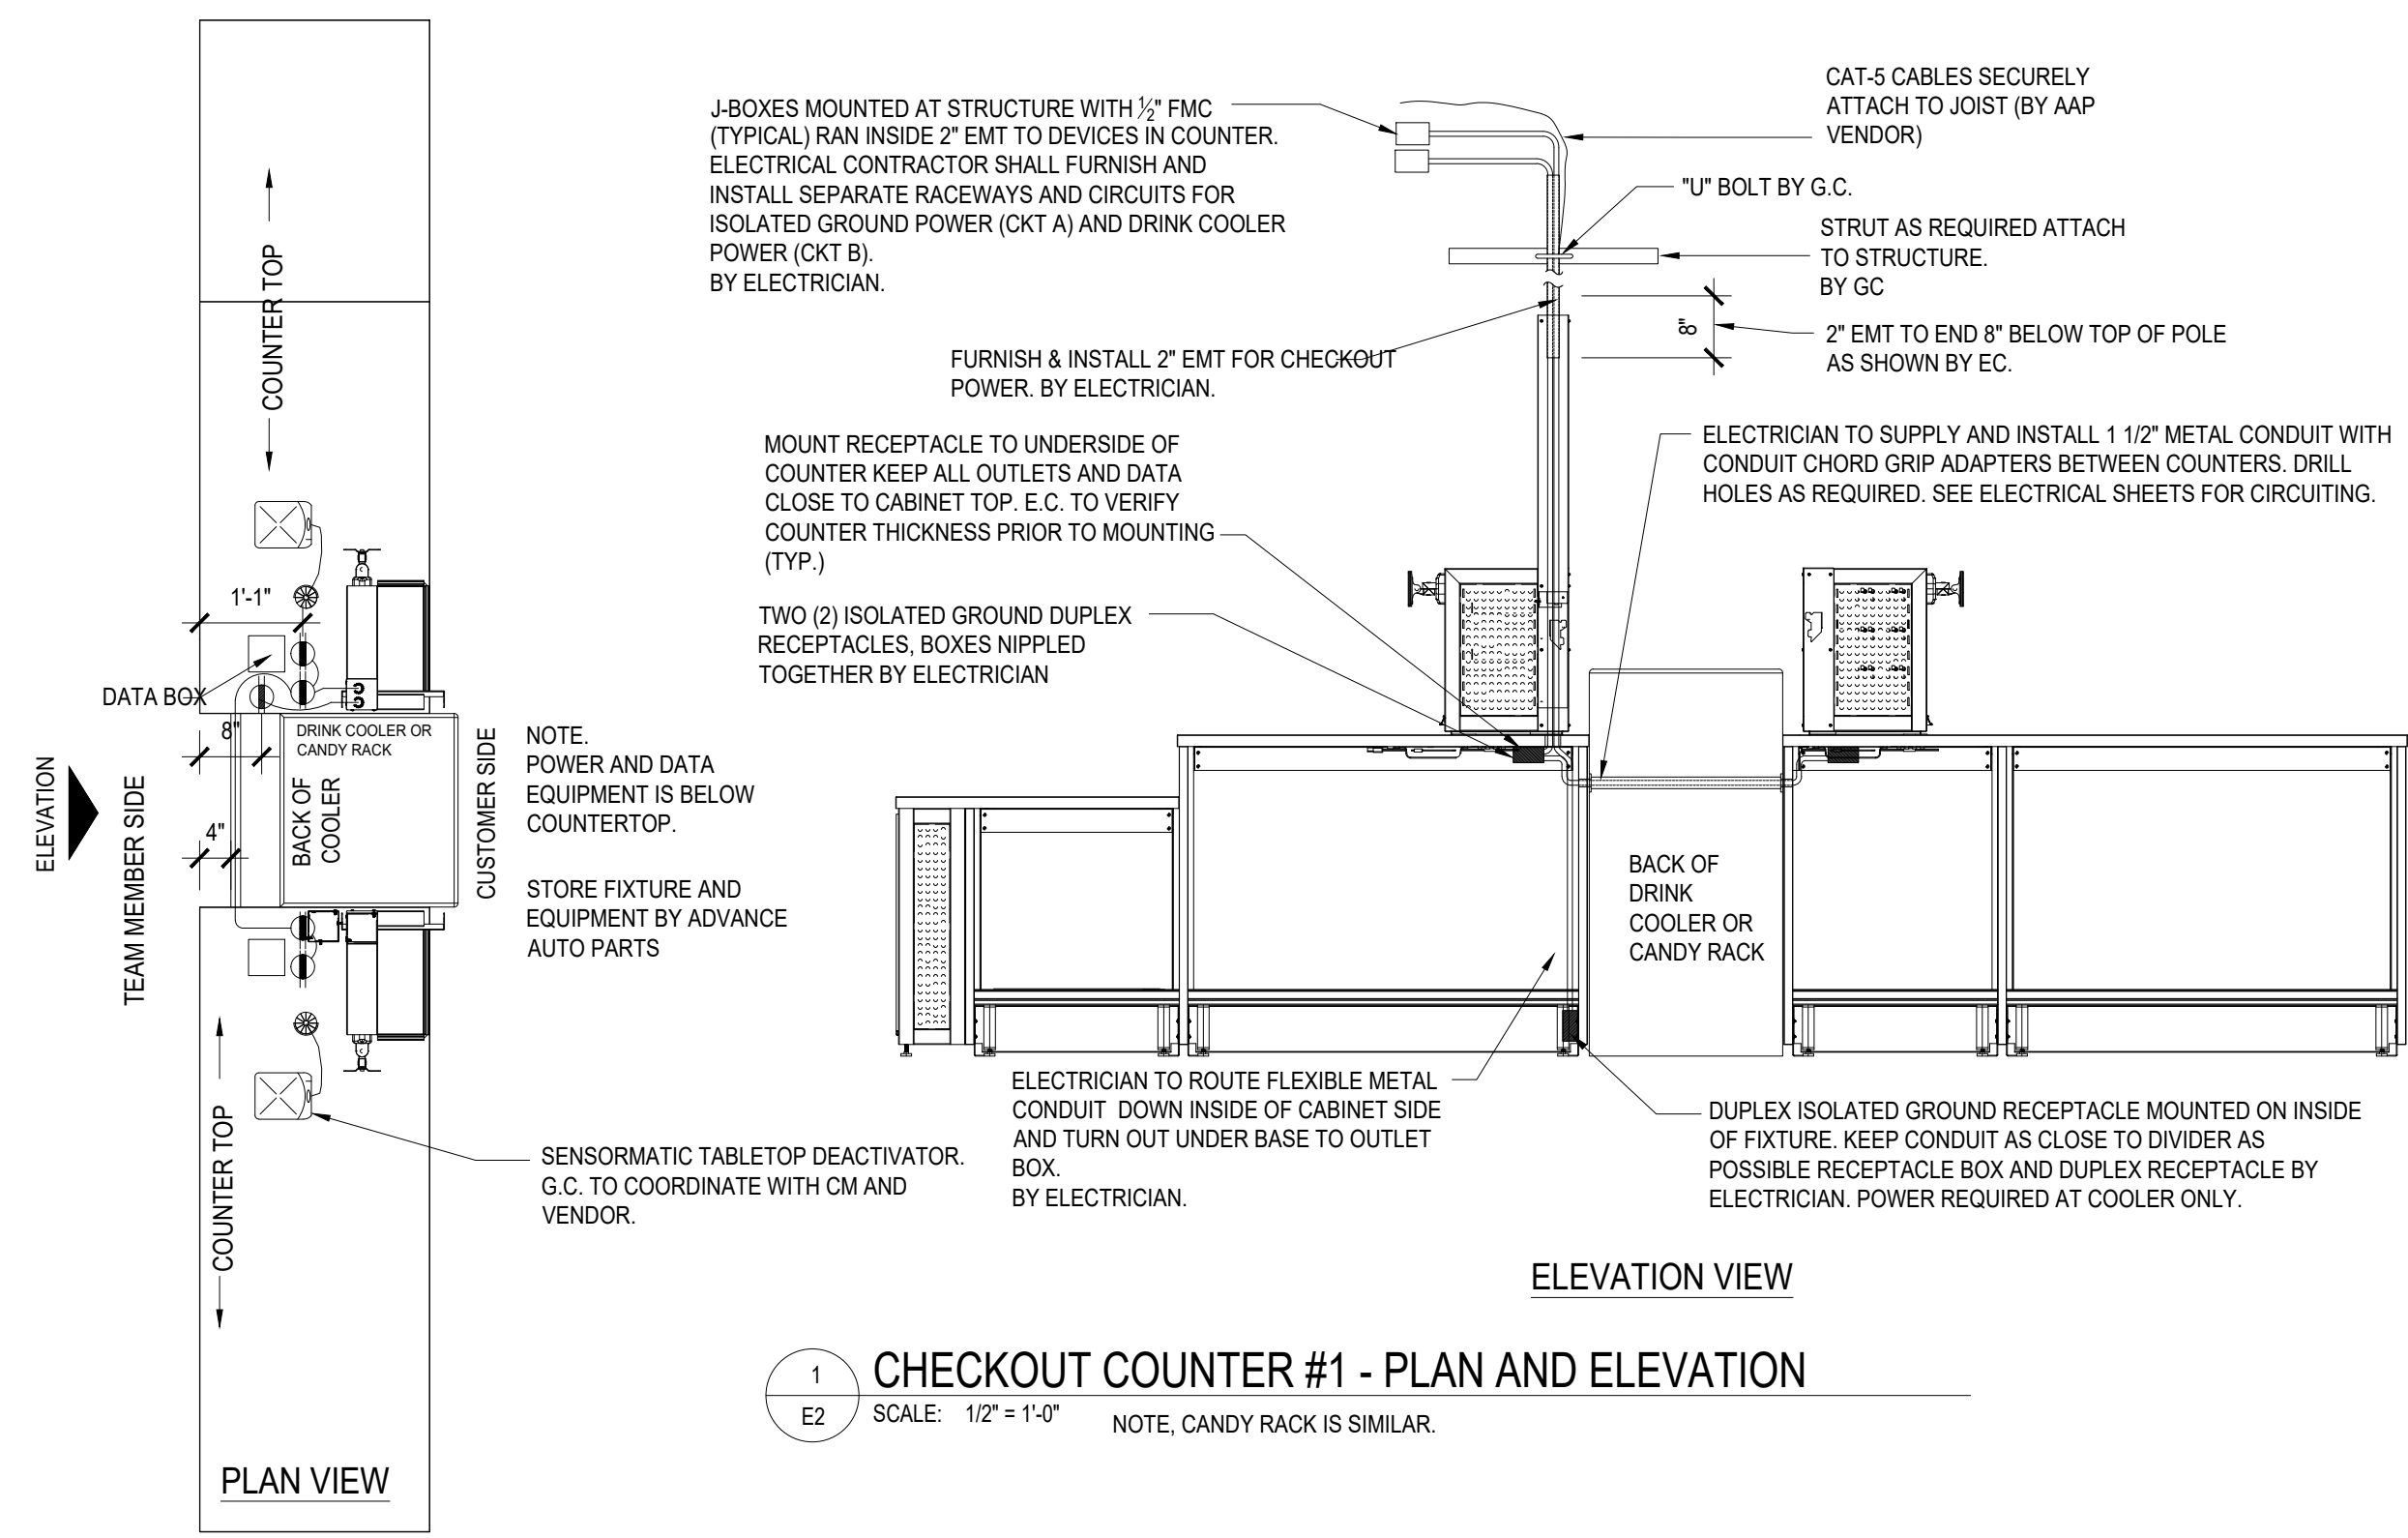

1
E2 CHECKOUT COUNTER #1 - PLAN AND ELEVATION
SCALE: 1/2" = 1'-0" NOTE, CANDY RACK IS SIMILAR.

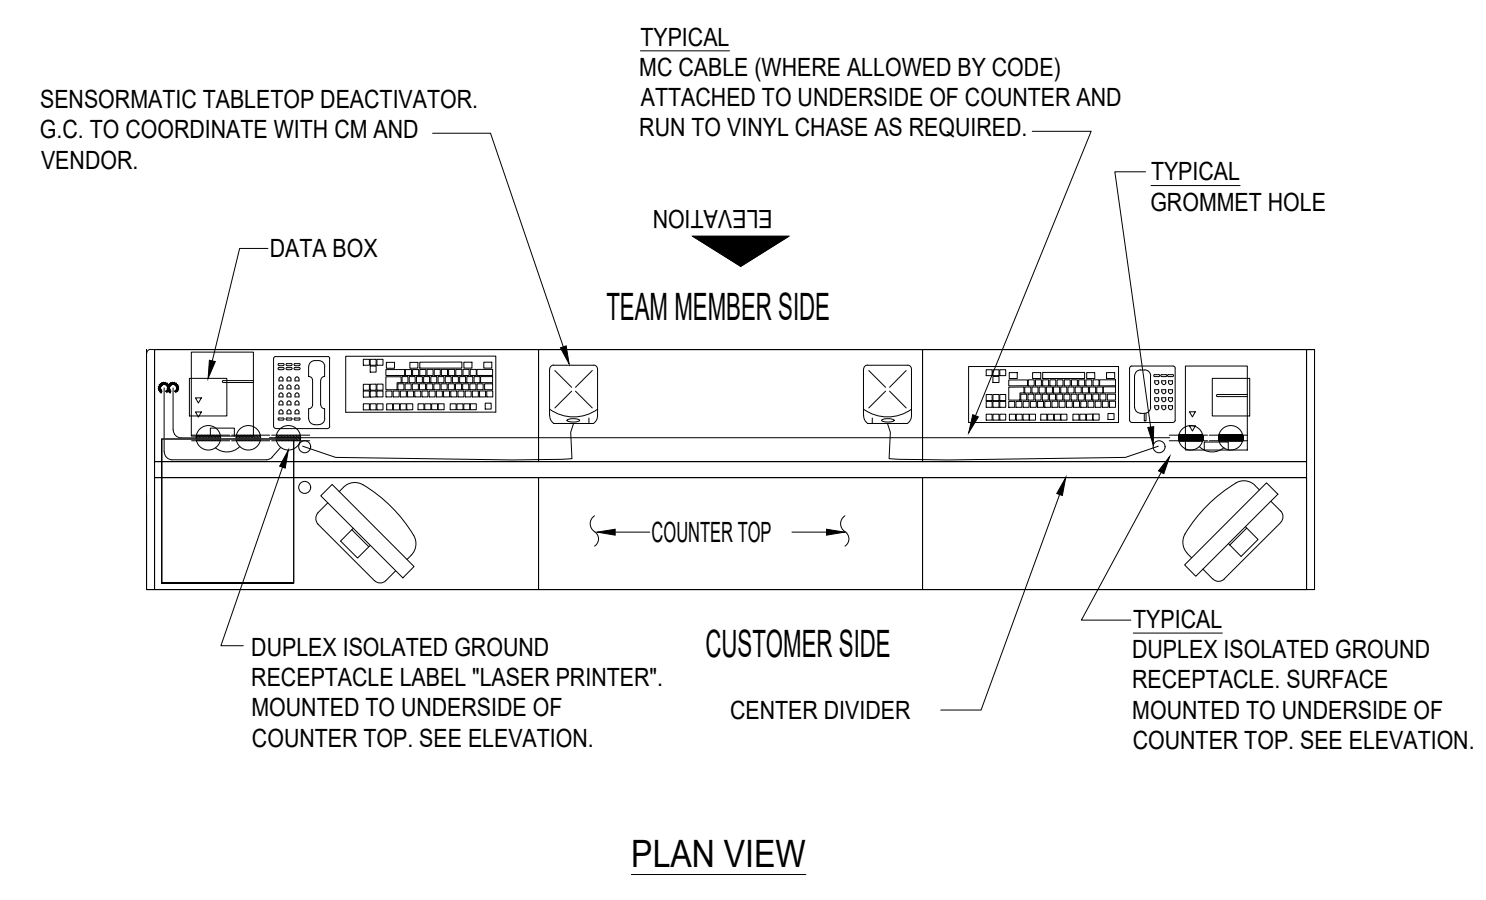


PLAN VIEW

2
E2 PROFESSIONAL SALES COUNTER - PLAN AND ELEVATION
SCALE: 1/2" = 1'-0"

NOTE: THESE DETAILS ARE TYPICAL DETAILS FOR POWER REQUIREMENTS AT ALL COUNTERS. ORIENTATION OF COUNTERS MAY VARY. COUNTERS ARE SUPPLIED AND INSTALLED BY AAP

NOTE: KEEP ALL OUTLETS AND DATA WITH IN 10" OF THE COUNTER SIDE UNLESS OTHERWISE NOTED.

NOTE: SEE SHEET E3 AND A3 FOR LOCATION OF POWER POLES AND ORIENTATION OF COUNTERS

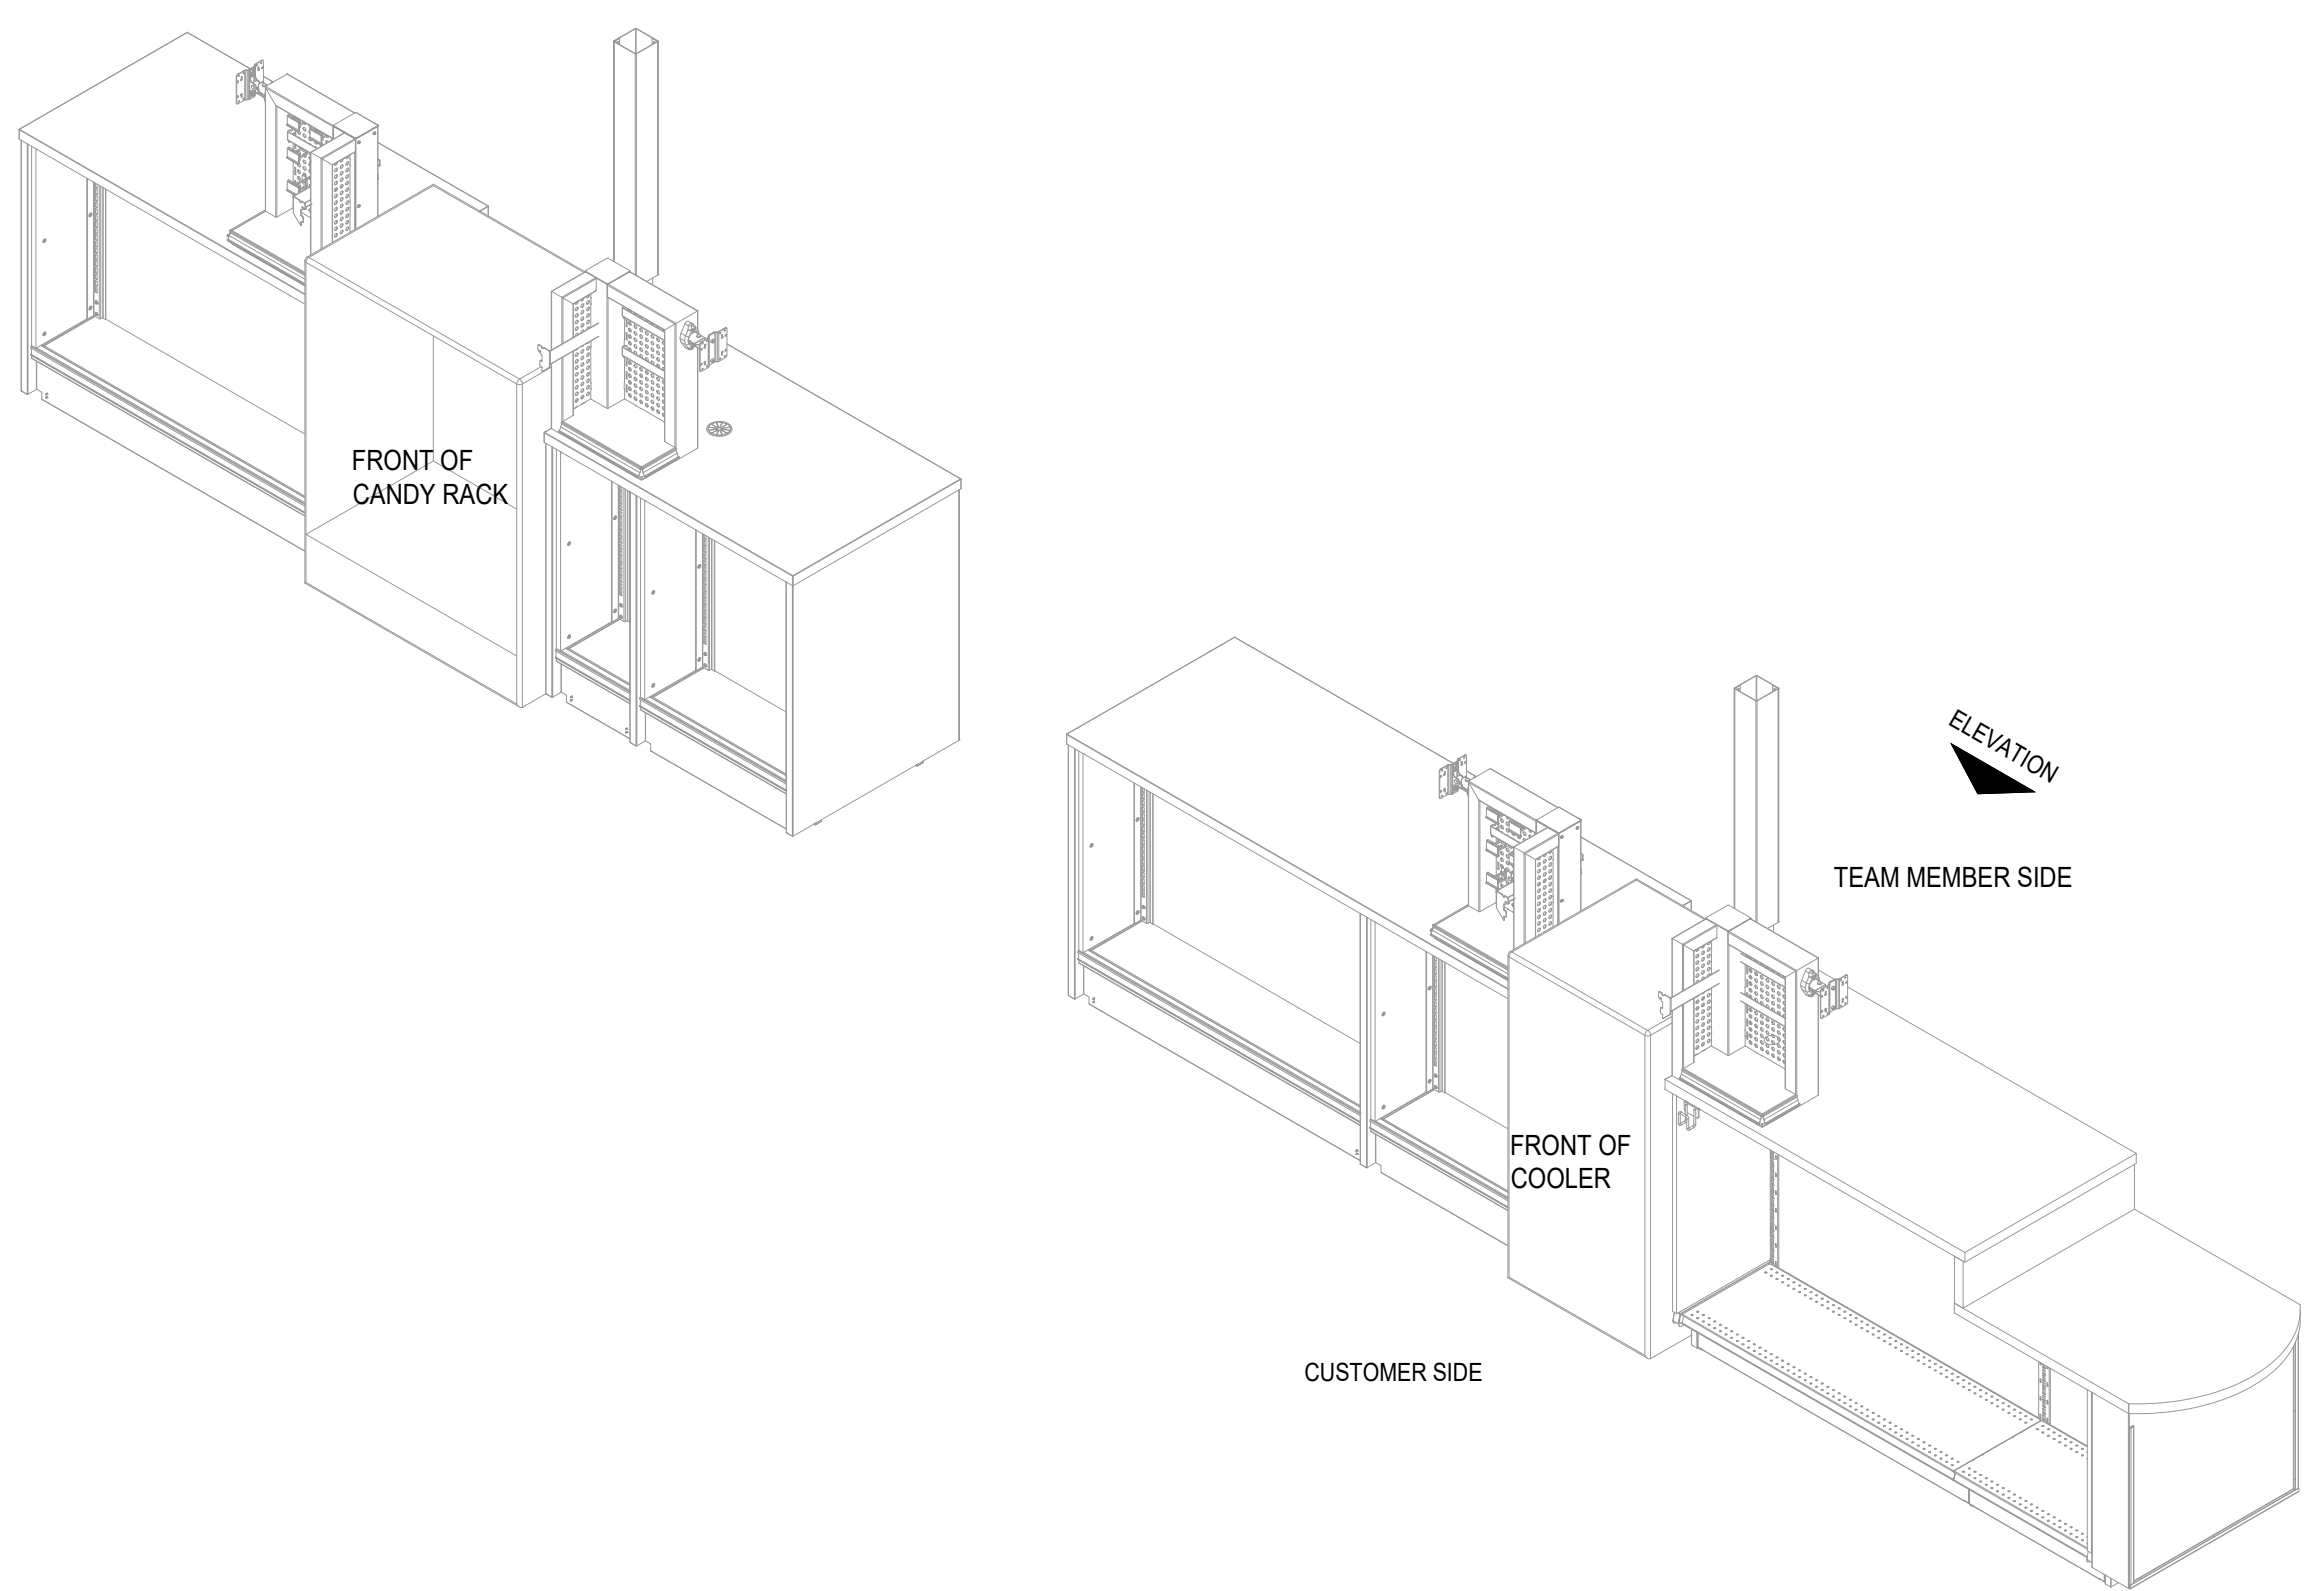

3
E2 ISOMETRIC AT ALL COUNTERS
SCALE: 1/2" = 1'-0"

NOTE: THESE DETAILS ARE TYPICAL DETAILS FOR POWER REQUIREMENTS AT ALL COUNTERS. ORIENTATION OF COUNTERS MAY VARY. COUNTERS ARE SUPPLIED AND INSTALLED BY AAP

NOTE: KEEP ALL OUTLETS AND DATA WITH IN 10" OF THE COUNTER SIDE UNLESS OTHERWISE NOTED.

NOTE: SEE SHEET E3 AND A3 FOR LOCATION OF POWER POLES AND ORIENTATION OF COUNTERS

NOTE: THESE DETAILS ARE TYPICAL DETAILS FOR POWER REQUIREMENTS AT ALL COUNTERS. ORIENTATION OF COUNTERS MAY VARY. COUNTERS ARE SUPPLIED AND INSTALLED BY AAP

NOTE: KEEP ALL OUTLETS AND DATA WITH IN 10" OF THE COUNTER SIDE UNLESS OTHERWISE NOTED.

NOTE: SEE SHEET E3 AND A3 FOR LOCATION OF POWER POLES AND ORIENTATION OF COUNTERS

Advance Auto Parts

221 GROVE CITY RD.
SLIPPERY ROCK, PA 16057

STORE # TBD

REV	DATE	DESCRIPTION

DATE	GROSS SQ. FT.
6-10-26	11,287 S.F.

PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF

VERSION Q1-26	83x83
---------------	-------

ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

COMMONWEALTH OF PENNSYLVANIA

REGISTERED PROFESSIONAL

W. M. ELLETT

NO. 101234

DATE 06/10/26

ENLARGED COUNTER DETAILS

E2


LUMINAIRE SCHEDULE										
(ALL LUMINARIES MAY NOT NECESSARILY BE USED ON PROJECT)										
TYPE	QTY.	MANUFACTURER	MODEL NUMBER	NO.	LAMPS PER FIXTURE			COLOR	MOUNTING	REMARKS
					OSRAMSYLA	VANIA TYPE	WATTS			
A	0	US LED	ST1-4-UNV-4-27A-35-GL-DE-TWS1	2	LED		31.8	120	WHITE	NOTES 1,2,3,10
EL	17	LITHONIA	ELMEL-UVOLT-LTP-SDRT	2	(2) 5.3 WATT LED INCLUDED		10.6	9.6-12.8V	WHITE	CONNECT DC WIRING TO EU FIXTURE, NOTE 6
EU	0	LITHONIA	ELMRESP1100LT	2	(2) 5.3 WATT LED INCLUDED		10.6	120V	WHITE	CONNECT REMOTE FIXTURES TO EL FIXTURE, NOTE 6
R	2	US LED	GTR2-11EH-35-80-UNV2-S	1	LED		27.5	120/277	WHITE	NOTES 1,2,3
WW3	0	LITHONIA	DSXW1 LED 10C 350 50K T3M MVOLT DSSXD	10	LED		13.21	120	SANDSTONE	NOTES 1.5 FIXTURE NOT TO BE PAINTED
WW3	1	LITHONIA	DSXW1 LED 10C 350 50K T3M 120 PE DSSXD	10	LED		13.21	120	SANDSTONE	NOTES 1.5 FIXTURE NOT TO BE PAINTED
WW	0	LITHONIA	DSXW1 LED 20C 700 50K T3M MVOLT DSSXD	20	LED		47	120	SANDSTONE	NOTES 1.5 FIXTURE NOT TO BE PAINTED
XL	11	LITHONIA	LHQM5WRGMVOLTHO	-	LED - INCLUDED		3	120/277	WHITE W/RED LETTERS	NOTES 1,2,7
XU	2	LITHONIA	ELMRW LP220L DWHXD (White)	-	5.4W LAMPS INCLUDED		12	120/277		CONNECT REMOTE FIXTURES TO "XL", NOTE 7
ET	0	LITHONIA	ELM2L	2	(2) 5.4 WATT KRYPTON INCLUDED		20	6V	WHITE	NOTES 1,2,8
S	0	US LED	LINEARSTAR	-	LED		18.5	120V	GRAY	NOTES 1 LENGTH AS REQUIRED BY SIGN
LIGHT FIXTURE SCHEDULE NOTES:										
1. ELEC. SHALL FURNISH AND INSTALL ALL LUMINARIES AND LAMPS AS SPECIFIED. LUMINARIES AND LAMPS SHALL BE ORDERED THROUGH ADVANCE AUTO PARTS NATIONAL ACCOUNT. REFER TO RESPONSIBILITY MATRIX SHEET T1 FOR ORDERING INFORMATION.										
2. ELEC. SHALL BE RESPONSIBLE TO SUPPORT LIGHT FIXTURES WITH UNISTRUT THAT IS INSTALLED TO ALLOW FOR ADJUSTMENT OF LIGHT FIXTURES AFTER FIXTURES ARE INSTALLED. LIGHT FIXTURES SHALL BE INSTALLED AS DIRECTED. E.C. IS TO MAKE MINOR ADJUSTMENTS TO CENTER LIGHTING ON AISLES AFTER THE MERCHANDISE FIXTURES ARE SET.										
3. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATION OF ALL LUMINARIES.										
4. IN "STAGING" DIRECT MOUNT FIXTURE BELOW STRUCTURE, KEEP AS HIGH AS POSSIBLE.										
5. J-BOXES SHALL BE MOUNTED ON INTERIOR OF CMU ABOVE CEILING, CONDUIT SHALL BE CONCEALED IN CMU TO FIXTURE ON EXTERIOR.										
6. MAXIMUM OF TWO (2) TYPE "EU" (4 INDIVIDUAL REMOTE HEADS) MAY BE CONNECTED TO A SINGLE TYPE "EL" UNIT.										
7. MAXIMUM OF TWO (2) TYPE "XU" (4 INDIVIDUAL REMOTE HEADS) MAY BE CONNECTED TO A SINGLE TYPE "XL" UNIT.										
8. FOR USE WHEN RESTROOM EMERGENCY LIGHTS ARE REQUIRED BY LOCAL CODE.										
9. NOT USED.										
10. PROVIDE 5' WHIPS ON FIXTURES "A" LIGHT FIXTURES TO ALLOW ELECTRICIAN TO ADJUST FINAL LOCATION AFTER STORE FIXTURES ARE SET. (SEE LIGHT FIXTURE SCHEDULE NOTE 2 ABOVE AND DETAIL 2 ON THIS SHEET) WHIPS SHOULD BE IN A VERTICAL COIL TIED OFF TO THE PANEL POINTS OF THE JOISTS. THE COIL SHOULD BE UNIFORM AND IN THE SAME LOCATION RELATIVE TO THE OTHER LIGHT FIXTURES IN THAT ROW.										

- LIGHTING GENERAL NOTES:
1. PROVIDE NEW SWITCHES AND SWITCH COVERS. COLOR SHALL BE WHITE
 2. EMERGENCY BATTERY UNITS AND EXIT SIGNS SHALL BE CONNECTED TO THE NORMAL LIGHTING CIRCUIT AHEAD OF ANY SWITCH.
 3. ELECTRICAL CONTRACTOR SHALL PLACE OIL/BATTERY LIGHTING AFTER RACK IS SET.
 4. ELECTRICAL CONTRACTOR SHALL ADD 5'-0" WHIPS ON ALL MERCHANDISE AREA LIGHT FIXTURES. WHIPS SHOULD BE IN A VERTICAL COIL TIED OFF TO THE PANEL POINTS OF THE JOISTS. THE COIL SHOULD BE UNIFORM AND IN THE SAME LOCATION RELATIVE TO THE OTHER LIGHT FIXTURES IN THAT ROW.
 5. SUSPENDING LIGHT FIXTURE HEIGHTS ABOVE FINISH FLOOR MAY VARY AND WILL BE BASED ON EXISTING OVERHEAD CLEARANCES. VERIFY ALL HEIGHT VARIATIONS WITH AAP CM/ARCHITECT PRIOR TO INSTALLING FIXTURES. LIGHT FIXTURE PREFERRED HEIGHT IS 14'-0" AFF. MOUNT AS HIGH AS POSSIBLE ELSEWHERE NOT TO EXCEED 14'-0" A.F.F..
 6. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL CONDUITS & CIRCUITING OF LIGHTING BACK TO PANELS. FINAL HOOK TO TIME CLOCK BY ELECTRICAL CONTRACTOR.
 7. LIGHTING SHALL BE INSTALLED DOWN CENTER OF AISLES.
 8. WHERE EXTERIOR BUILDING MOUNTED LIGHTING OCCURS, RUN THE CONDUIT AT THE JOIST SPACE HEIGHT AND FEED DOWN TO EACH LIGHT JUNCTION BOX.
 9. MOUNT EMERGENCY LIGHTING TO BOTTOM OF JOIST.


NOTE
SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR LIGHTING LOCATION DIMENSIONS

ELECTRICAL CEILING LEGEND	
(ALL SYMBOLS MAY NOT NECESSARILY BE USED ON PROJECT).	
SYMBOL:	DESCRIPTION:
	4in X 48in. LINEAR LED LUMINAIRE
	1X1 SOFFIT LUMINAIRE
	EXIT SIGN WITH BATTERY BACK UP
	INTERIOR EMERGENCY LUMINAIRE
	EXTERIOR DECORATIVE WALL LIGHT
	EXTERIOR WALL PACK
	OCCUPANCY SENSOR WITH DUAL TECHNOLOGY (ULTRASONIC AND INFRA RED) AND OFF SWITCH. WALL MOUNT AT 48" AFF. RESTROOMS: HUBBELL #LHMTS1
	LIGHTING LUMINAIRE SYMBOL TYPE: REFER TO LUMINAIRE SCHEDULE
	INDICATES PANEL DESCRIPTION & CIRCUIT NUMBERS
	20 AMP, 125 VOLT DUPLEX RECEPTACLE FLUSH MOUNTED IN SUSPENDED CEILING TILE, U.N.O. WHITE COLOR.


- LIGHTING PLAN KEYED NOTES
1. PRIOR TO INSTALLATION OF SIGNAGE, ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ONE (1) 20-AMP CIRCUIT TO JUNCTION BOX FOR BUILDING SIGN. J-BOX SHALL BE MOUNTED DIRECTLY BEHIND "E" IN "ADVANCE". CLEARLY MARK J-BOX "FOR SIGN COMPANY". SIGN COMPANY TO MAKE ALL FINAL CONNECTIONS TO SIGNS. SEE ARCHITECTURAL ELEVATIONS FOR EXACT LOCATION OF ALL SIGNS. SIGNS SHALL BE FURNISHED WITH DISCONNECT SWITCH. ELECTRICAL CONTRACTOR SHALL ROUTE CIRCUIT TO PANEL, FINAL CONNECTION TO TIME CLOCK BY ELECTRICAL CONTRACTOR.
 2. NEW LIGHT FIXTURE, E.C. SHALL COORDINATE NEW FIXTURE WITH CM AND USLED. TIE INTO EXISTING CIRCUITS & CONTROLS.
 3. E.C. SHALL REMOVE THE EXISTING DRIVER/BALLAST AND ASSOCIATED INTERNAL COMPONENTS FROM THE EXISTING LIGHT FIXTURES IN ROW. MAINTAIN THE EXISTING FIXTURE HOUSING. PROVIDE AND INSTALL NEW USLED COMPONENTS, MODEL ST1-4-UNV-4-10A-35-GL-XX (TWS), IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS. MAINTAIN AND RECONNECT TO THE EXISTING BRANCH CIRCUITING.
 4. E.C. SHALL REMOVE THE EXISTING DRIVER/BALLAST AND ASSOCIATED INTERNAL COMPONENTS FROM THE EXISTING LIGHT FIXTURES IN ROW. MAINTAIN THE EXISTING FIXTURE HOUSING. PROVIDE AND INSTALL NEW USLED COMPONENTS, MODEL ST1-4-UNV-4-27A-35-GL-DE-TWS, IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS. MAINTAIN AND RECONNECT TO THE EXISTING BRANCH CIRCUITING.
 5. NEW EXTERIOR WALLPACKS. MATCH EXISTING WALLPACKS, TIE INTO EXISTING CIRCUITS AND CONTROLS.

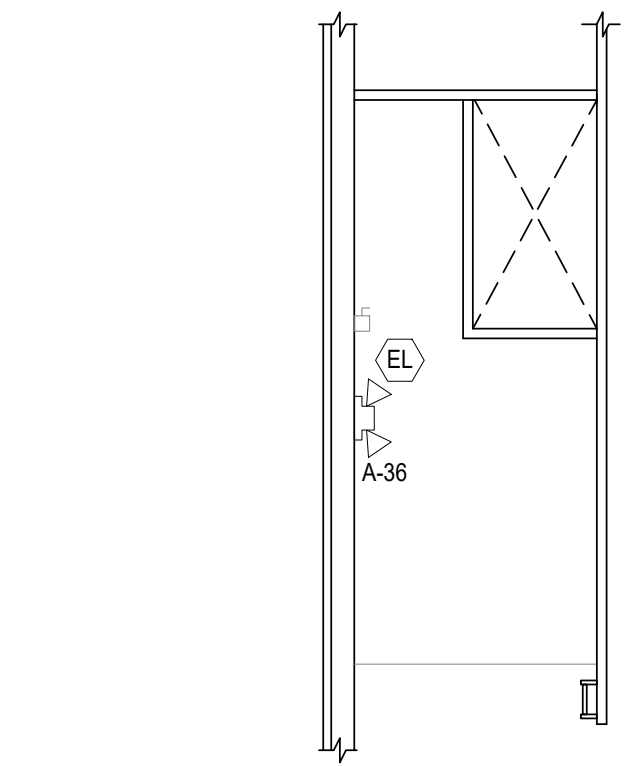

2 MEZZANINE ELECTRICAL LIGHTING PLAN
SCALE: 1/8"=1'-0"

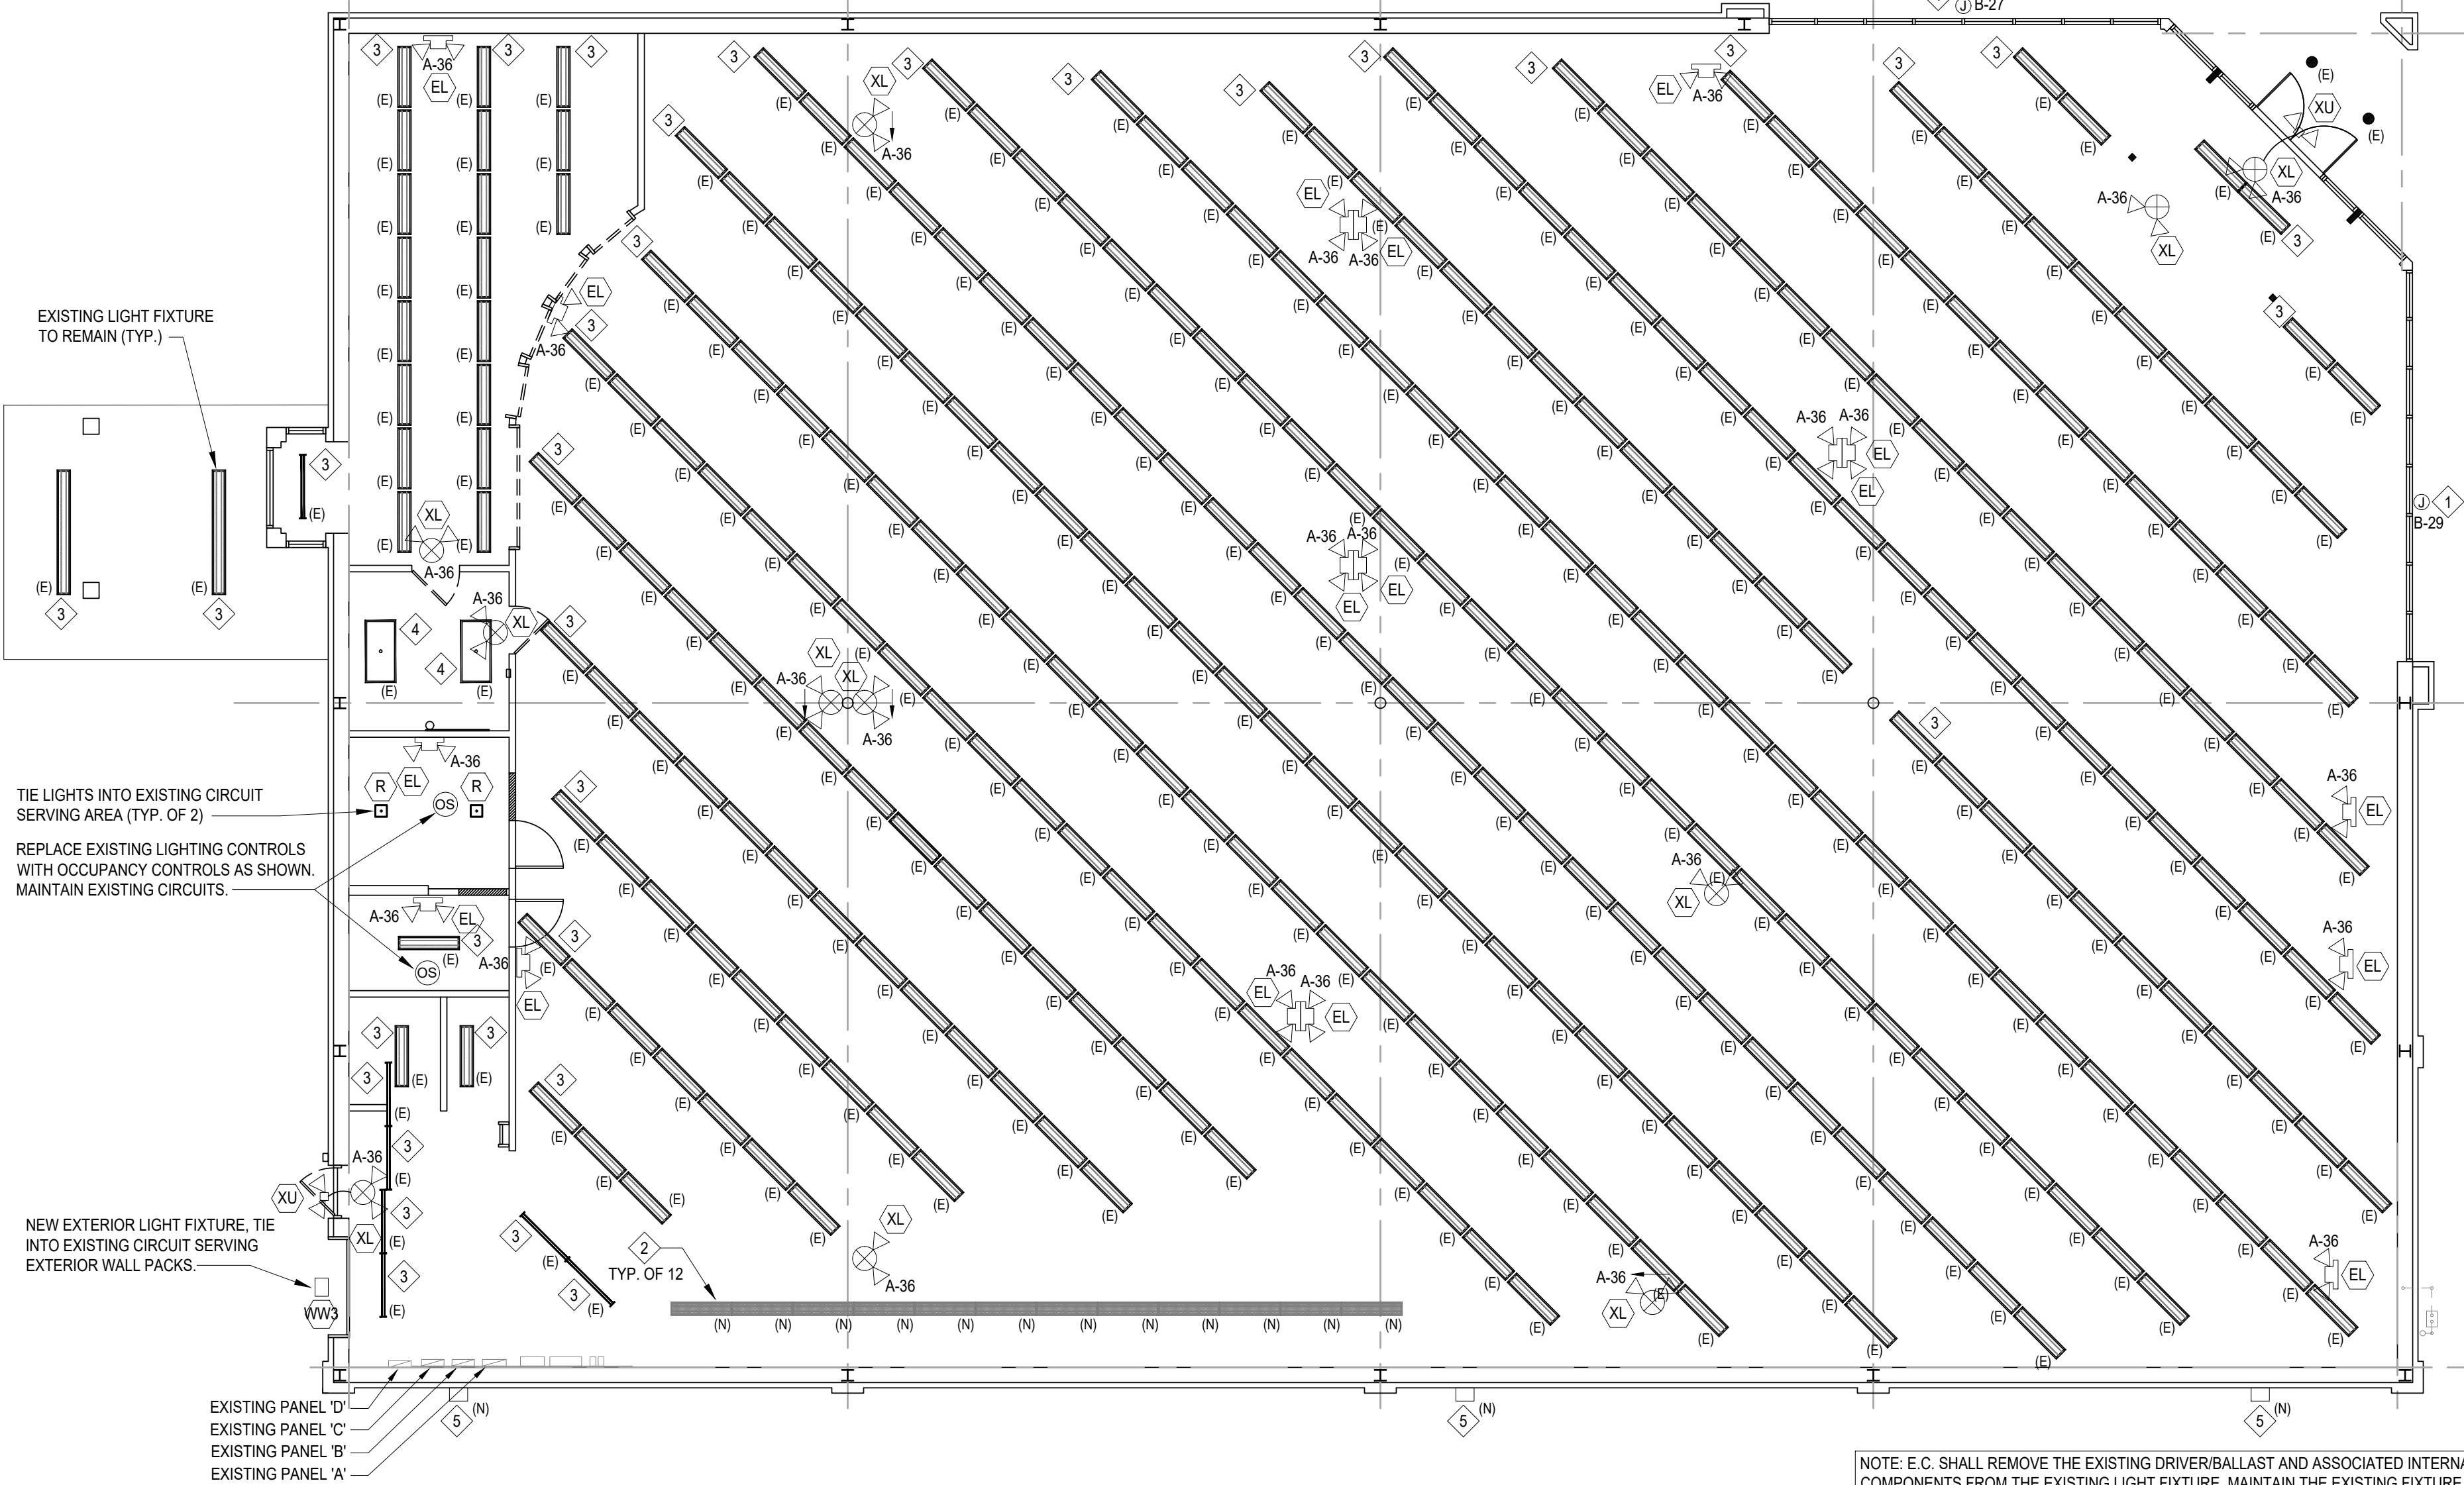

1 ELECTRICAL LIGHTING PLAN
SCALE: 1/8"=1'-0"

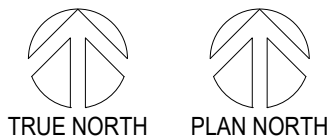


NOTE: E.C. SHALL REMOVE THE EXISTING DRIVER/BALLAST AND ASSOCIATED INTERNAL COMPONENTS FROM THE EXISTING LIGHT FIXTURE. MAINTAIN THE EXISTING FIXTURE HOUSING. PROVIDE AND INSTALL NEW USLED COMPONENTS. IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS. MAINTAIN AND RECONNECT TO THE EXISTING BRANCH CIRCUITING.

REVISIONS		DESCRIPTION
REV	DATE	

DATE	GROSS SQ. FT.
6-10-26	11,287 S.F.
PROJECT #	330
DRAWN BY:	STAFF
CHECK BY:	STAFF

VERSION Q1-26 83x83
ALL REPORTS, PLANS, SPECIFICATIONS, FIELD DATA, NOTES AND OTHER DOCUMENTS, INCLUDING ALL DOCUMENTS ON ELECTRONIC MEDIA, PREPARED BY THE DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. DISSEMINATION MAY NOT BE MADE WITHOUT PRIOR CONSENT OF THE DESIGN PROFESSIONAL. ALL COMMON LAW RIGHTS OF COPYRIGHT AND OTHERWISE, ARE HEREBY SPECIFICALLY RESERVED.

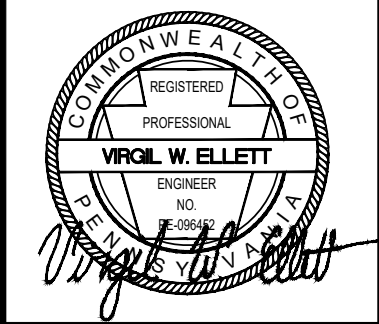

LIGHTING PLAN,
SCHEDULE &
NOTES

E3

